

Light Measurement Report

Print date: 17-7-2025

Measurement date and time: 21-11-2024 15:36:10 – Measurement no. VFR-241121-2098-MS

Measurement tracking No. and Link: [VT241121-006566](#)

Operator:



Laboratory and Equipment

Laboratory Owner and Location
Goniospectrometer System and Type
Sensor Name, Calibr. Date and Serial No.
Spectrometer Manufacturer and Model

Viso Systems, Copenhagen V, Denmark
LabSpion – Type C, horizontal
LabSensor Model2 – 11-1-2024 – 3130191315
Ibsen Photonics, Denmark – Freedom VIS (Custom Viso)

Measurement Conditions

Number of C-planes and Resolution
 γ (gamma)-Resolution
Test Distance
Input Power, Power and Displ. Factors
Input RMS Voltage and Current
Frequency of Input Power
Warm-up Time and Variation

12 planes – 30°
5°
12,10 m
32,3 W – PF 0,95 – DPF 0,0
230 V – 0,147 A
50 Hz
n/a – n/a%

Tested Light Source



Product Name
Item No. and Manufacturer
Product Description (line 1)

273702-3000K BATCH 2410
273702-3000K BATCH 2410 – Dutchfulfillment
SIDE-LIT LED PANEEL | DESDE | 150X18CM | 32W | CCT-SWITCH

Main Light Measurement Results

Output – Total Lumen (Up% / Down%)
Efficiency
Peak Intensity and Beam Angle
Correlated Color Temperature, Target/Measured
Color Rendering Index
Color Rendering TM30-18
Color Shift, CIE duv and MacAdam Steps
Flicker

2795 lm – 1,06% / 98,94%
87 lm/W
1424 cd – 82°
CCT = 3000 K / 3026 K
CRI 82,1
 R_f 84,1 – R_g 95,9
Duv -0,0003 – SDCM 1,0
SVM n/a – PstLM n/a

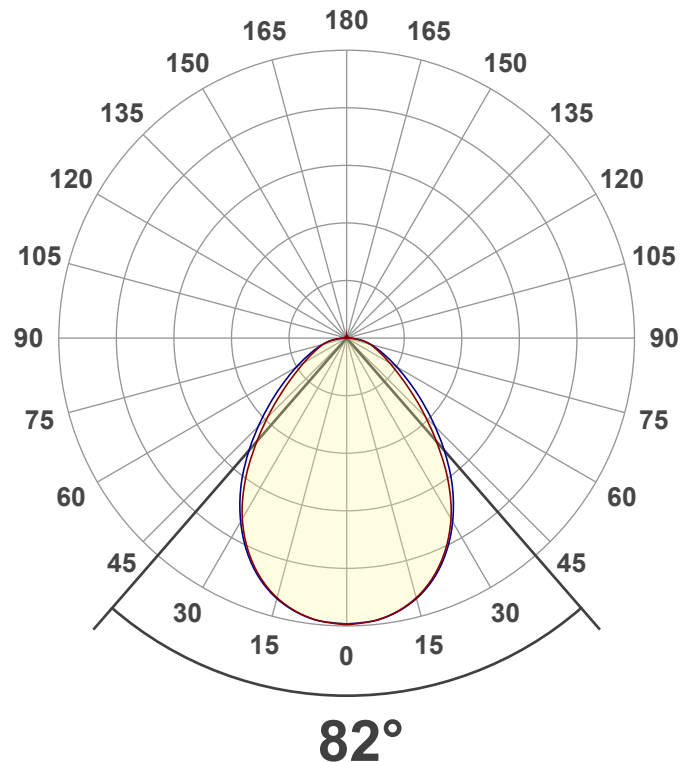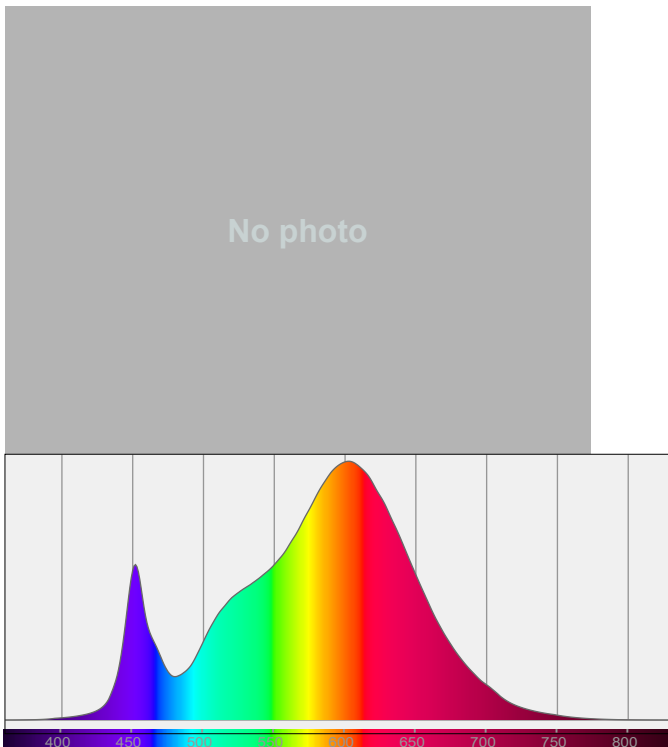

Light Measurement Report

Print date: 17-7-2025

Measurement date and time: 21-11-2024 15:36:10 – Measurement no. VFR-241121-2098-MS


Measurement tracking No. and Link: [VT241121-006566](https://www.viso-systems.com/VT241121-006566)

Operator:



Luminous Intensity diagram

Unit: 0-100% of peak intensity

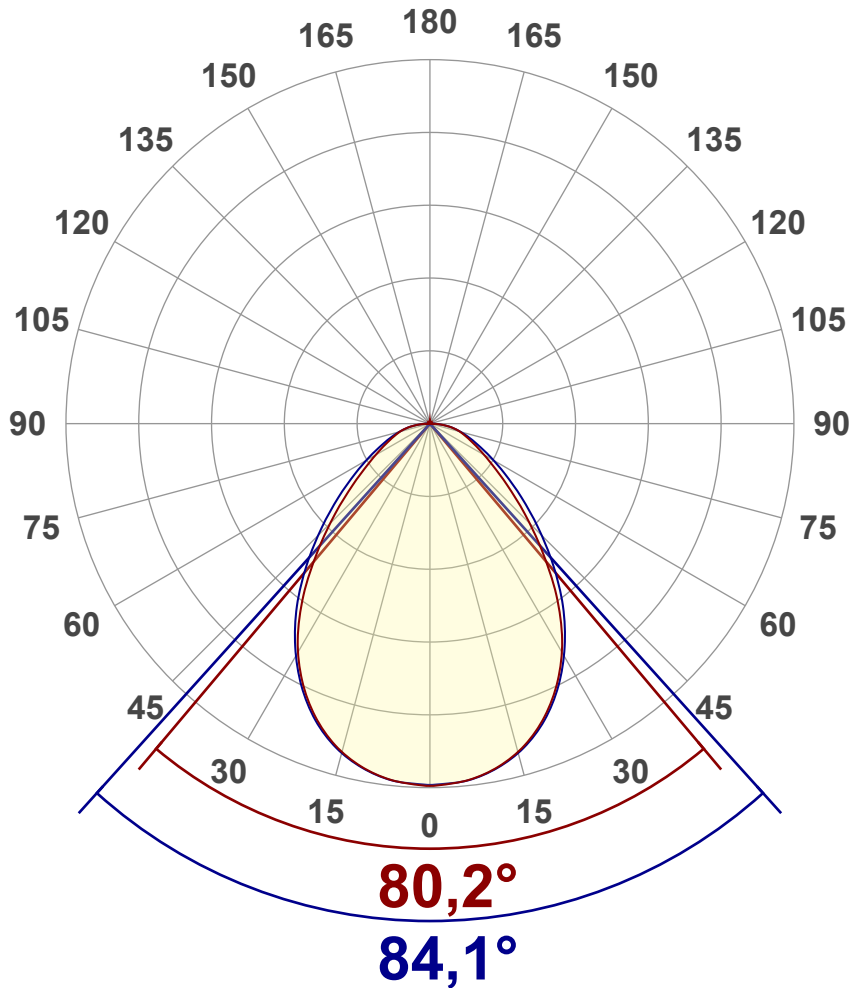

Main Values

Output (total Lumen)	2795 lm
Lumen Up% / Down%	1,06% / 98,94%
Peak Intensity	1424 cd
Beam Angle (50%)	82°
Beam Angle (90%)	84,1°
Beam Angle (10%)	80,2°

Cut-off Angle

Average 2,5%	172,1°
--------------	--------

Field Angle

Average 10%	144,9°
-------------	--------


Intensity Ratio

In 120° cone	85,2%
In 90° cone	66,5%

C000-C180

C090-C270

Linear distribution diagram - Intensity (candela) vs γ -angle

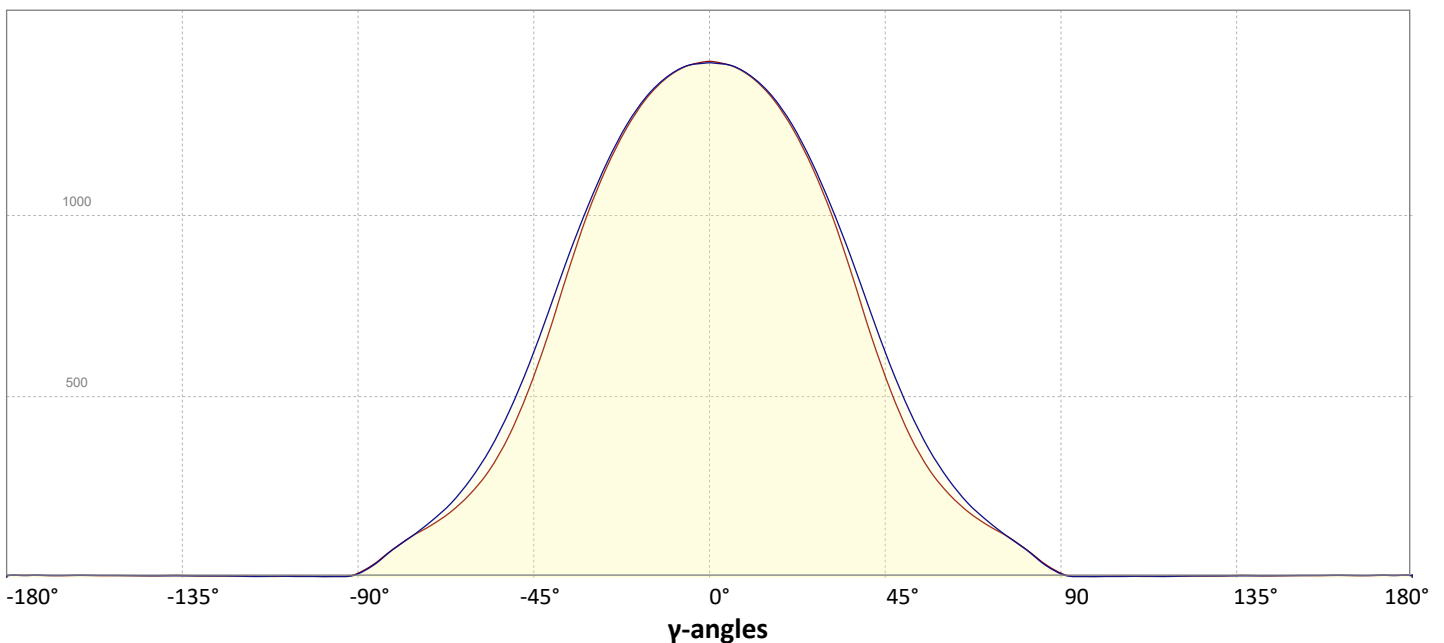

Light Measurement Report

Print date: 17-7-2025


Measurement date and time: 21-11-2024 15:36:10 – Measurement no. VFR-241121-2098-MS

Measurement tracking No. and Link: [VT241121-006566](https://www.viso-systems.com/VT241121-006566)

Operator:



Iso-intensity Diagram (Iso-candela)

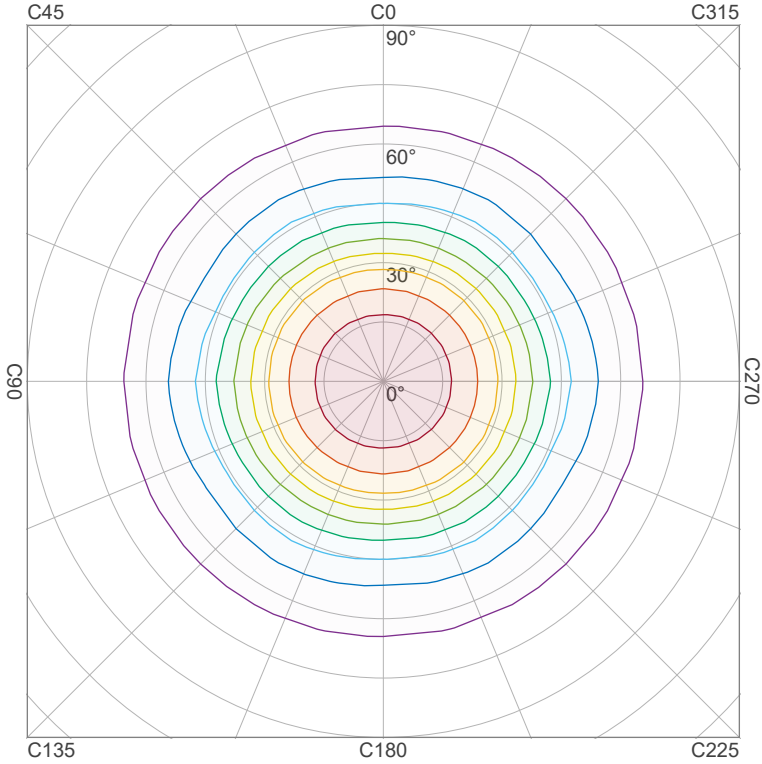


90 %	1281,7 cd
80 %	1139,3 cd
70 %	996,9 cd
60 %	854,5 cd
50 %	712,1 cd
40 %	569,6 cd
30 %	427,2 cd
20 %	284,8 cd
10 %	142,4 cd

Peak intensity: 1424,1 cd

Number of c-planes: 12

Iso-illuminance Diagram (Iso-lux)

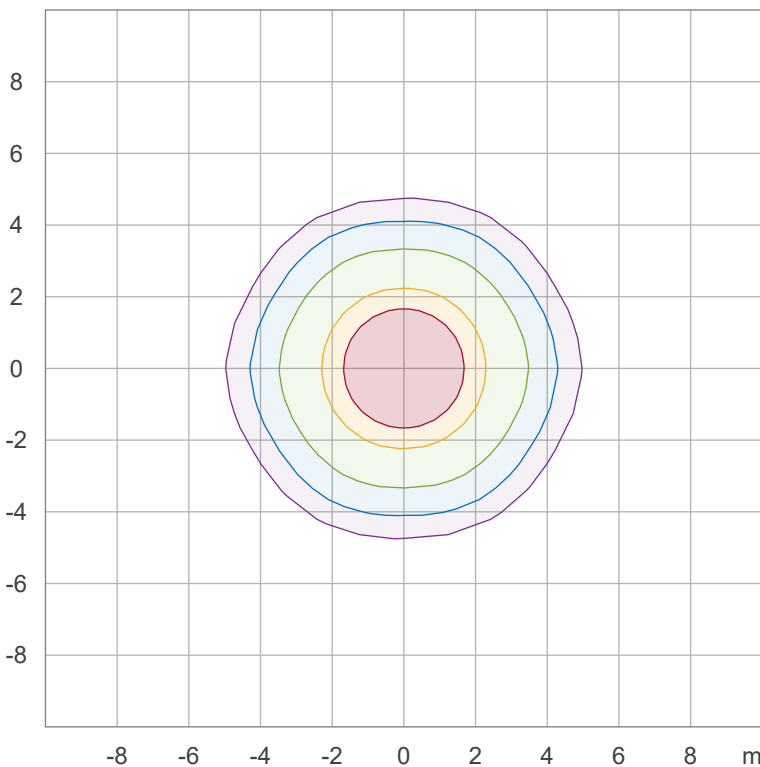

50,0 %	79,1 lx
30,0 %	47,4 lx
10,0 %	15,8 lx
5,0 %	7,9 lx
3,0 %	4,7 lx

Peak illuminance: 158,2 lx

Mounting height: 3,0 m

Number of c-planes: 12

Light Measurement Report

Print date: 17-7-2025

Measurement date and time: 21-11-2024 15:36:10 – Measurement no. VFR-241121-2098-MS

Measurement tracking No. and Link: [VT241121-006566](#)

Operator:




Color details

Correlated Color Temperature, Target CCT = 3000 K
 Correlated Color Temperature, Measured CCT = 3026 K
 Color Rendering Index CRI 82,1
 Color Rendering Index, R9 (red component) R9 = 3,7
 Color Rendering TM30-18 R_f 84,1 – R_g 95,9
 Color Quality Scale CQS = 81,2

MacAdam Steps SDCM = 1,0
 Color coordinates CIE 1931 (x;y) = (0,437;0,404)
 Color coordinate CIEs 1960 (u;v) = (0,251;0,348)
 Color deviation from BBL Duv = -0,0003
 Color coordinate CIEs 1976 (CIELUV) (u';v') = (0,251;0,521)


CIE 1931

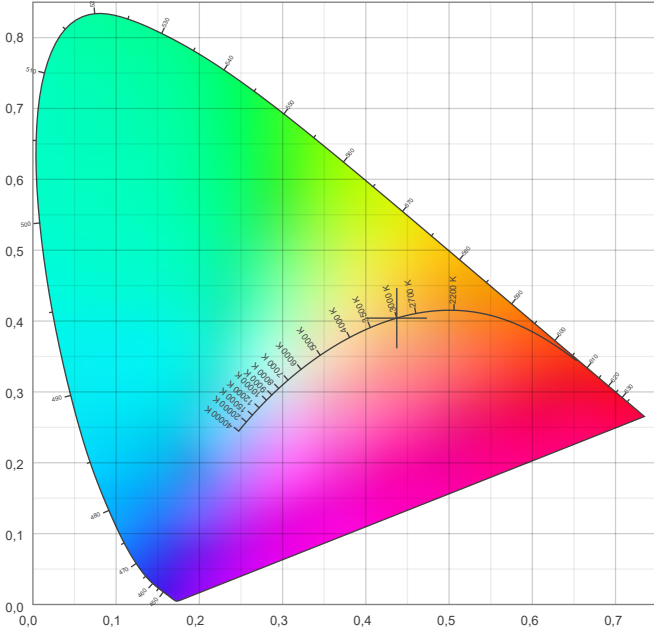

CIE 1931 – zoomed on Planckian locus




Color Rendering Index per reference color (CIE 1995)

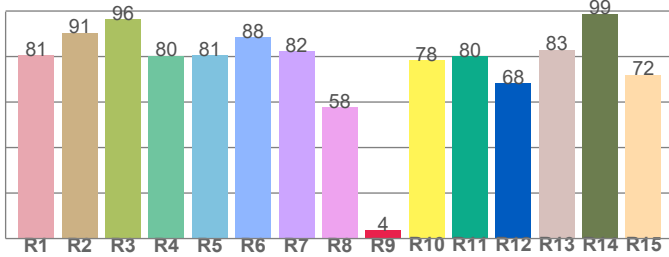


CRI R values, only R1-R8 are used to calculate final CRI value

R1	R2	R3	R4	R5	R6	R7	R8	R9	R10	R11	R12	R13	R14	R15
80,5	90,5	96,4	80,4	80,5	88,5	82,3	57,8	3,7	78,4	80,1	68,2	83,0	98,7	72,1

Spectral power distribution (SPD) / W/nm – 0-100%

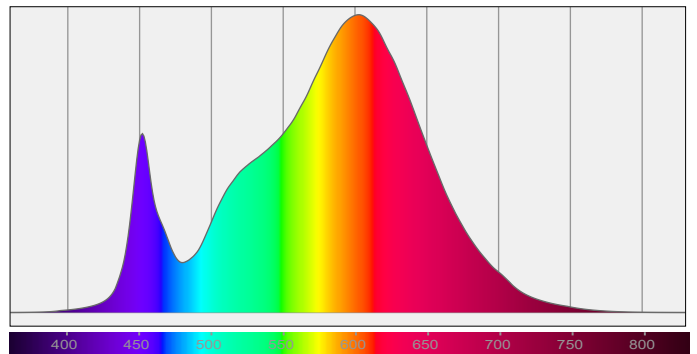


TM30-18 R_f-values per hue bin

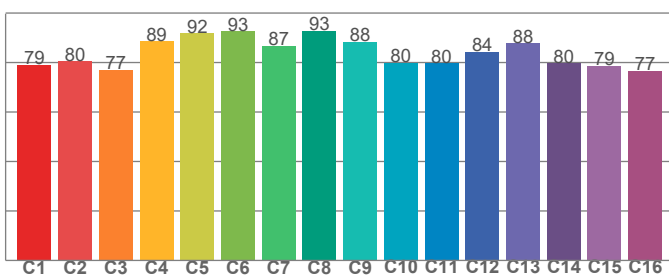

TM30 C values, 16 binned values out of total of 99 C values

C1	C2	C3	C4	C5	C6	C7	C8	C9	C10	C11	C12	C13	C14	C15	C16
79,2	80,5	77,1	88,7	91,7	92,8	86,8	92,9	88,5	79,9	79,8	84,4	87,9	79,7	78,7	76,7

Color Quality Scale by reference color

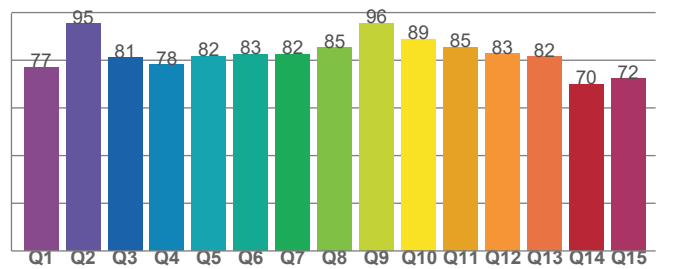

CQS Q values

Q1	Q2	Q3	Q4	Q5	Q6	Q7	Q8	Q9	Q10	Q11	Q12	Q13	Q14	Q15
77,1	95,2	81,0	78,1	81,8	82,6	82,5	85,2	95,5	88,8	85,4	82,7	81,5	69,9	72,3

Light Measurement Report

Print date: 17-7-2025


Measurement date and time: 21-11-2024 15:36:10 – Measurement no. VFR-241121-2098-MS

Measurement tracking No. and Link: [VT241121-006566](https://www.viso-systems.com/VT241121-006566)

Operator:



Beam Details

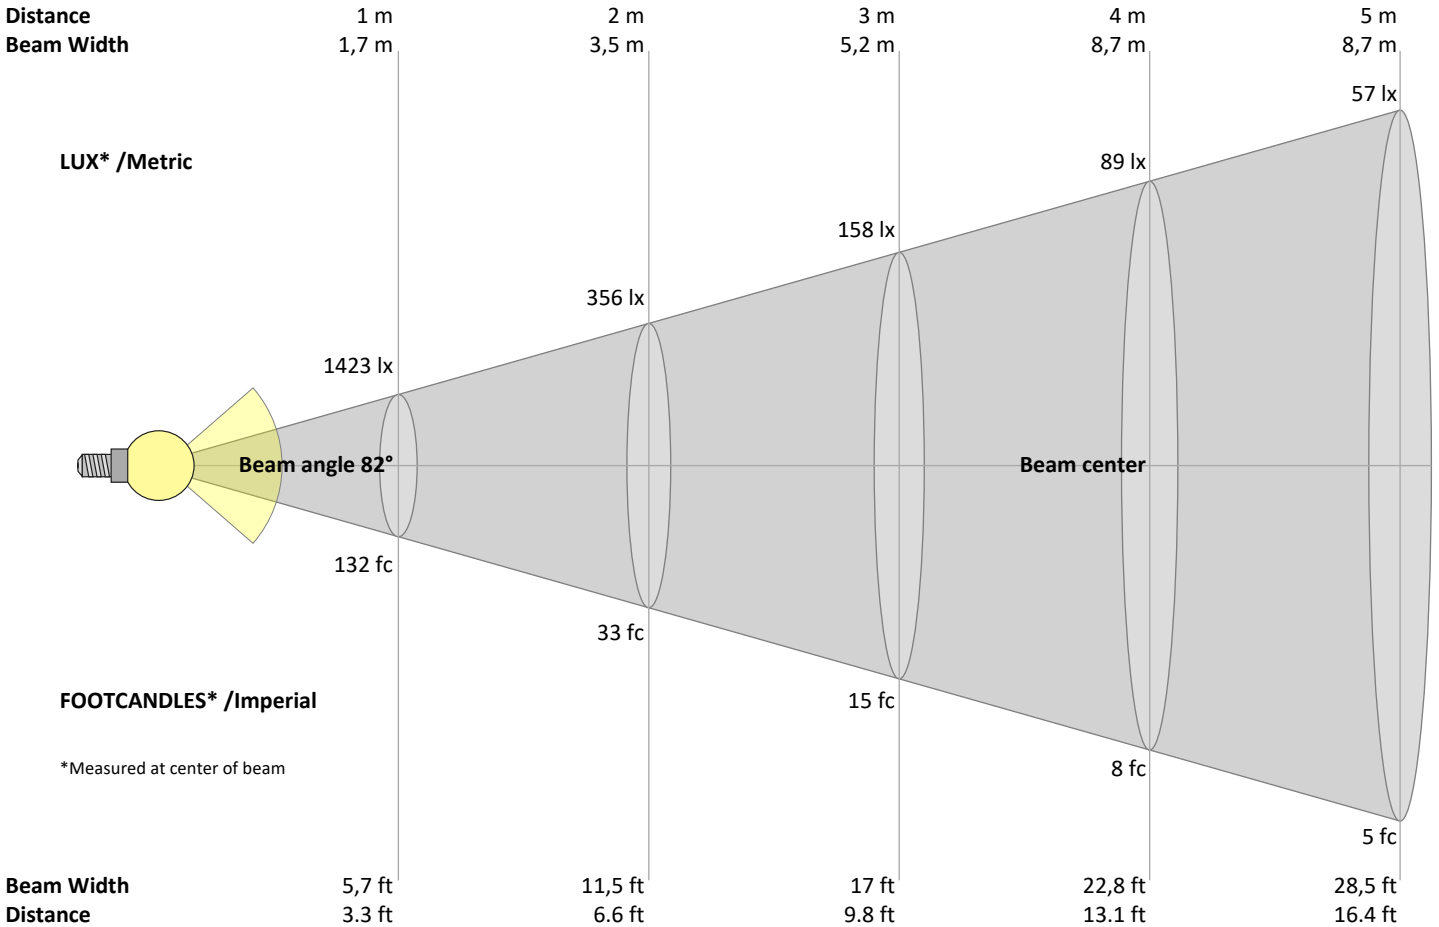

Beam intensities from 1 – 20 m

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	m
3,3	6,6	9,8	13,1	16,4	19,7	23	26,2	29,5	32,8	36,1	39,4	42,7	45,9	49,2	52,5	55,8	59,1	62,3	65,6	ft
1423	356	158	89	57	40	29	22	18	14	12	10	8	7	6	6	5	4	4	4	lux
132,2	33	14,7	8,3	5,3	3,7	2,7	2,1	1,6	1,3	1,1	0,9	0,8	0,7	0,6	0,5	0,5	0,4	0,4	0,3	fc

Intensities in 0° c-plane

0°	5°	10°	15°	20°	25°	30°	35°	40°	45°	50°	55°	60°	65°	70°	75°	80°	85°	90°	95°	γ
1423	1414	1385	1335	1261	1161	1036	884	715	558	426	323	249	194	154	122	86	46	15	5	cd
100%	99%	97%	94%	89%	82%	73%	62%	50%	39%	30%	23%	17%	14%	11%	9%	6%	3%	1%	0%	of 0°val

Intensities in 90° c-plane

0°	5°	10°	15°	20°	25°	30°	35°	40°	45°	50°	55°	60°	65°	70°	75°	80°	85°	90°	95°	γ
1423	1414	1388	1340	1269	1172	1053	919	771	624	492	380	291	221	168	125	86	44	13	4	cd
100%	99%	98%	94%	89%	82%	74%	65%	54%	44%	35%	27%	20%	16%	12%	9%	6%	3%	1%	0%	of 0°val

Intensities in 180° c-plane

0°	5°	10°	15°	20°	25°	30°	35°	40°	45°	50°	55°	60°	65°	70°	75°	80°	85°	90°	95°	γ
1423	1414	1385	1335	1261	1161	1036	884	715	558	426	323	249	194	154	122	86	46	15	5	cd
100%	99%	97%	94%	89%	82%	73%	62%	50%	39%	30%	23%	17%	14%	11%	9%	6%	3%	1%	0%	of 0°val

Intensities in 270° c-plane

0°	5°	10°	15°	20°	25°	30°	35°	40°	45°	50°	55°	60°	65°	70°	75°	80°	85°	90°	95°	γ
1423	1414	1388	1340	1269	1172	1053	919	771	624	492	380	291	221	168	125	86	44	13	4	cd
100%	99%	98%	94%	89%	82%	74%	65%	54%	44%	35%	27%	20%	16%	12%	9%	6%	3%	1%	0%	of 0°val

Light Measurement Report

Print date: 17-7-2025

Measurement date and time: 21-11-2024 15:36:10 – Measurement no. VFR-241121-2098-MS

Measurement tracking No. and Link: [VT241121-006566](https://www.viso-systems.com/VT241121-006566)

Operator:



Light Planning – UGR table

Uncorrected, comprehensive UGR table according to 117-1995

Reflectances		70	70	50	50	30	70	70	50	50	30
	ρ Ceiling	70	70	50	50	30	70	70	50	50	30
	ρ Walls	50	30	50	30	30	50	30	50	30	30
	ρ Floor	20	20	20	20	20	20	20	20	20	20
Room size		Viewed Crosswise					Viewed Endwise				
H = mounting height above eye level		(Viewing direction orthogonal to lamp length axis)					(Viewing direction parallel to lamp length axis)				
X	Y										
2H	2H	15,6	16,6	15,8	16,9	17,2	16,1	17,1	16,3	17,4	17,7
	3H	16,4	17,5	16,9	17,8	18,0	17,1	18,2	17,5	18,5	18,7
	4H	16,9	18,0	17,4	18,3	18,5	17,6	18,7	18,0	18,9	19,2
	6H	17,5	18,4	17,8	18,7	19,1	18,2	19,1	18,5	19,4	19,8
	8H	17,6	18,5	18,0	18,8	19,3	18,3	19,2	18,7	19,6	20,0
	12H	17,7	18,6	18,1	18,9	19,4	18,5	19,3	18,9	19,7	20,2
4H	2H	15,9	17,0	16,3	17,3	17,5	16,3	17,4	16,8	17,7	18,0
	3H	17,2	18,0	17,5	18,4	18,9	17,7	18,6	18,1	18,9	19,4
	4H	17,7	18,6	18,2	19,0	19,5	18,3	19,1	18,8	19,5	20,1
	6H	18,3	19,1	18,8	19,5	19,9	18,9	19,7	19,5	20,1	20,5
	8H	18,6	19,3	19,1	19,7	20,1	19,2	19,9	19,7	20,3	20,7
	12H	18,7	19,3	19,2	19,7	20,2	19,4	20,0	19,9	20,4	20,9
8H	4H	18,0	18,7	18,5	19,1	19,5	18,5	19,2	19,1	19,6	20,0
	6H	18,8	19,3	19,3	19,8	20,4	19,3	19,9	19,9	20,3	20,9
	8H	19,1	19,6	19,7	20,1	20,8	19,7	20,2	20,3	20,7	21,4
	12H	19,4	19,8	20,0	20,3	20,9	20,0	20,4	20,6	20,9	21,5
12H	4H	18,0	18,6	18,6	19,1	19,6	18,5	19,1	19,0	19,6	20,1
	6H	18,9	19,4	19,4	19,9	20,5	19,4	19,9	20,0	20,4	21,1
	8H	19,3	19,6	19,9	20,2	20,8	19,8	20,2	20,4	20,7	21,3

Variations with the observer position for the luminaire spacings, S:

S = 1.0H	0,2 / -0,3	0,1 / -0,2
S = 1.5H	0,4 / -0,5	0,4 / -0,4
S = 2.0H	0,8 / -0,8	0,9 / -0,7

Coefficients of Utilization

Ceiling reflectance	80			70			50			30			10			0		
Wall reflectance	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
Floor reflectance	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	0
RCR	(RCR: Room Cavity Ratio)																	
	Room Values are expressed as percentage of Lumen delivered to the task surface																	
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	101	101	101	99
1	110	106	102	98	107	103	100	97	99	96	93	95	92	90	91	89	88	85
2	101	94	88	83	99	92	86	82	88	84	80	85	81	78	82	79	76	74
3	93	84	77	71	91	82	76	70	79	74	69	77	72	68	74	70	66	64
4	86	76	68	62	84	74	67	61	72	65	60	69	64	59	67	63	59	57
5	80	69	60	54	78	67	60	54	65	59	53	63	57	53	61	56	52	50
6	75	63	54	49	73	62	54	48	60	53	48	58	52	47	56	51	47	45
7	70	57	49	44	68	56	49	43	55	48	43	53	47	43	52	47	42	41
8	65	53	45	40	64	52	45	39	51	44	39	49	43	39	48	43	39	37
9	61	49	41	36	60	48	41	36	47	40	36	46	40	35	45	39	35	34
10	58	45	38	33	56	45	38	33	44	37	33	43	37	33	42	36	32	31

Light Measurement Report

Print date: 17-7-2025

Measurement date and time: 21-11-2024 15:36:10 – Measurement no. VFR-241121-2098-MS

Measurement tracking No. and Link: [VT241121-006566](https://www.viso-systems.com/VT241121-006566)


Operator:



Luminaire budgetary diagram

Uncorrected, comprehensive UGR table according to 117-1995

LAMPS (number of lamps)

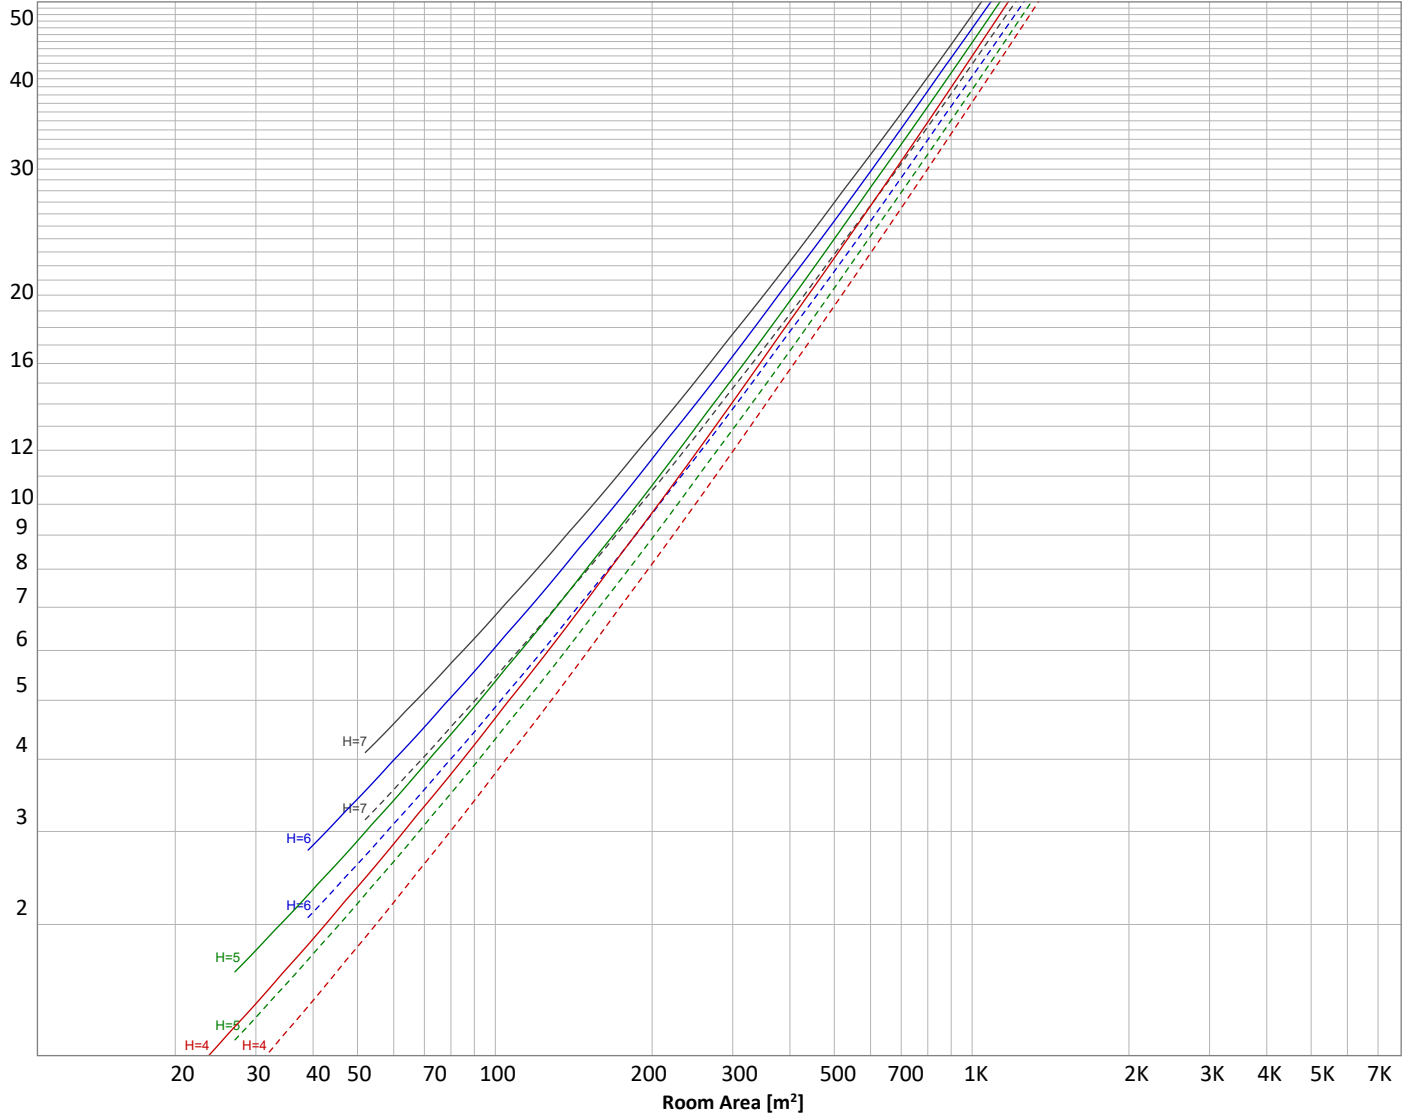

Conditions

H = Room height	Flux = 2795 lm				
H _{down} = Lamp distance from ceiling =	0.00 m	Line type	Ceiling reflectance	ρ(%) Wall reflectance	Floor reflectance
H _{work} = Work area height from floor =	0.00 m	-----	70	50	30
E _{work} = Average lux on work area =	100 lx	—————	50	30	20

Zonal Lumen Summary

0°-10°	10°-20°	20°-30°	30°-40°	40°-50°	50°-60°	60°-70°	70°-80°	80°-90°
134 lm	378 lm	537 lm	565 lm	454 lm	314 lm	204 lm	131 lm	48,9 lm
90°-100°	100°-110°	110°-120°	120°-130°	130°-140°	140°-150°	150°-160°	160°-170°	170°-180°
4,29 lm	4,11 lm	4,02 lm	4,24 lm	4,04 lm	3,64 lm	2,82 lm	1,79 lm	0,649 lm

Light Measurement Report

Print date: 17-7-2025

Measurement date and time: 21-11-2024 15:36:10 – Measurement no. VFR-241121-2098-MS

Measurement tracking No. and Link: [VT241121-006566](#)

Operator:




Power Details


Input Power

Power feed to light source	32,3 W
Frequency of input power	50 Hz
RMS Input voltage feed, V_{RMS}	230 V
RMS Input current feed, I_{RMS}	0,147 A
Volt-Ampere or apparent power = $V_{RMS} * I_{RMS}$	33,91 VA
Displacement factor of AC power feed	0,0
Power factor of AC current feed	0,95
Total harmonic distortion of the current	0%
Total harmonic distortion of the voltage	0%

Input Power Curve



Efficiency

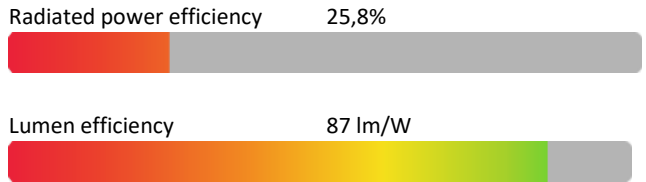

Stabilization Details

Warmup Conditions

Stable period	n/a
Stable change max	n/a%
Minimum time	n/a

Color Temperature Change

CCT start	n/a K
CCT shift	n/a K
CCT end	3000 K


Warmup Result

Total warmup time	n/a
Warmup variation	n/a%

Output Change

Output start	n/a lm
Output change	n/a lm
Output end	2795 lm

Stabilization Curve

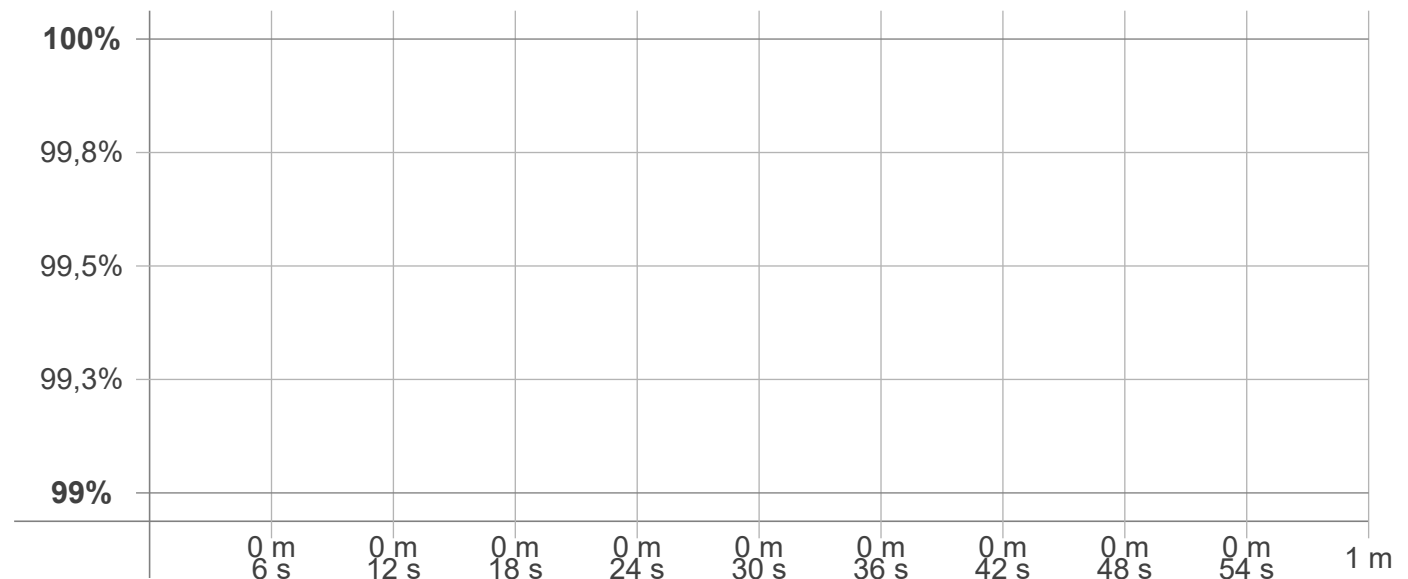

Light Measurement Report

Print date: 17-7-2025

Measurement date and time: 21-11-2024 15:36:10 – Measurement no. VFR-241121-2098-MS

Measurement tracking No. and Link: [VT241121-006566](https://www.viso-systems.com/VT241121-006566)

Operator:



Flicker /TLA details

Flicker Meter Type: Viso Systems LabFlicker
 Frequency of input power: 50 Hz
 Flicker/TLA sample rate: n/a samples/s

Measurement time
 PstLM: 180 sec
 All other indices: 1,2 sec

Flicker indices according to Illuminating Engineering Society (IES)

Flicker frequency: n/a Hz
 Percent Flicker: n/a %
 Flicker index: n/a

Flicker indices according to California Energy Commission (CEC) 2016b

JA8/10 40 Hz: n/a %
 JA8/10 90 Hz: n/a %
 JA8/10 200 Hz: n/a %
 JA8/10 400 Hz: n/a %
 JA8/10 1000 Hz: n/a %


TLA indices (re IEC TR 61547-1, IEC 61000-3-3 and IEC 61000-4-15)

PstLM value (F < 80 Hz): n/a
 SVM value (80 < F < 2000 Hz): n/a

Flicker indices according to Lighting Research Center (2015)

Perception metric, Assist Mp: n/a

Flicker frame (frame of one flicker period in time domain)

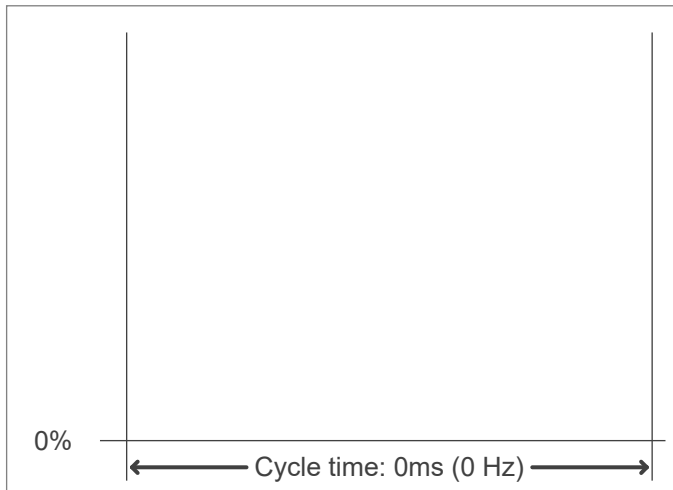

Flicker FFT (flicker curve in frequency domain)



IEEE 1789 Frequency/modulation plot

