

# Light Measurement Report

Print date: 28-11-2024

Measurement date and time: 28-11-2024 10:12:31 – Measurement no. VFR-241128-2236-MS

Measurement tracking No. and Link: [VT241128-007267](https://www.viso-systems.com/track/VT241128-007267)

Operator:



## Laboratory and Equipment

Laboratory Owner and Location  
Goniospectrometer System and Type  
Sensor Name, Calibr. Date and Serial No.  
Spectrometer Manufacturer and Model

Viso Systems, Copenhagen V, Denmark  
LabSpion – Type C, horizontal  
LabSensor Model2 – 11-1-2024 – 3130191315  
Ibsen Photonics, Denmark – Freedom VIS (Custom Viso)

## Measurement Conditions

Number of C-planes and Resolution  
 $\gamma$  (gamma)-Resolution  
Test Distance  
Input Power, Power and Displ. Factors  
Input RMS Voltage and Current  
Frequency of Input Power  
Warm-up Time and Variation

32 planes – 11,25°  
5°  
1,99 m  
7,5 W – PF 0,83 – DPF 0,97  
230 V – 0,039 A  
50 Hz  
Lamp stabilized in 16 min 50 sec – 2,0%

## Tested Light Source



Product Name  
Item No. and Manufacturer  
Product Description (line 1)

800741-4000K  
800741-4000K – Dutchfulfillment  
GU10 SPOT | DIM | ZOOMABLE | 7.5W

## Main Light Measurement Results

Output – Total Lumen (Up% / Down%)  
Efficiency  
Peak Intensity and Beam Angle  
Correlated Color Temperature, Target/Measured  
Color Rendering Index  
Color Rendering TM30-18  
Color Shift, CIE duv and MacAdam Steps  
Flicker

492 lm – 0,6% / 99,4%  
65 lm/W  
570 cd – 49,5°  
CCT = 4000 K / 4046 K  
CRI 96,1  
R<sub>f</sub> 90,6 – R<sub>g</sub> 96,8  
Duv 0,0010 – SDCM 1,2  
SVM 0,02 – PstLM 0,06

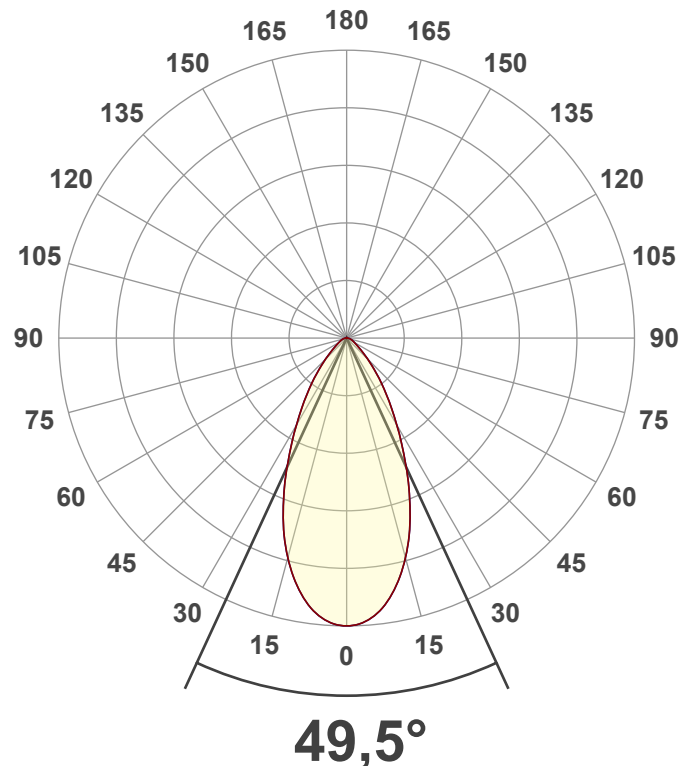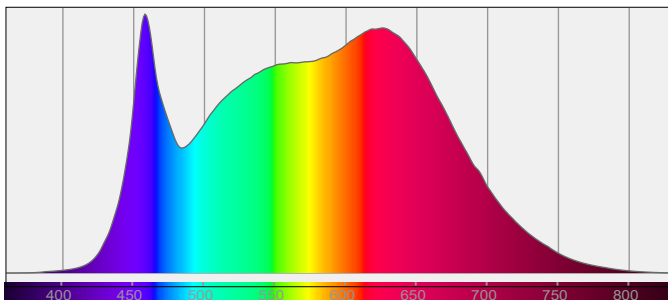

# Light Measurement Report

Print date: 28-11-2024

Measurement date and time: 28-11-2024 10:12:31 – Measurement no. VFR-241128-2236-MS


Measurement tracking No. and Link: [VT241128-007267](https://www.viso-systems.com/VT241128-007267)

Operator:



## Luminous Intensity diagram

Unit: 0-100% of peak intensity

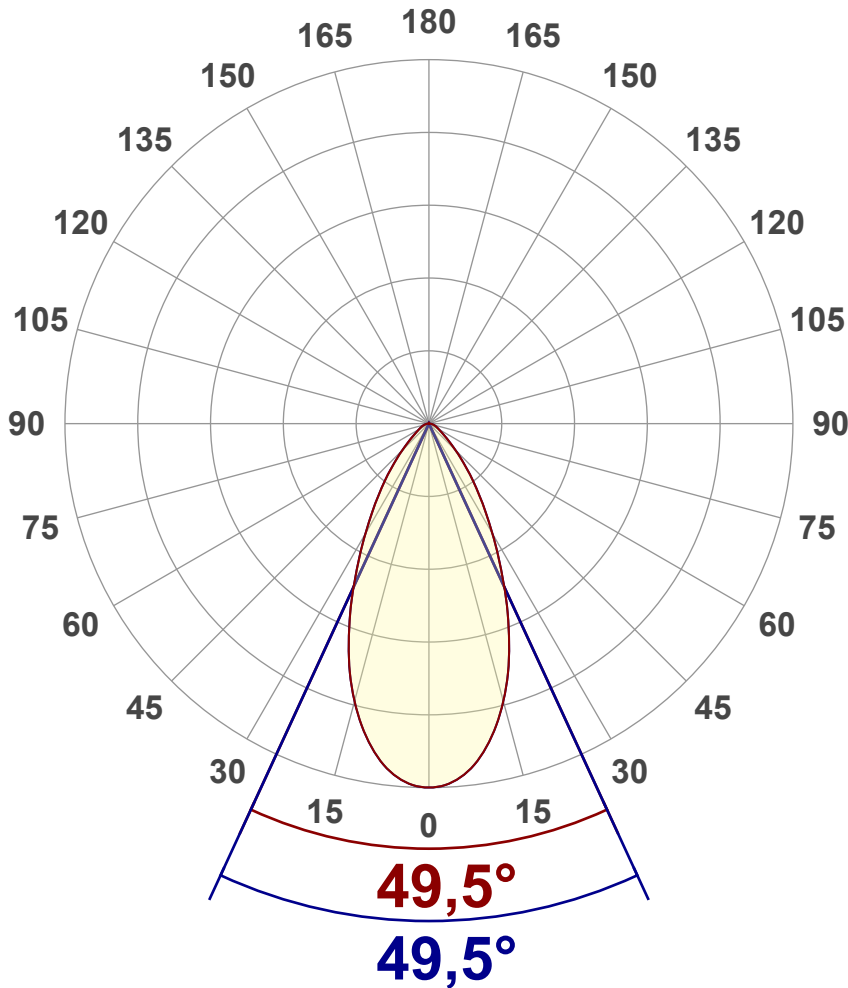

### Main Values

Output (total Lumen)	492 lm
Lumen Up% / Down%	0,6% / 99,4%
Peak Intensity	570 cd
Beam Angle (50%)	49,5°
Beam Angle (90%)	49,5°
Beam Angle (10%)	49,5°

### Cut-off Angle

Average 2,5%	129,2°
--------------	--------

### Field Angle

Average 10%	91,3°
-------------	-------


### Intensity Ratio

In 120° cone	94,2%
In 90° cone	85,7%

**C000-C180**

**C090-C270**

## Linear distribution diagram - Intensity (candela) vs $\gamma$ -angle

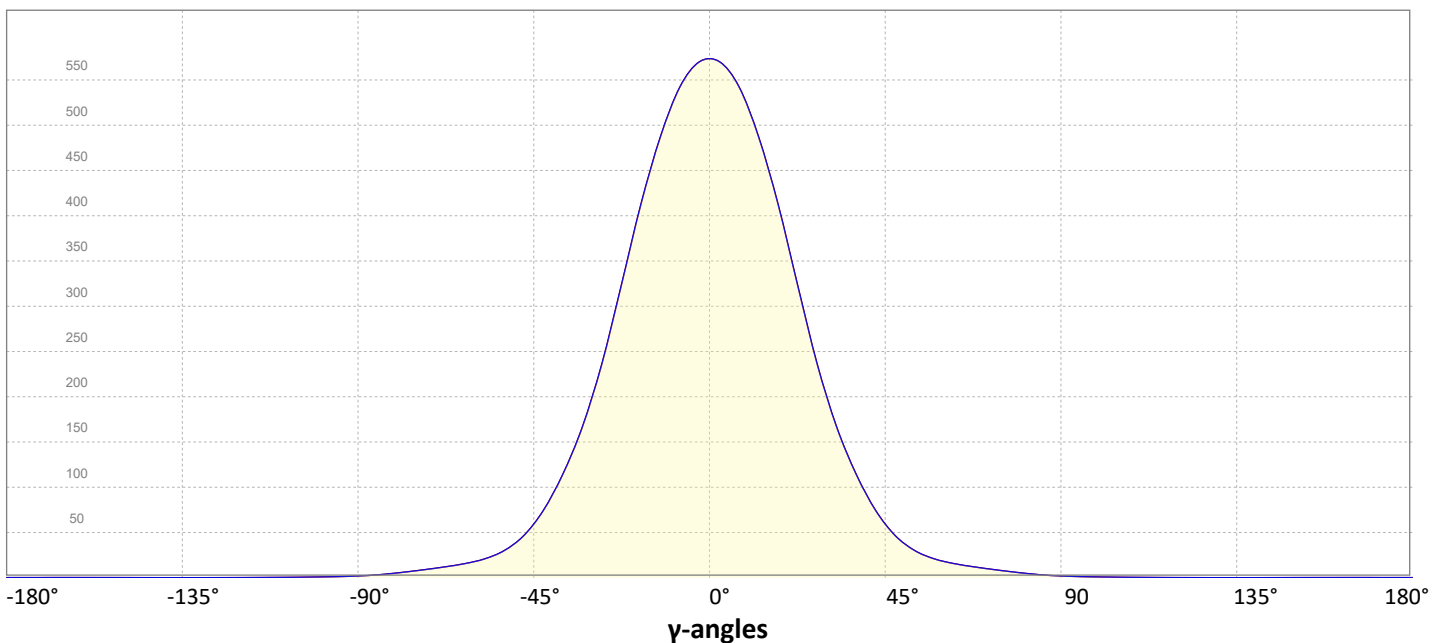

# Light Measurement Report

Print date: 28-11-2024


Measurement date and time: 28-11-2024 10:12:31 – Measurement no. VFR-241128-2236-MS

Measurement tracking No. and Link: [VT241128-007267](https://www.viso-systems.com/VT241128-007267)

Operator:



## Iso-intensity Diagram (Iso-candela)

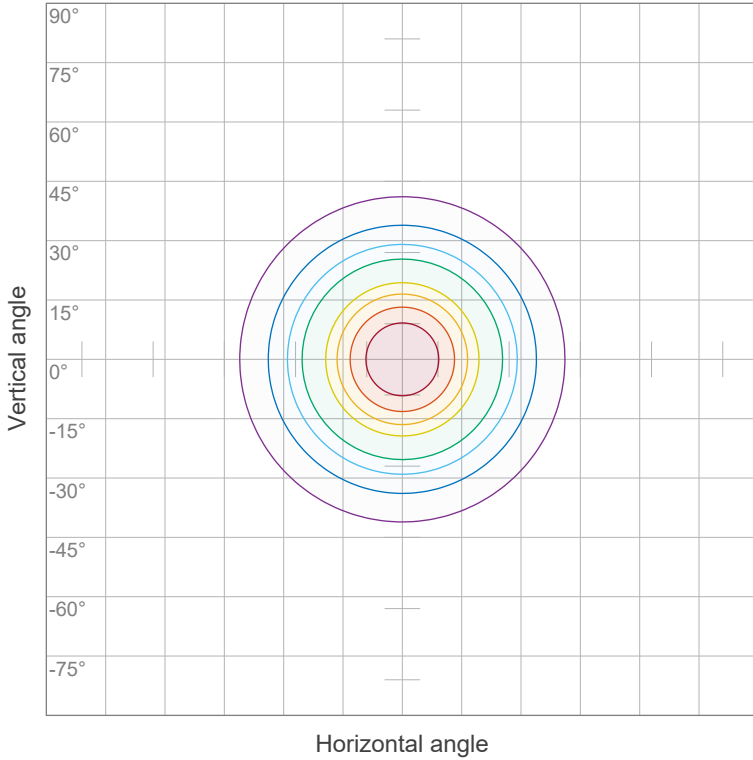


90 %	513,1 cd
80 %	456,0 cd
70 %	399,0 cd
60 %	342,0 cd
50 %	285,0 cd
40 %	228,0 cd
30 %	171,0 cd
20 %	114,0 cd
10 %	57,0 cd

Peak intensity: 570,1 cd

Number of c-planes: 32

## Iso-illuminance Diagram (Iso-lux)

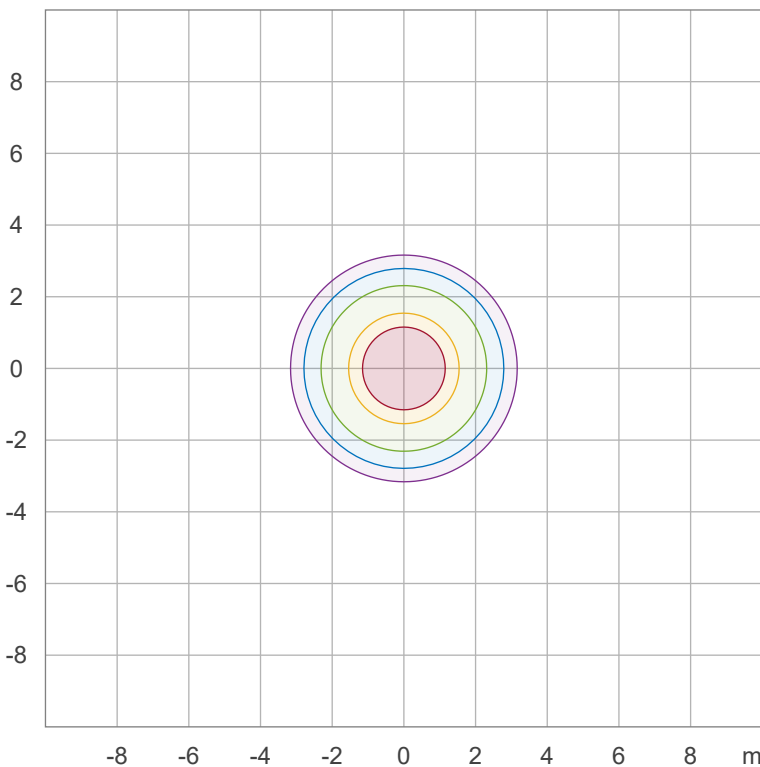

50,0 %	31,7 lx
30,0 %	19,0 lx
10,0 %	6,3 lx
5,0 %	3,2 lx
3,0 %	1,9 lx

Peak illuminance: 63,3 lx

Mounting height: 3,0 m

Number of c-planes: 32

# Light Measurement Report

Print date: 28-11-2024

Measurement date and time: 28-11-2024 10:12:31 – Measurement no. VFR-241128-2236-MS

Measurement tracking No. and Link: [VT241128-007267](#)

Operator:



## Color details

Correlated Color Temperature, Target CCT = 4000 K  
 Correlated Color Temperature, Measured CCT = 4046 K  
 Color Rendering Index CRI 96,1  
 Color Rendering Index, R9 (red component) R9 = 86,0  
 Color Rendering TM30-18 R<sub>f</sub> 90,6 – R<sub>g</sub> 96,8  
 Color Quality Scale CQS = 93,9

MacAdam Steps  
 Color coordinates CIE 1931 (x;y) = (0,381;0,377)  
 Color coordinate CIEs 1960 (u;v) = (0,225;0,334)  
 Color deviation from BBL Duv = 0,0010  
 Color coordinate CIEs 1976 (CIELUV) (u';v') = (0,225;0,502)


### CIE 1931



### CIE 1931 – zoomed on Planckian locus




### Color Rendering Index per reference color (CIE 1995)

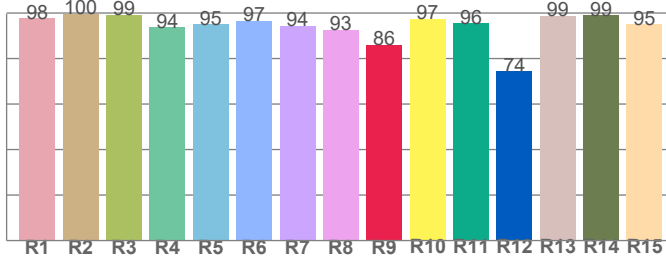


CRI R values, only R1-R8 are used to calculate final CRI value

R1	R2	R3	R4	R5	R6	R7	R8	R9	R10	R11	R12	R13	R14	R15
97,7	99,6	99,2	93,9	95,1	96,6	94,4	92,6	86,0	97,5	95,6	74,5	98,9	98,9	95,1

### Spectral power distribution (SPD) / W/nm – 0-100%

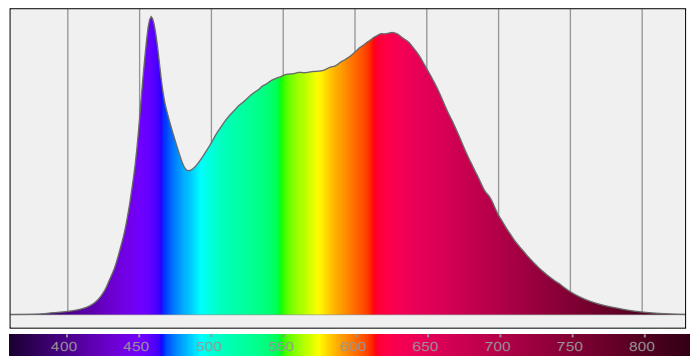


### TM30-18 R<sub>f</sub>-values per hue bin

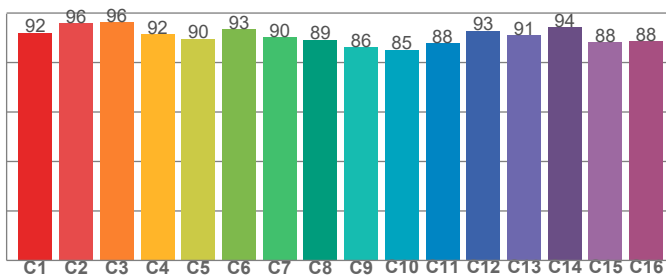

TM30 C values, 16 binned values out of total of 99 C values

C1	C2	C3	C4	C5	C6	C7	C8	C9	C10	C11	C12	C13	C14	C15	C16
92,0	95,9	96,2	91,5	89,6	93,4	90,3	89,2	86,1	85,2	87,9	92,9	91,1	94,2	88,1	88,5

### Color Quality Scale by reference color

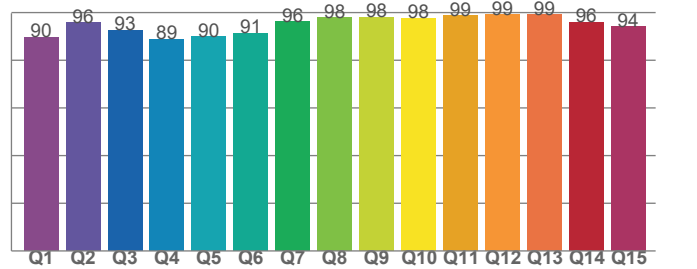

CQS Q values

Q1	Q2	Q3	Q4	Q5	Q6	Q7	Q8	Q9	Q10	Q11	Q12	Q13	Q14	Q15
89,6	95,8	92,7	88,9	89,9	91,3	96,3	97,8	98,0	97,7	98,7	99,1	99,0	96,0	94,0

# Light Measurement Report

Print date: 28-11-2024


Measurement date and time: 28-11-2024 10:12:31 – Measurement no. VFR-241128-2236-MS

Measurement tracking No. and Link: [VT241128-007267](https://www.viso-systems.com/VT241128-007267)

Operator:



## Beam Details

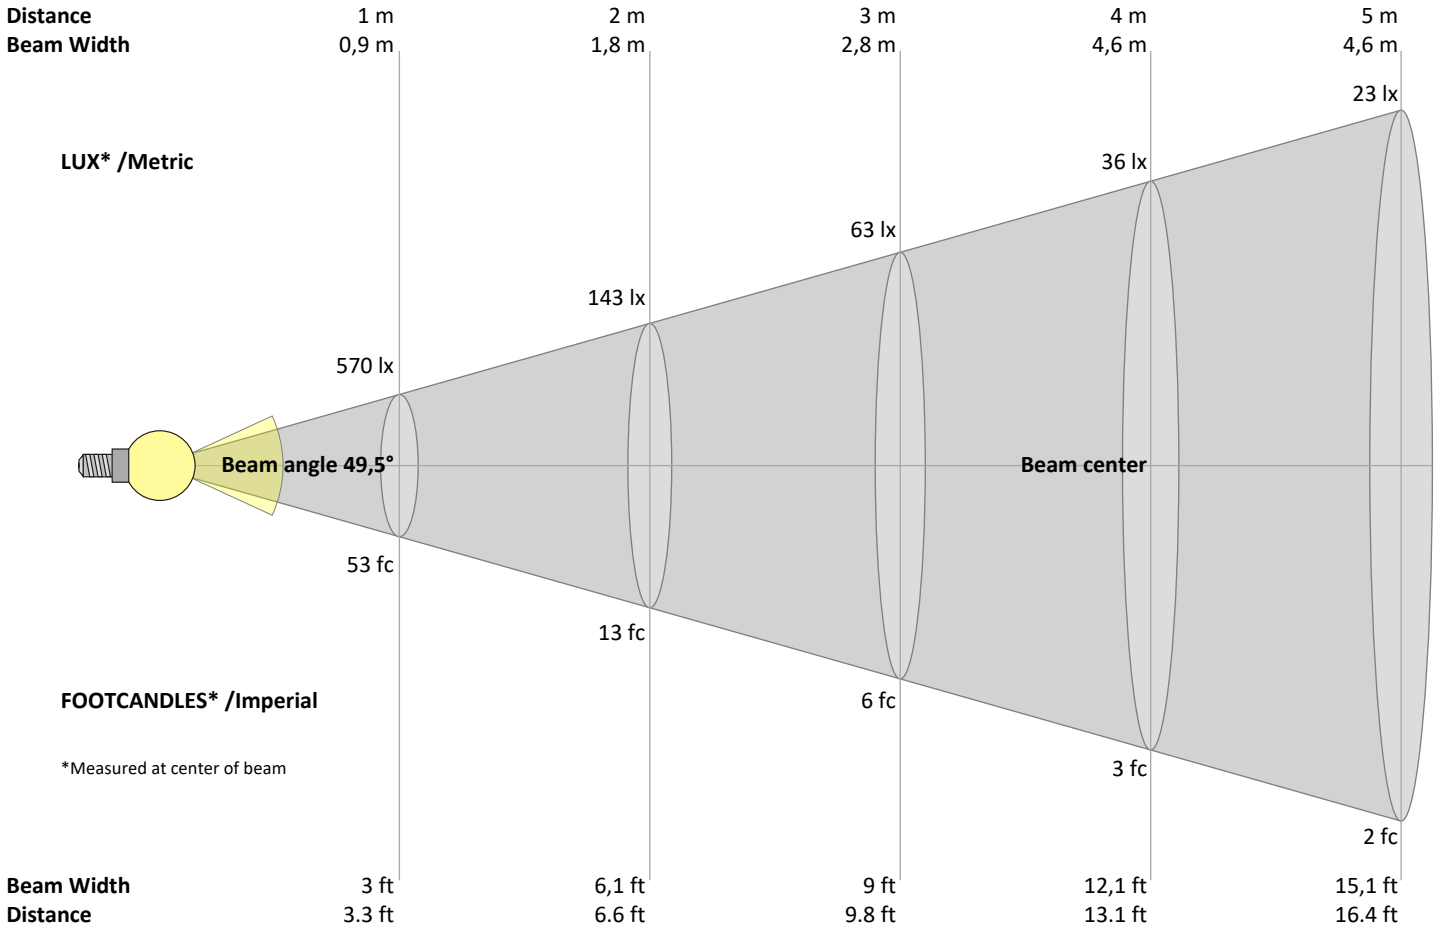

### Beam intensities from 1 – 20 m

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	m
3,3	6,6	9,8	13,1	16,4	19,7	23	26,2	29,5	32,8	36,1	39,4	42,7	45,9	49,2	52,5	55,8	59,1	62,3	65,6	ft
570	143	63	36	23	16	12	9	7	6	5	4	3	3	3	2	2	2	2	1	lux
53	13,2	5,9	3,3	2,1	1,5	1,1	0,8	0,7	0,5	0,4	0,4	0,3	0,3	0,2	0,2	0,2	0,2	0,1	0,1	fc

### Intensities in 0° c-plane

0°	2°	4°	6°	8°	10°	12°	14°	16°	18°	20°	22°	24°	26°	28°	30°	32°	34°	36°	38°	γ
570	570	562	551	538	516	494	466	436	405	369	333	298	264	230	202	174	152	131	111	cd
100%	100%	99%	97%	94%	90%	87%	82%	76%	71%	65%	58%	52%	46%	40%	35%	31%	27%	23%	19%	of 0°val

### Intensities in 90° c-plane

0°	2°	4°	6°	8°	10°	12°	14°	16°	18°	20°	22°	24°	26°	28°	30°	32°	34°	36°	38°	γ
570	570	562	551	538	516	494	466	436	405	369	333	298	264	230	202	174	152	131	111	cd
100%	100%	99%	97%	94%	90%	87%	82%	76%	71%	65%	58%	52%	46%	40%	35%	31%	27%	23%	19%	of 0°val

### Intensities in 180° c-plane

0°	2°	4°	6°	8°	10°	12°	14°	16°	18°	20°	22°	24°	26°	28°	30°	32°	34°	36°	38°	γ
570	570	562	551	538	516	494	466	436	405	369	333	298	264	230	202	174	152	131	111	cd
100%	100%	99%	97%	94%	90%	87%	82%	76%	71%	65%	58%	52%	46%	40%	35%	31%	27%	23%	19%	of 0°val

### Intensities in 270° c-plane

0°	2°	4°	6°	8°	10°	12°	14°	16°	18°	20°	22°	24°	26°	28°	30°	32°	34°	36°	38°	γ
570	570	562	551	538	516	494	466	436	405	369	333	298	264	230	202	174	152	131	111	cd
100%	100%	99%	97%	94%	90%	87%	82%	76%	71%	65%	58%	52%	46%	40%	35%	31%	27%	23%	19%	of 0°val

# Light Measurement Report

Print date: 28-11-2024

Measurement date and time: 28-11-2024 10:12:31 – Measurement no. VFR-241128-2236-MS

Measurement tracking No. and Link: [VT241128-007267](https://www.viso-systems.com/VT241128-007267)

Operator:



## Light Planning – UGR table

Uncorrected, comprehensive UGR table according to 117-1995

Reflectances		70	70	50	50	30	70	70	50	50	30
	ρ Ceiling	70	70	50	50	30	70	70	50	50	30
	ρ Walls	50	30	50	30	30	50	30	50	30	30
	ρ Floor	20	20	20	20	20	20	20	20	20	20
Room size		Viewed Crosswise					Viewed Endwise				
H = mounting height above eye level		(Viewing direction orthogonal to lamp length axis)					(Viewing direction parallel to lamp length axis)				
X	Y										
2H	2H	21,6	22,3	21,7	22,6	22,8	21,6	22,3	21,7	22,6	22,8
	3H	21,8	22,7	22,2	22,9	23,1	21,8	22,7	22,2	22,9	23,1
	4H	22,0	22,8	22,4	23,0	23,3	22,0	22,8	22,4	23,0	23,3
	6H	22,2	22,9	22,5	23,2	23,5	22,2	22,9	22,5	23,2	23,5
	8H	22,2	22,9	22,5	23,2	23,6	22,2	22,9	22,5	23,2	23,6
	12H	22,2	22,9	22,6	23,2	23,7	22,2	22,9	22,6	23,2	23,7
4H	2H	21,5	22,4	21,9	22,6	22,9	21,5	22,4	21,9	22,6	22,9
	3H	22,1	22,7	22,4	23,1	23,5	22,1	22,7	22,4	23,1	23,5
	4H	22,3	22,9	22,7	23,3	23,8	22,3	22,9	22,7	23,3	23,8
	6H	22,5	23,1	23,0	23,5	23,8	22,5	23,1	23,0	23,5	23,8
	8H	22,6	23,1	23,1	23,5	23,9	22,6	23,1	23,1	23,5	23,9
	12H	22,6	23,1	23,1	23,5	24,0	22,6	23,1	23,1	23,5	24,0
8H	4H	22,3	22,9	22,8	23,3	23,6	22,3	22,9	22,8	23,3	23,6
	6H	22,7	23,1	23,2	23,5	24,1	22,7	23,1	23,2	23,5	24,1
	8H	22,8	23,2	23,4	23,7	24,3	22,8	23,2	23,4	23,7	24,3
	12H	22,9	23,2	23,5	23,7	24,3	22,9	23,2	23,5	23,7	24,3
12H	4H	22,3	22,8	22,8	23,2	23,7	22,3	22,8	22,8	23,2	23,7
	6H	22,7	23,0	23,2	23,6	24,2	22,7	23,0	23,2	23,6	24,2
	8H	22,9	23,1	23,5	23,7	24,3	22,9	23,1	23,5	23,7	24,3

### Variations with the observer position for the luminaire spacings, S:

S = 1.0H	1,4 / -1,2	1,4 / -1,2
S = 1.5H	3,0 / -1,8	3,0 / -1,8
S = 2.0H	4,5 / -2,2	4,5 / -2,2

## Coefficients of Utilization

Ceiling reflectance	80			70			50			30			10			0		
Wall reflectance	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
Floor reflectance	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	0
RCR	(RCR: Room Cavity Ratio)																	
	Room Values are expressed as percentage of Lumen delivered to the task surface																	
0	119	119	119	119	116	116	116	116	111	111	106	106	106	101	101	101	99	
1	112	109	106	104	110	107	104	102	103	100	99	99	97	95	95	94	93	91
2	106	100	96	92	103	98	94	91	95	91	88	92	89	86	89	87	85	83
3	100	92	87	82	98	91	86	82	88	84	80	86	82	79	83	80	78	76
4	94	86	79	75	92	84	79	74	82	77	73	80	76	72	78	74	71	70
5	89	80	73	68	87	79	73	68	77	71	67	75	70	67	73	69	66	64
6	84	74	68	63	83	74	67	63	72	66	62	70	66	62	69	65	61	60
7	80	70	63	59	78	69	63	58	68	62	58	66	61	58	65	61	57	56
8	76	65	59	55	74	65	59	54	64	58	54	63	58	54	62	57	54	52
9	72	62	55	51	71	61	55	51	60	55	51	59	54	51	58	54	50	49
10	69	58	52	48	68	58	52	48	57	52	48	56	51	48	55	51	47	46

# Light Measurement Report

Print date: 28-11-2024

Measurement date and time: 28-11-2024 10:12:31 – Measurement no. VFR-241128-2236-MS

Measurement tracking No. and Link: [VT241128-007267](https://www.viso-systems.com/VT241128-007267)


Operator:



## Luminaire budgetary diagram

Uncorrected, comprehensive UGR table according to 117-1995

LAMPS (number of lamps)

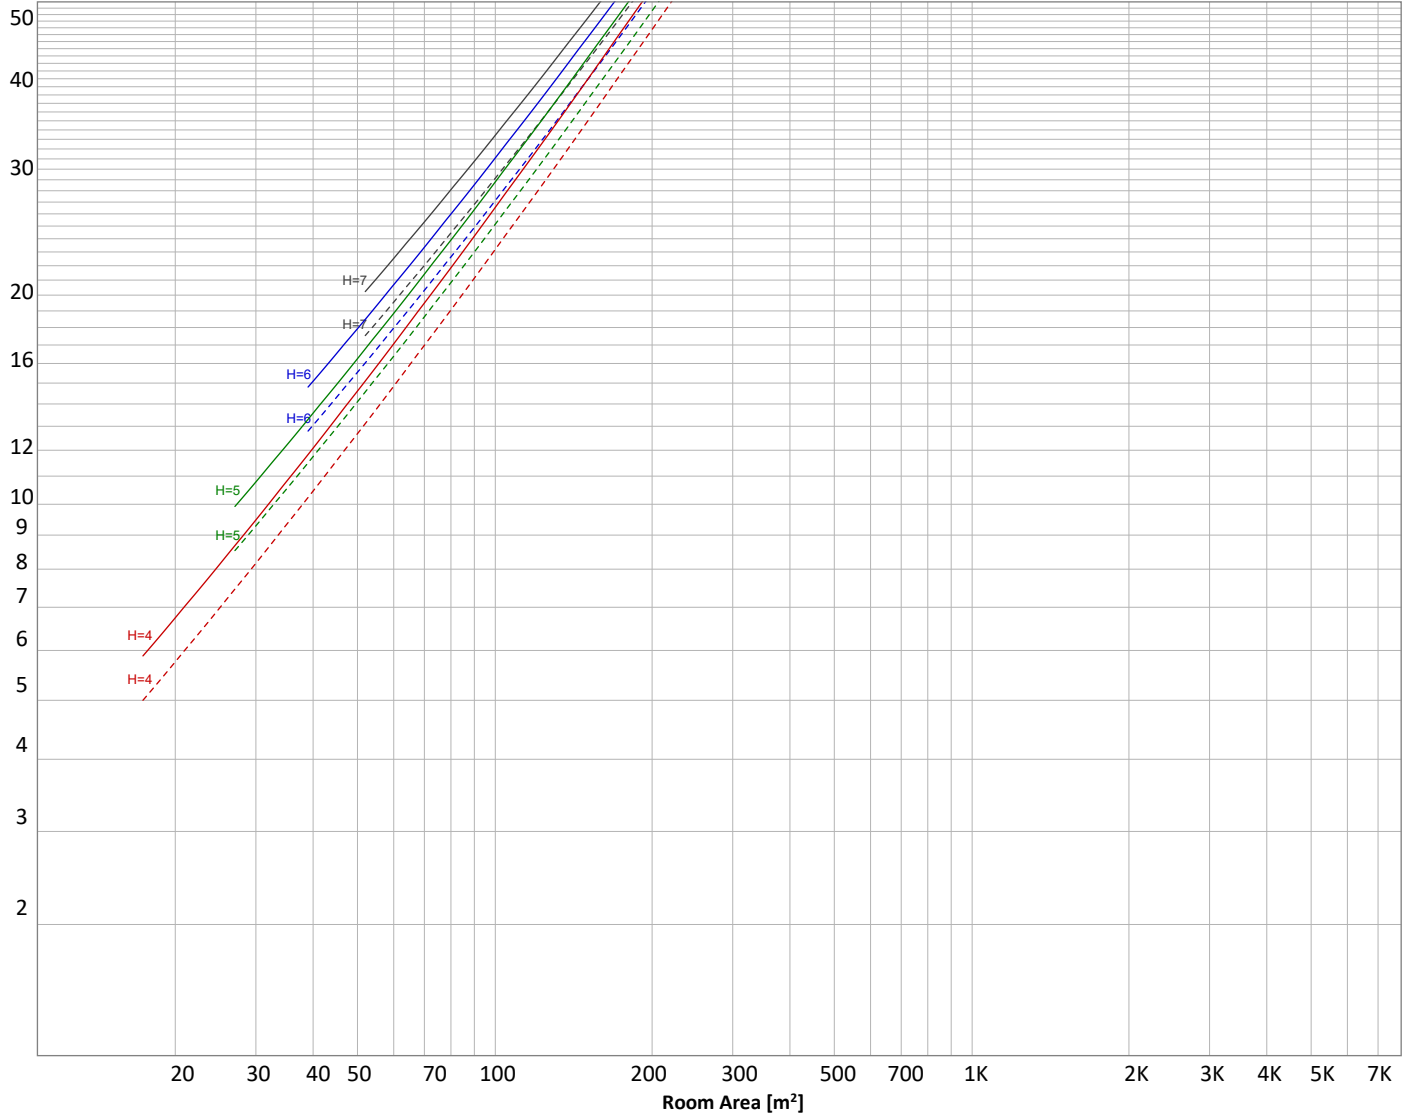

### Conditions

H = Room height	Flux = 492 lm	$\rho(\%)$			
H <sub>down</sub> = Lamp distance from ceiling =	0.00 m	Line type	Ceiling reflectance	Wall reflectance	Floor reflectance
H <sub>work</sub> = Work area height from floor =	0.00 m	-----	70	50	30
E <sub>work</sub> = Average lux on work area =	100 lx	_____	50	30	20

### Zonal Lumen Summary

0°-10°	10°-20°	20°-30°	30°-40°	40°-50°	50°-60°	60°-70°	70°-80°	80°-90°
52,4 lm	126 lm	128 lm	87,7 lm	46,6 lm	22,8 lm	13,8 lm	8,31 lm	3,64 lm
90°-100°	100°-110°	110°-120°	120°-130°	130°-140°	140°-150°	150°-160°	160°-170°	170°-180°
1,43 lm	0,662 lm	0,318 lm	0,146 lm	0,095 lm	0,100 lm	0,110 lm	0,076 lm	0,021 lm

# Light Measurement Report

Print date: 28-11-2024

Measurement date and time: 28-11-2024 10:12:31 – Measurement no. VFR-241128-2236-MS

Measurement tracking No. and Link: [VT241128-007267](#)

Operator:



## Outdoor Light Planning

### Lumen per Zone

Zone (γ)	Lumen	% Total
0-10°	{LUM00-10} lm	#VALUE!
10-20°	{LUM10-20} lm	#VALUE!
20-30°	{LUM20-30} lm	#VALUE!
30-40°	{LUM30-40} lm	#VALUE!
40-50°	{LUM40-50} lm	#VALUE!
50-60°	{LUM50-60} lm	#VALUE!
60-70°	{LUM60-70} lm	#VALUE!
70-80°	{LUM70-80} lm	#VALUE!
80-90°	{LUM80-90} lm	#VALUE!
90-100°	{LUM90-100} lm	#VALUE!
100-110°	{LUM100-110} lm	#VALUE!
110-120°	{LUM110-120} lm	#VALUE!
120-130°	{LUM120-130} lm	#VALUE!
130-140°	{LUM130-140} lm	#VALUE!
140-150°	{LUM140-150} lm	#VALUE!
150-160°	{LUM150-160} lm	#VALUE!
160-170°	{LUM160-170} lm	#VALUE!
170-180°	{LUM170-180} lm	#VALUE!
Total	0 lm	#VALUE!

### Intensity peaks

Max intensity	{PEAK} cd
Intensity, 90°	{INT90} cd
Intensity, 0°	{INT0} cd

### Zonal Lumen summary


Zone (γ)	Lumen	% Total
0-30°	{LUM00-30} lm	#VALUE!
0-40°	{LUM00-40} lm	#VALUE!
0-60°	{LUM00-60} lm	#VALUE!
60-90°	{LUM60-90} lm	#VALUE!
70-100°	{LUM70-100} lm	#VALUE!
90-120°	{LUM90-120} lm	#VALUE!
0-90°	{LUM00-90} lm	#VALUE!
90-180°	{LUM90-180} lm	#VALUE!
0-180°	{LUM00-180} lm	#VALUE!

### BUG rating

	Lumen	% Total
<b>Forward light</b>		
Low(0-30°)	{BUG0} lm	#VALUE!
Medium(30-60°)	{BUG1} lm	#VALUE!
High(60-80°)	{BUG2} lm	#VALUE!
Very high(80-90°)	{BUG3} lm	#VALUE!
<b>Back light</b>		
Low(0-30°)	{BUG4} lm	#VALUE!
Medium(30-60°)	{BUG5} lm	#VALUE!
High(60-80°)	{BUG6} lm	#VALUE!
Very high(80-90°)	{BUG7} lm	#VALUE!
<b>Uplight</b>		
Low(90-100°)	{BUG8} lm	#VALUE!
High(100-180°)	{BUG9} lm	#VALUE!

## IESNA TM-15-07 Luminaire Classification System For Outdoor Luminaires

BUG rating B1 U1 G0

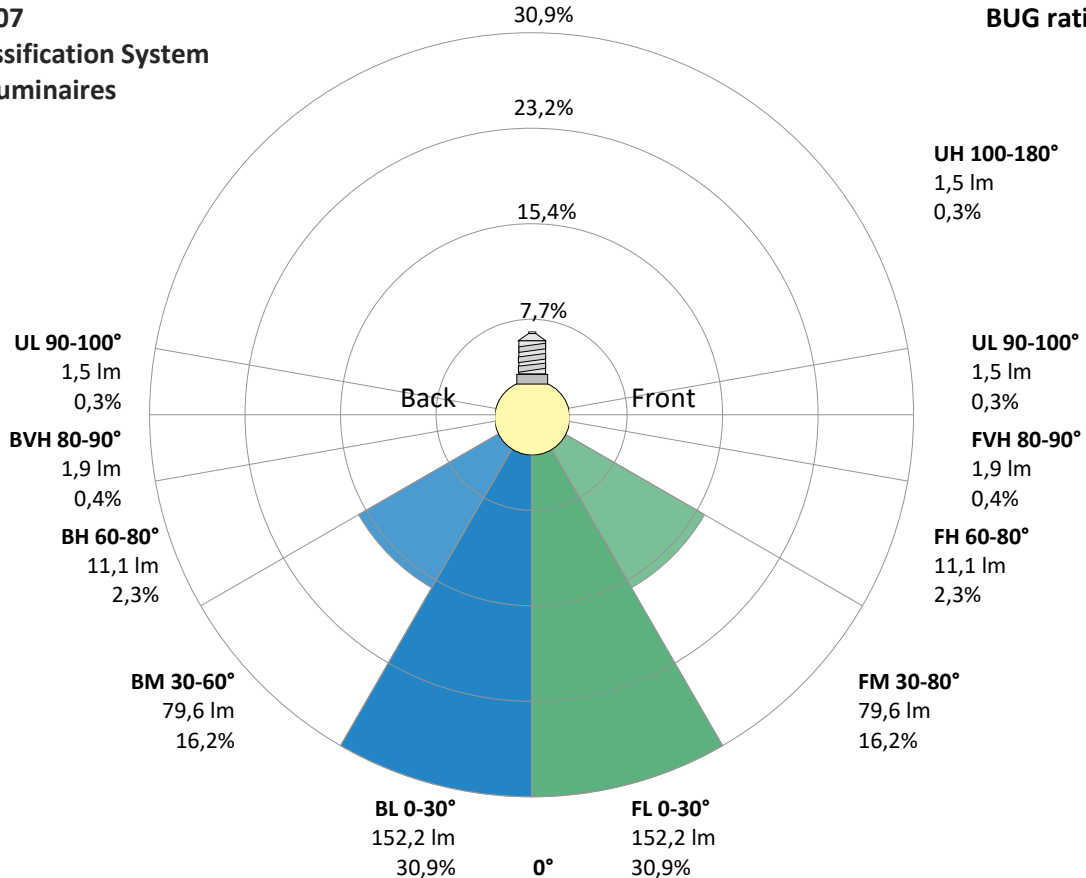

# Light Measurement Report

Print date: 28-11-2024

Measurement date and time: 28-11-2024 10:12:31 – Measurement no. VFR-241128-2236-MS

Measurement tracking No. and Link: [VT241128-007267](#)

Operator:




## Power Details

### Input Power

Power feed to light source	7,5 W
Frequency of input power	50 Hz
RMS Input voltage feed, $V_{RMS}$	230 V
RMS Input current feed, $I_{RMS}$	0,039 A
Volt-Ampere or apparent power = $V_{RMS} * I_{RMS}$	9,04 VA
Displacement factor of AC power feed	0,97
Power factor of AC current feed	0,83
Total harmonic distortion of the current	60,5%
Total harmonic distortion of the voltage	0,07%

### Input Power Curve

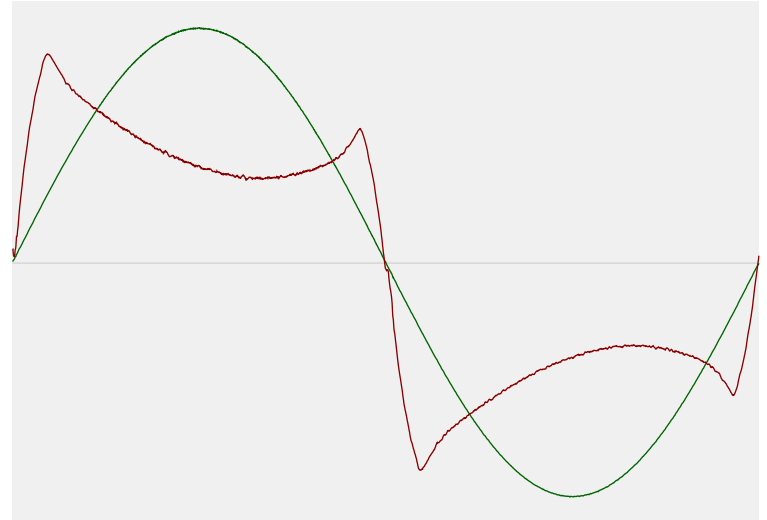

### Efficiency

Radiated power efficiency	23,2%
Lumen efficiency	65 lm/W

## Stabilization Details

### Warmup Conditions

Stable period	15 min
Stable change max	2,0%
Minimum time	15 min

### Color Temperature Change

CCT start	3994 K
CCT shift	+6 K
CCT end	4000 K


### Warmup Result

Total warmup time	Lamp stabilized in 16 min 50 sec
Warmup variation	-2,8%

### Output Change

Output start	506 lm
Output change	-14 lm
Output end	492 lm

### Stabilization Curve

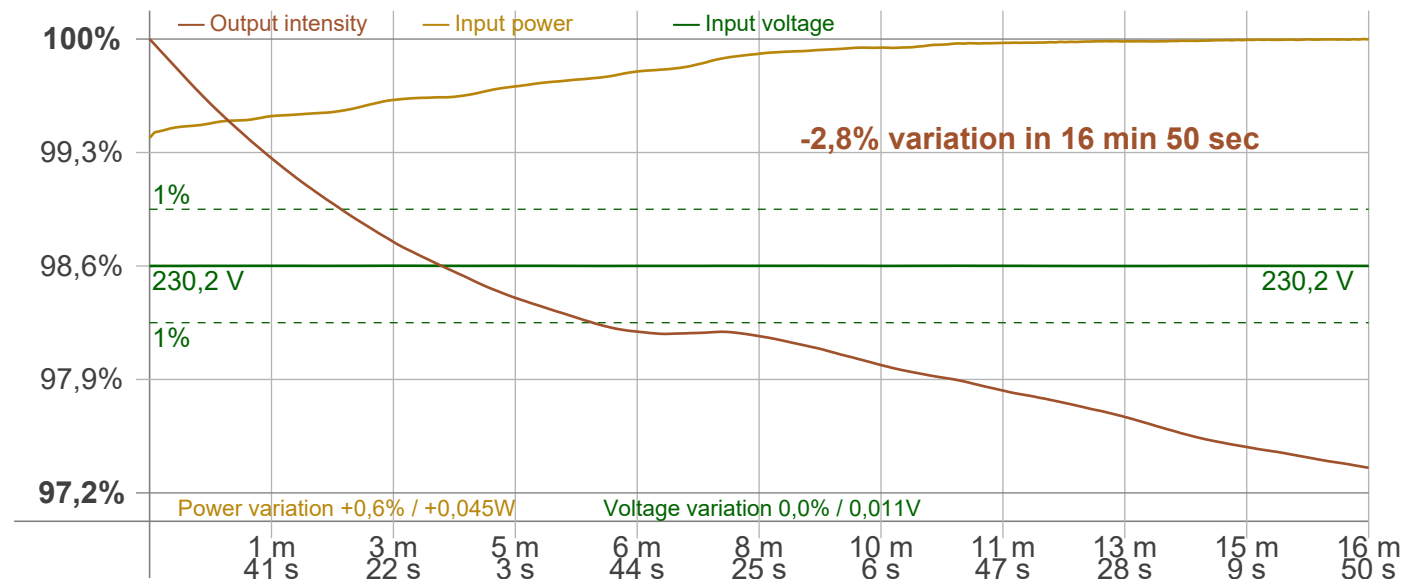

# Light Measurement Report

Print date: 28-11-2024

Measurement date and time: 28-11-2024 10:12:31 – Measurement no. VFR-241128-2236-MS

Measurement tracking No. and Link: [VT241128-007267](https://vfr.viso-systems.com/VT241128-007267)

Operator:



## Flicker /TLA details

Flicker Meter Type: Viso Systems LabFlicker  
 Frequency of input power: 50 Hz  
 Flicker/TLA sample rate: 20000 samples/s

**Measurement time**  
 PstLM: 180 sec  
 All other indices: 1,2 sec

### Flicker indices according to Illuminating Engineering Society (IES)

Flicker frequency: 99,5 Hz  
 Percent Flicker: 0,66 %  
 Flicker index: 0

### Flicker indices according to California Energy Commission (CEC) 2016b

JA8/10 40 Hz: 0,04 %  
 JA8/10 90 Hz: 0,04 %  
 JA8/10 200 Hz: 0,64 %  
 JA8/10 400 Hz: 0,66 %  
 JA8/10 1000 Hz: 0,66 %


### TLA indices (re IEC TR 61547-1, IEC 61000-3-3 and IEC 61000-4-15)

PstLM value (F < 80 Hz): 0,06  
 SVM value (80 < F < 2000 Hz): 0,02

### Flicker indices according to Lighting Research Center (2015)

Perception metric, Assist Mp: 0,03

### Flicker frame (frame of one flicker period in time domain)

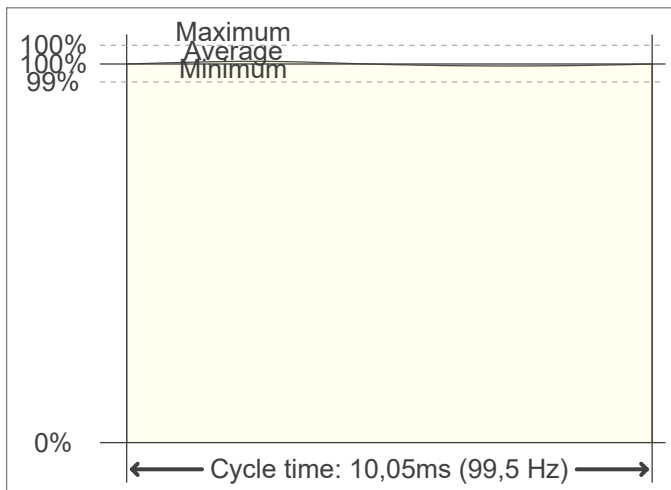

### Flicker FFT (flicker curve in frequency domain)



### IEEE 1789 Frequency/modulation plot

