

# Light Measurement Report

Print date: 20-1-2025

Measurement date and time: 20-1-2025 08:55:42 – Measurement no. VFR-250120-3029-MS

Measurement tracking No. and Link: [VT250120-003518](#)

Operator:



## Laboratory and Equipment

Laboratory Owner and Location  
Goniospectrometer System and Type  
Sensor Name, Calibr. Date and Serial No.  
Spectrometer Manufacturer and Model

Viso Systems, Copenhagen V, Denmark  
LabSpion – Type C, horizontal  
LabSensor Model2 – 11-1-2024 – 3130191315  
Ibsen Photonics, Denmark – Freedom VIS (Custom Viso)

## Measurement Conditions

Number of C-planes and Resolution  
 $\gamma$  (gamma)-Resolution  
Test Distance  
Input Power, Power and Displ. Factors  
Input RMS Voltage and Current  
Frequency of Input Power  
Warm-up Time and Variation

12 planes – 30°  
5°  
3,24 m  
102,5 W – PF 0,99 – DPF 0,99  
230 V – 0,450 A  
50 Hz  
Lamp stabilized in 15 min 2 sec – 2,0%

## Tested Light Source



Product Name  
Item No. and Manufacturer  
Product Description (line 1)

802653-4000K  
802653-4000K – Dutchfulfillment  
LED HIGHBAY | KALIK | 100W | PHILIPS DRIVER | IP65 | 120°

## Main Light Measurement Results

Output – Total Lumen (Up% / Down%)  
Efficiency  
Peak Intensity and Beam Angle  
Correlated Color Temperature, Target/Measured  
Color Rendering Index  
Color Rendering TM30-18  
Color Shift, CIE duv and MacAdam Steps  
Flicker

14371 lm – 0,13% / 99,87%  
140 lm/W  
5060 cd – 114,6°  
CCT = 4000 K / 4048 K  
CRI 81,0  
 $R_f$  83,4 –  $R_g$  92,9  
Duv 0,0041 – SDCM 3,3  
SVM 0,01 – PstLM 0,05

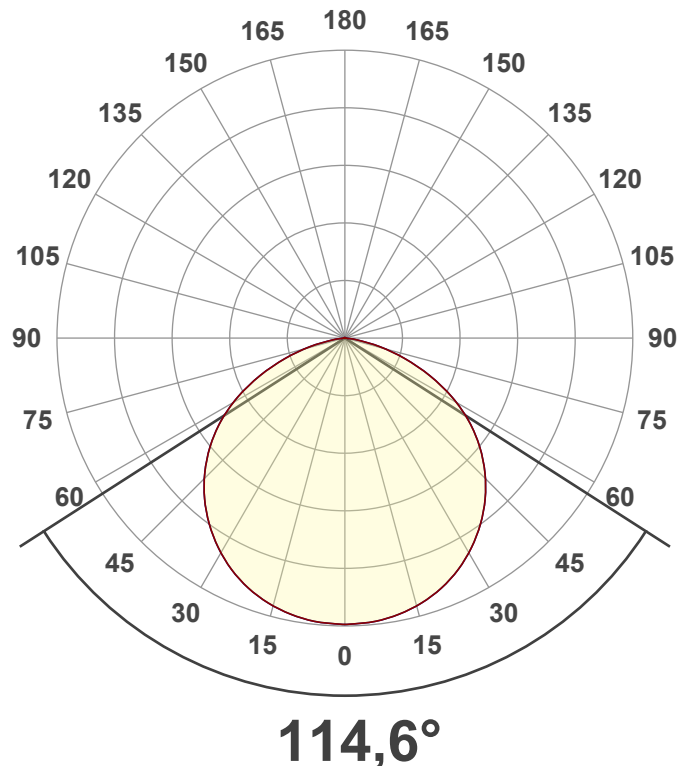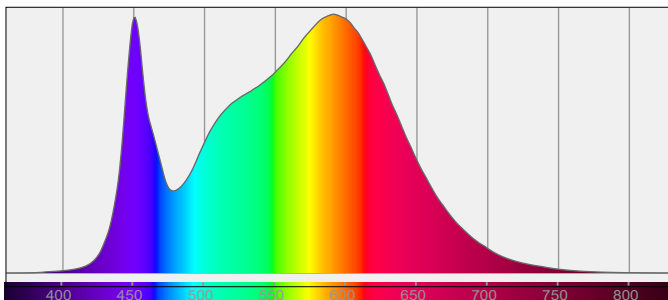

# Light Measurement Report

Print date: 20-1-2025

Measurement date and time: 20-1-2025 08:55:42 – Measurement no. VFR-250120-3029-MS


Measurement tracking No. and Link: [VT250120-003518](#)

Operator:



## Luminous Intensity diagram

Unit: 0-100% of peak intensity

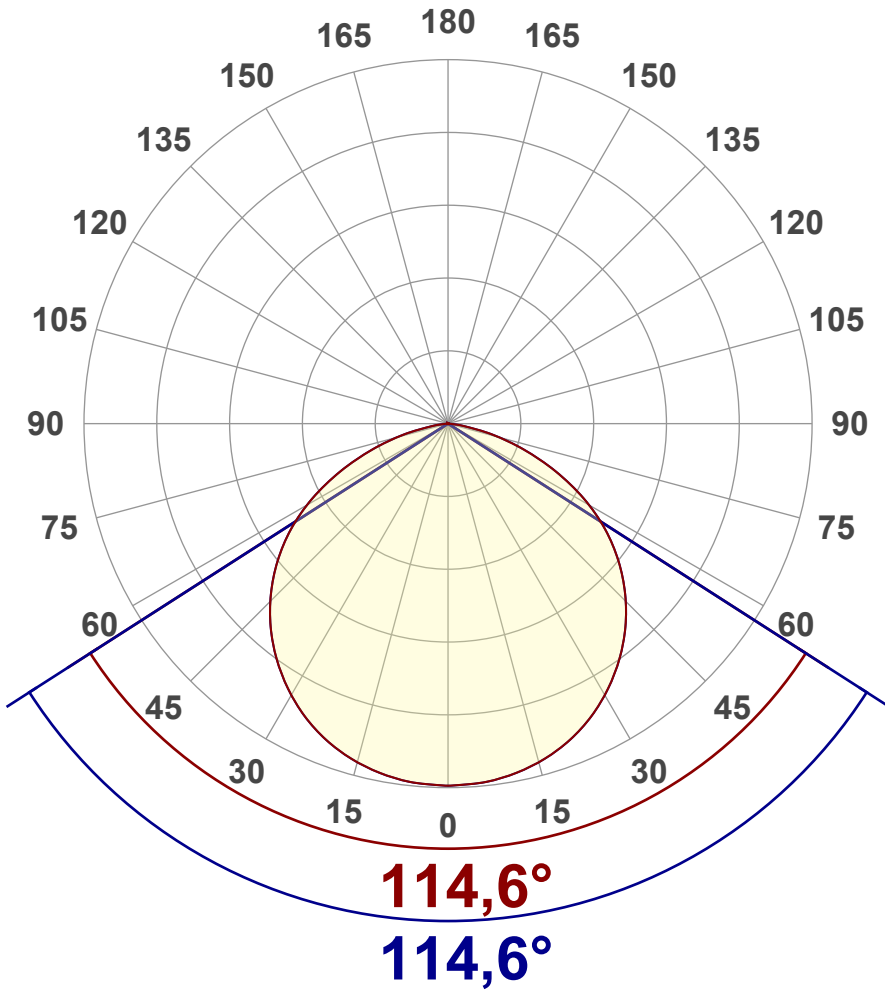

## Main Values

Output (total Lumen)	14371 lm
Lumen Up% / Down%	0,13% / 99,87%
Peak Intensity	5060 cd
Beam Angle (50%)	114,6°
Beam Angle (90%)	114,6°
Beam Angle (10%)	114,6°

## Cut-off Angle

Average 2,5%	167,4°
--------------	--------

## Field Angle

Average 10%	155,5°
-------------	--------


## Intensity Ratio

In 120° cone	81,5%
In 90° cone	55,1%

**C000-C180**

**C090-C270**

## Linear distribution diagram - Intensity (candela) vs $\gamma$ -angle

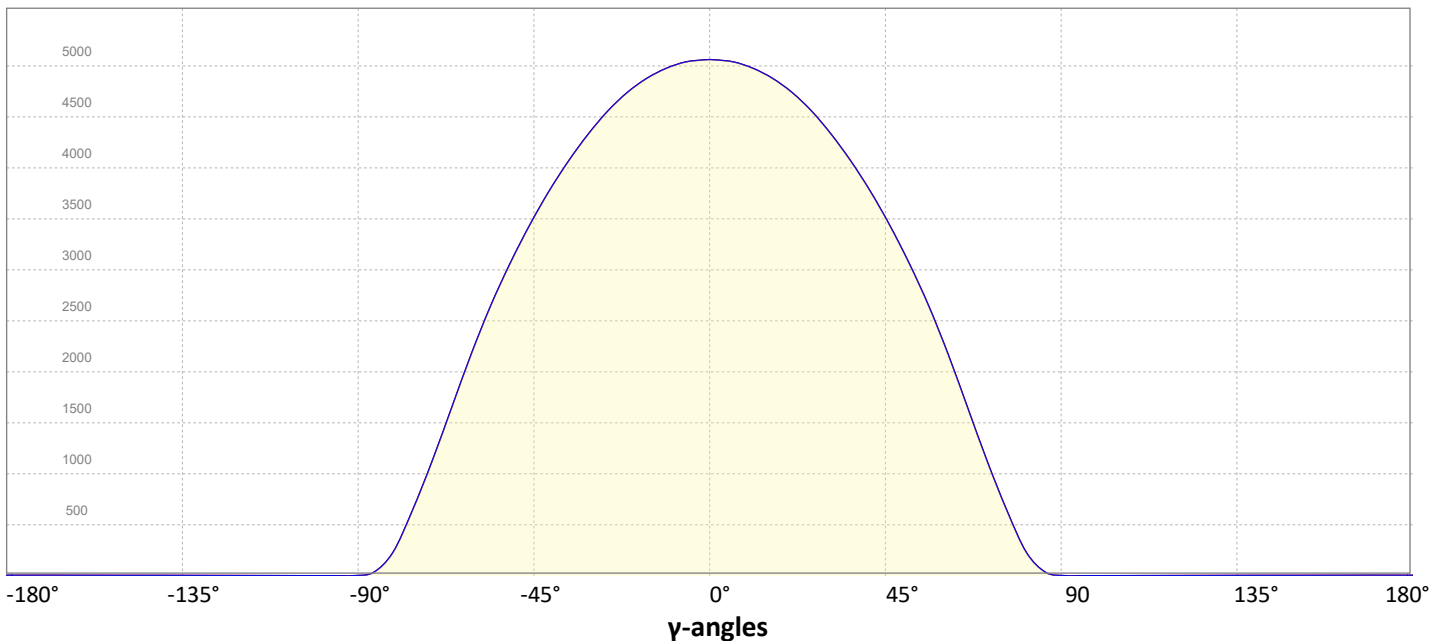

# Light Measurement Report

Print date: 20-1-2025


Measurement date and time: 20-1-2025 08:55:42 – Measurement no. VFR-250120-3029-MS

Measurement tracking No. and Link: [VT250120-003518](#)

Operator:




## Iso-intensity Diagram (Iso-candela)

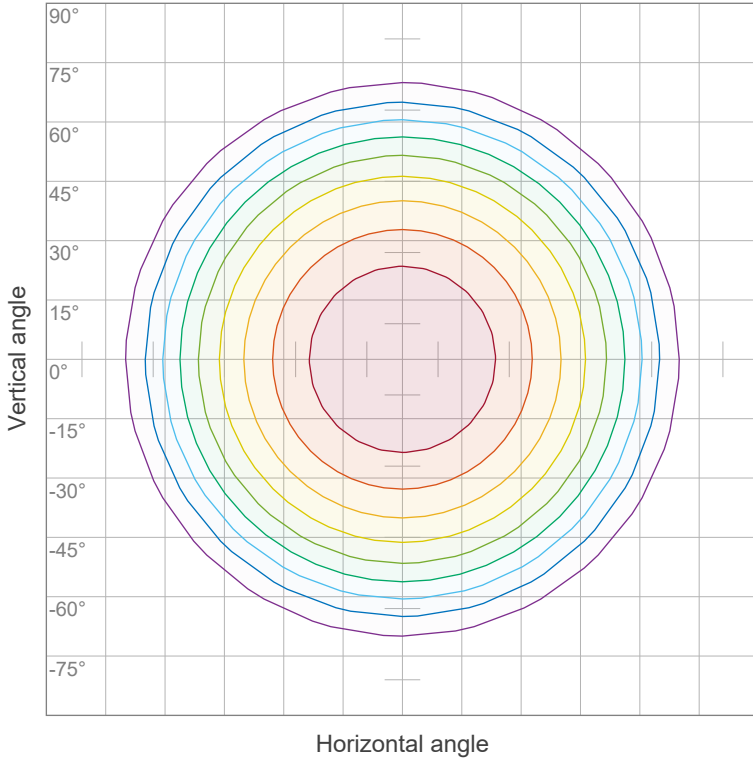

90 %	4553,9 cd
80 %	4047,9 cd
70 %	3541,9 cd
60 %	3035,9 cd
50 %	2529,9 cd
40 %	2024,0 cd
30 %	1518,0 cd
20 %	1012,0 cd
10 %	506,0 cd

Peak intensity: 5059,9 cd  
Number of c-planes: 12

## Iso-illuminance Diagram (Iso-lux)

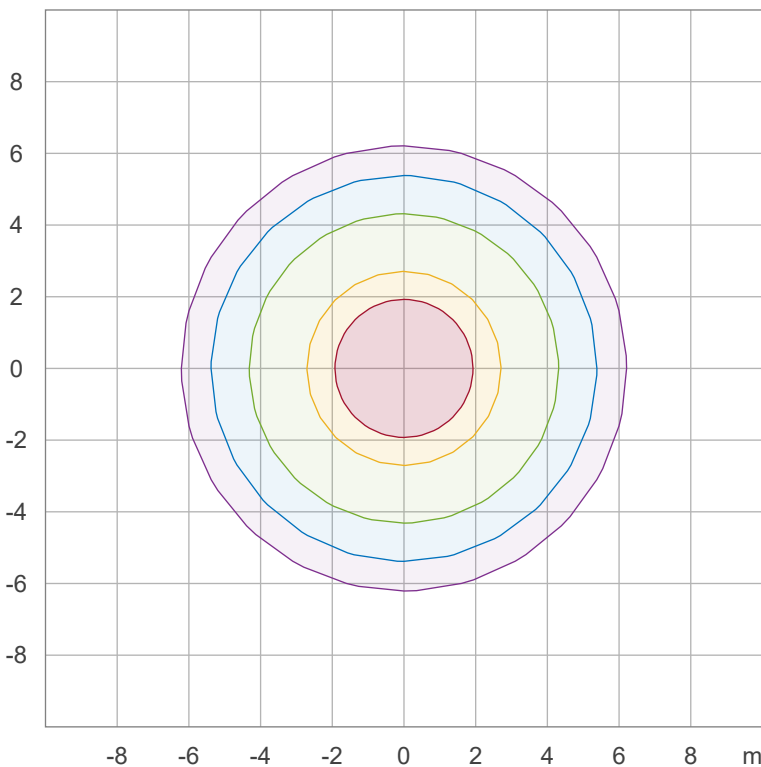

50,0 %	281,1 lx
30,0 %	168,7 lx
10,0 %	56,2 lx
5,0 %	28,1 lx
3,0 %	16,9 lx

Peak illuminance: 562,2 lx  
Mounting height: 3,0 m  
Number of c-planes: 12

# Light Measurement Report

Print date: 20-1-2025

Measurement date and time: 20-1-2025 08:55:42 – Measurement no. VFR-250120-3029-MS

Measurement tracking No. and Link: [VT250120-003518](#)

Operator:




## Color details


Correlated Color Temperature, Target CCT = 4000 K  
 Correlated Color Temperature, Measured CCT = 4048 K  
 Color Rendering Index CRI 81,0  
 Color Rendering Index, R9 (red component) R9 = -8,2  
 Color Rendering TM30-18 R<sub>f</sub> 83,4 – R<sub>g</sub> 92,9  
 Color Quality Scale CQS = 81,2

MacAdam Steps SDCM = 3,3  
 Color coordinates CIE 1931 (x;y) = (0,381;0,377)  
 Color coordinate CIEs 1960 (u;v) = (0,225;0,334)  
 Color deviation from BBL Duv = 0,0041  
 Color coordinate CIEs 1976 (CIELUV) (u';v') = (0,225;0,502)


### CIE 1931

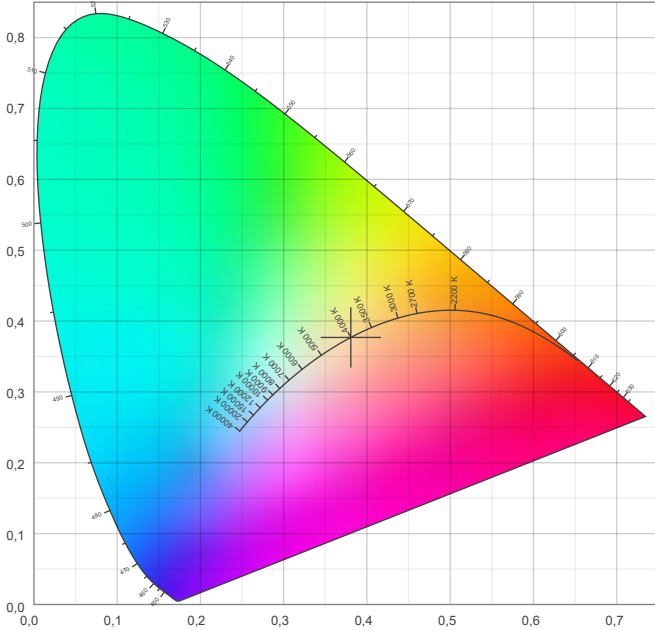

### CIE 1931 – zoomed on Planckian locus

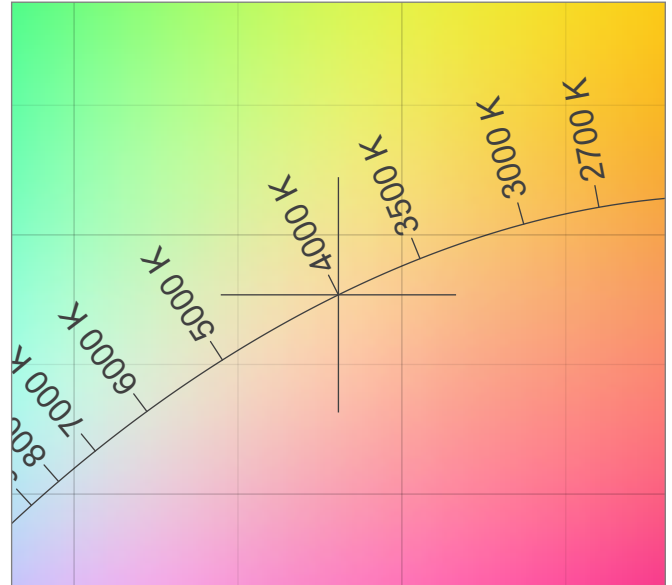


### Color Rendering Index per reference color (CIE 1995)

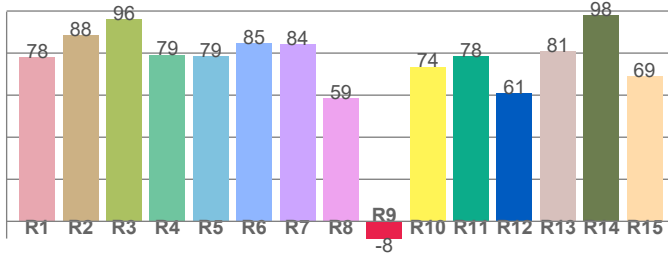


CRI R values, only R1-R8 are used to calculate final CRI value

R1	R2	R3	R4	R5	R6	R7	R8	R9	R10	R11	R12	R13	R14	R15
78,1	88,4	96,1	79,2	78,6	84,7	84,3	58,5	-8,2	73,5	78,3	60,7	80,8	98,1	69,0

### Spectral power distribution (SPD) / W/nm – 0-100%

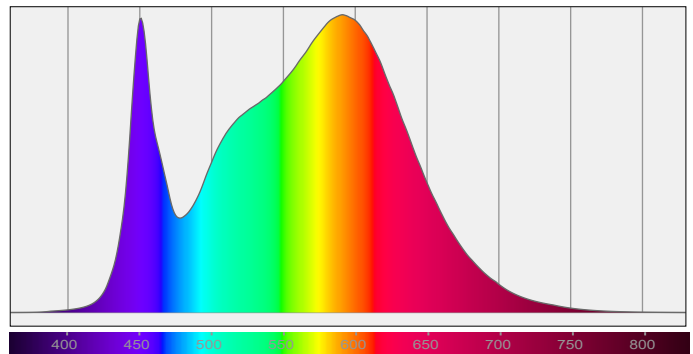


### TM30-18 Rf-values per hue bin

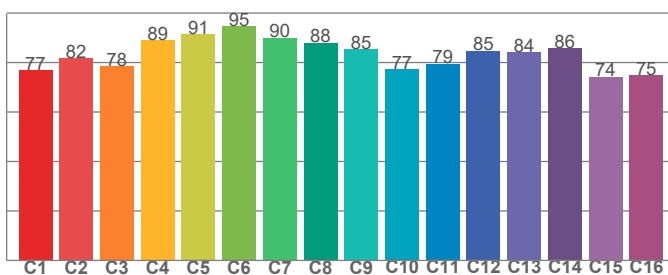

TM30 C values, 16 binned values out of total of 99 C values

C1	C2	C3	C4	C5	C6	C7	C8	C9	C10	C11	C12	C13	C14	C15	C16
76,9	81,7	78,4	89,1	91,5	94,8	90,0	87,9	85,3	77,4	79,4	84,8	84,1	85,6	74,3	74,8

### Color Quality Scale by reference color

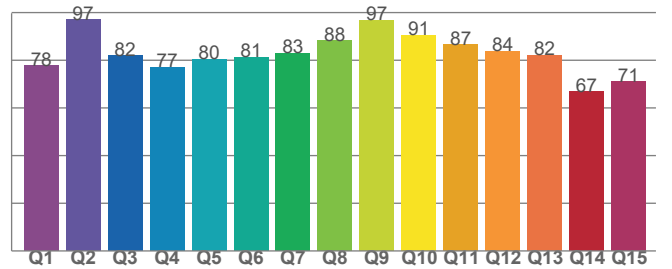

CQS Q values

Q1	Q2	Q3	Q4	Q5	Q6	Q7	Q8	Q9	Q10	Q11	Q12	Q13	Q14	Q15
77,7	97,0	81,9	77,2	80,4	81,4	83,0	88,2	96,7	90,6	86,6	83,9	82,0	66,8	71,0

# Light Measurement Report

Print date: 20-1-2025


Measurement date and time: 20-1-2025 08:55:42 – Measurement no. VFR-250120-3029-MS

Measurement tracking No. and Link: [VT250120-003518](https://www.viso-systems.com/VT250120-003518)

Operator:



## Beam Details

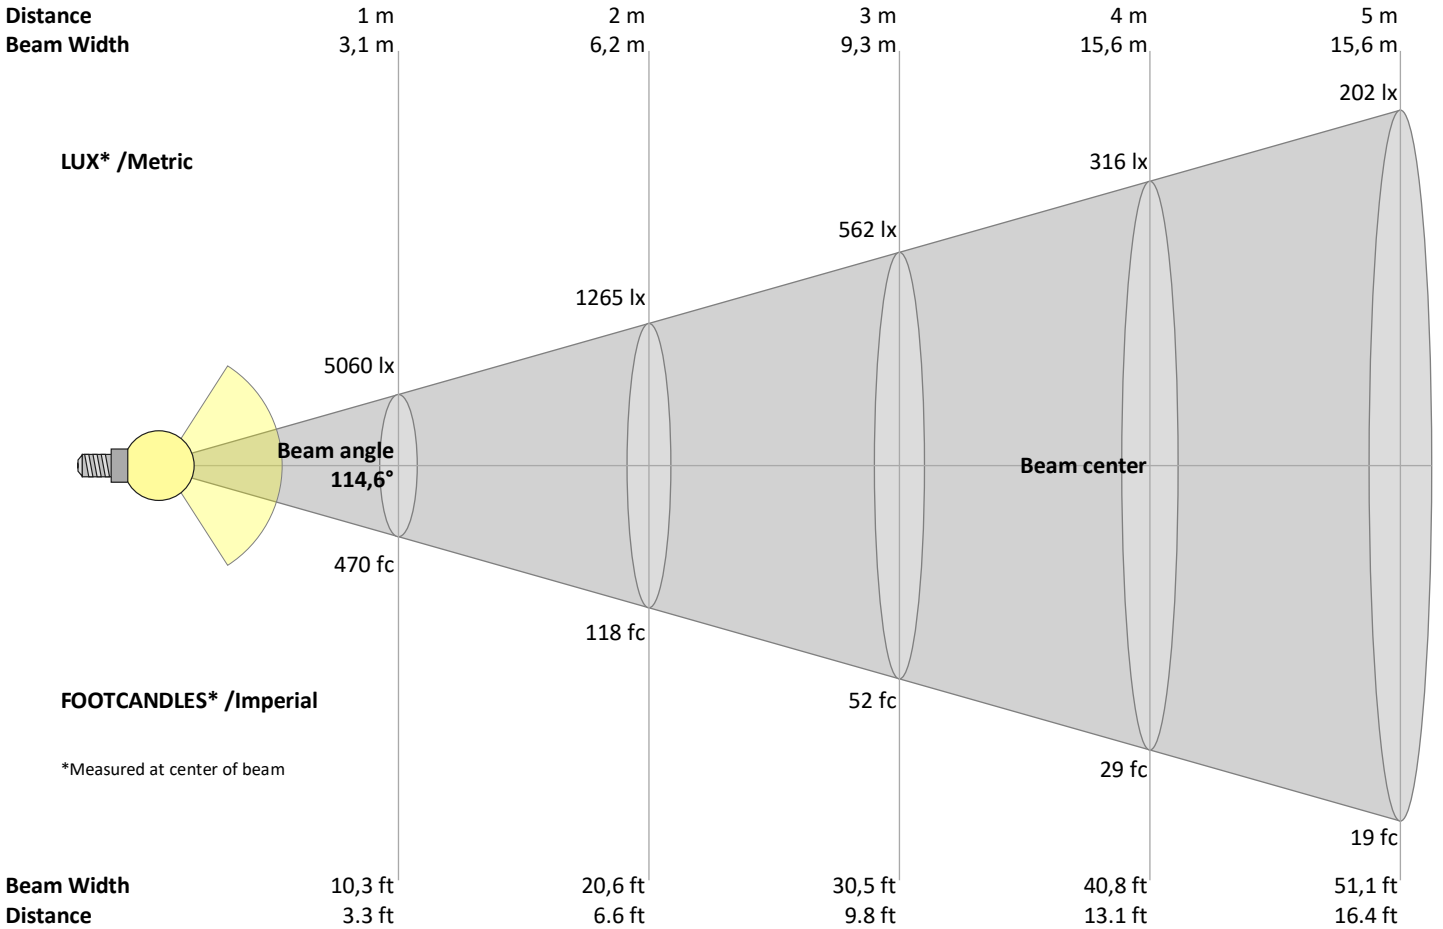

### Beam intensities from 1 – 20 m

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	m
3,3	6,6	9,8	13,1	16,4	19,7	23	26,2	29,5	32,8	36,1	39,4	42,7	45,9	49,2	52,5	55,8	59,1	62,3	65,6	ft
5060	1265	562	316	202	141	103	79	62	51	42	35	30	26	22	20	18	16	14	13	lux
470,1	117,5	52,2	29,4	18,8	13,1	9,6	7,3	5,8	4,7	3,9	3,3	2,8	2,4	2,1	1,8	1,6	1,5	1,3	1,2	fc

### Intensities in 0° c-plane

0°	5°	10°	15°	20°	25°	30°	35°	40°	45°	50°	55°	60°	65°	70°	75°	80°	85°	90°	95°	γ
5060	5044	4990	4900	4770	4597	4380	4127	3838	3511	3146	2737	2273	1759	1235	746	319	75	8	1	cd
100%	100%	99%	97%	94%	91%	87%	82%	76%	69%	62%	54%	45%	35%	24%	15%	6%	1%	0%	0%	of 0°val

### Intensities in 90° c-plane

0°	5°	10°	15°	20°	25°	30°	35°	40°	45°	50°	55°	60°	65°	70°	75°	80°	85°	90°	95°	γ
5060	5044	4990	4900	4770	4597	4380	4127	3838	3511	3146	2737	2273	1759	1235	746	319	75	8	1	cd
100%	100%	99%	97%	94%	91%	87%	82%	76%	69%	62%	54%	45%	35%	24%	15%	6%	1%	0%	0%	of 0°val

### Intensities in 180° c-plane

0°	5°	10°	15°	20°	25°	30°	35°	40°	45°	50°	55°	60°	65°	70°	75°	80°	85°	90°	95°	γ
5060	5044	4990	4900	4770	4597	4380	4127	3838	3511	3146	2737	2273	1759	1235	746	319	75	8	1	cd
100%	100%	99%	97%	94%	91%	87%	82%	76%	69%	62%	54%	45%	35%	24%	15%	6%	1%	0%	0%	of 0°val

### Intensities in 270° c-plane

0°	5°	10°	15°	20°	25°	30°	35°	40°	45°	50°	55°	60°	65°	70°	75°	80°	85°	90°	95°	γ
5060	5044	4990	4900	4770	4597	4380	4127	3838	3511	3146	2737	2273	1759	1235	746	319	75	8	1	cd
100%	100%	99%	97%	94%	91%	87%	82%	76%	69%	62%	54%	45%	35%	24%	15%	6%	1%	0%	0%	of 0°val

# Light Measurement Report

Print date: 20-1-2025

Measurement date and time: 20-1-2025 08:55:42 – Measurement no. VFR-250120-3029-MS

Measurement tracking No. and Link: [VT250120-003518](#)

Operator:



## Light Planning – UGR table

Uncorrected, comprehensive UGR table according to 117-1995

Reflectances		70	70	50	50	30	70	70	50	50	30
	ρ Ceiling	70	70	50	50	30	70	70	50	50	30
	ρ Walls	50	30	50	30	30	50	30	50	30	30
	ρ Floor	20	20	20	20	20	20	20	20	20	20
Room size		Viewed Crosswise					Viewed Endwise				
H = mounting height above eye level		(Viewing direction orthogonal to lamp length axis)					(Viewing direction parallel to lamp length axis)				
X	Y										
2H	2H	32,4	33,6	32,7	34,0	34,2	32,4	33,6	32,7	34,0	34,2
	3H	33,5	34,8	34,0	35,1	35,3	33,5	34,8	34,0	35,1	35,3
	4H	33,9	35,1	34,3	35,4	35,6	33,9	35,1	34,3	35,4	35,6
	6H	34,1	35,1	34,4	35,4	35,8	34,1	35,1	34,4	35,4	35,8
	8H	34,1	35,1	34,4	35,4	35,8	34,1	35,1	34,4	35,4	35,8
	12H	34,1	35,0	34,4	35,4	35,8	34,1	35,0	34,4	35,4	35,8
4H	2H	33,0	34,1	33,4	34,4	34,7	33,0	34,1	33,4	34,4	34,7
	3H	34,3	35,3	34,7	35,7	36,1	34,3	35,3	34,7	35,7	36,1
	4H	34,7	35,6	35,1	36,0	36,6	34,7	35,6	35,1	36,0	36,6
	6H	34,9	35,7	35,4	36,1	36,5	34,9	35,7	35,4	36,1	36,5
	8H	34,9	35,7	35,4	36,1	36,4	34,9	35,7	35,4	36,1	36,4
	12H	34,9	35,5	35,4	36,0	36,4	34,9	35,5	35,4	36,0	36,4
8H	4H	34,8	35,6	35,3	36,0	36,4	34,8	35,6	35,3	36,0	36,4
	6H	35,1	35,7	35,6	36,2	36,7	35,1	35,7	35,6	36,2	36,7
	8H	35,2	35,7	35,7	36,2	36,8	35,2	35,7	35,7	36,2	36,8
	12H	35,2	35,6	35,8	36,1	36,7	35,2	35,6	35,8	36,1	36,7
12H	4H	34,8	35,5	35,3	35,9	36,4	34,8	35,5	35,3	35,9	36,4
	6H	35,1	35,6	35,6	36,2	36,8	35,1	35,6	35,6	36,2	36,8
	8H	35,2	35,6	35,8	36,1	36,7	35,2	35,6	35,8	36,1	36,7

### Variations with the observer position for the luminaire spacings, S:

S = 1.0H	0,1 / -0,2	0,1 / -0,2
S = 1.5H	0,3 / -0,5	0,3 / -0,5
S = 2.0H	0,8 / -1,0	0,8 / -1,0

## Coefficients of Utilization

Ceiling reflectance	80	70	50	30	10	0
Wall reflectance	70 50 30	10 70 50	30 10 50	30 10 50	30 10 50	30 10 0
Floor reflectance	20 20 20	20 20 20	20 20 20	20 20 20	20 20 20	20 20 0
RCR	(RCR: Room Cavity Ratio)					
Room Values are expressed as percentage of Lumen delivered to the task surface						
0	119 119 119	119 116 116	116 116 111	111 111 106	106 106 102	102 102 100
1	109 105 101	97 107 103	99 96 98	95 92 94	92 90 91	89 87 85
2	100 92 85	79 97 90	84 79 86	81 77 83	79 75 80	76 73 71
3	91 81 73	66 88 79	72 66 76	70 64 73	68 63 71	66 62 60
4	83 71 63	56 81 70	62 56 67	60 55 65	59 54 63	58 53 51
5	76 64 55	48 74 63	54 48 60	53 47 58	52 47 57	51 46 44
6	71 57 48	42 69 56	48 42 55	47 41 53	46 41 51	45 41 39
7	65 52 43	37 64 51	43 37 50	42 37 48	41 36 47	41 36 34
8	61 47 39	33 59 47	39 33 45	38 33 44	37 32 43	37 32 30
9	57 43 35	30 55 43	35 30 42	34 29 41	34 29 40	33 29 27
10	53 40 32	27 52 39	32 27 38	31 27 38	31 27 37	31 26 25

# Light Measurement Report

Print date: 20-1-2025

Measurement date and time: 20-1-2025 08:55:42 – Measurement no. VFR-250120-3029-MS

Measurement tracking No. and Link: [VT250120-003518](#)


Operator:



## Luminaire budgetary diagram

Uncorrected, comprehensive UGR table according to 117-1995

LAMPS (number of lamps)

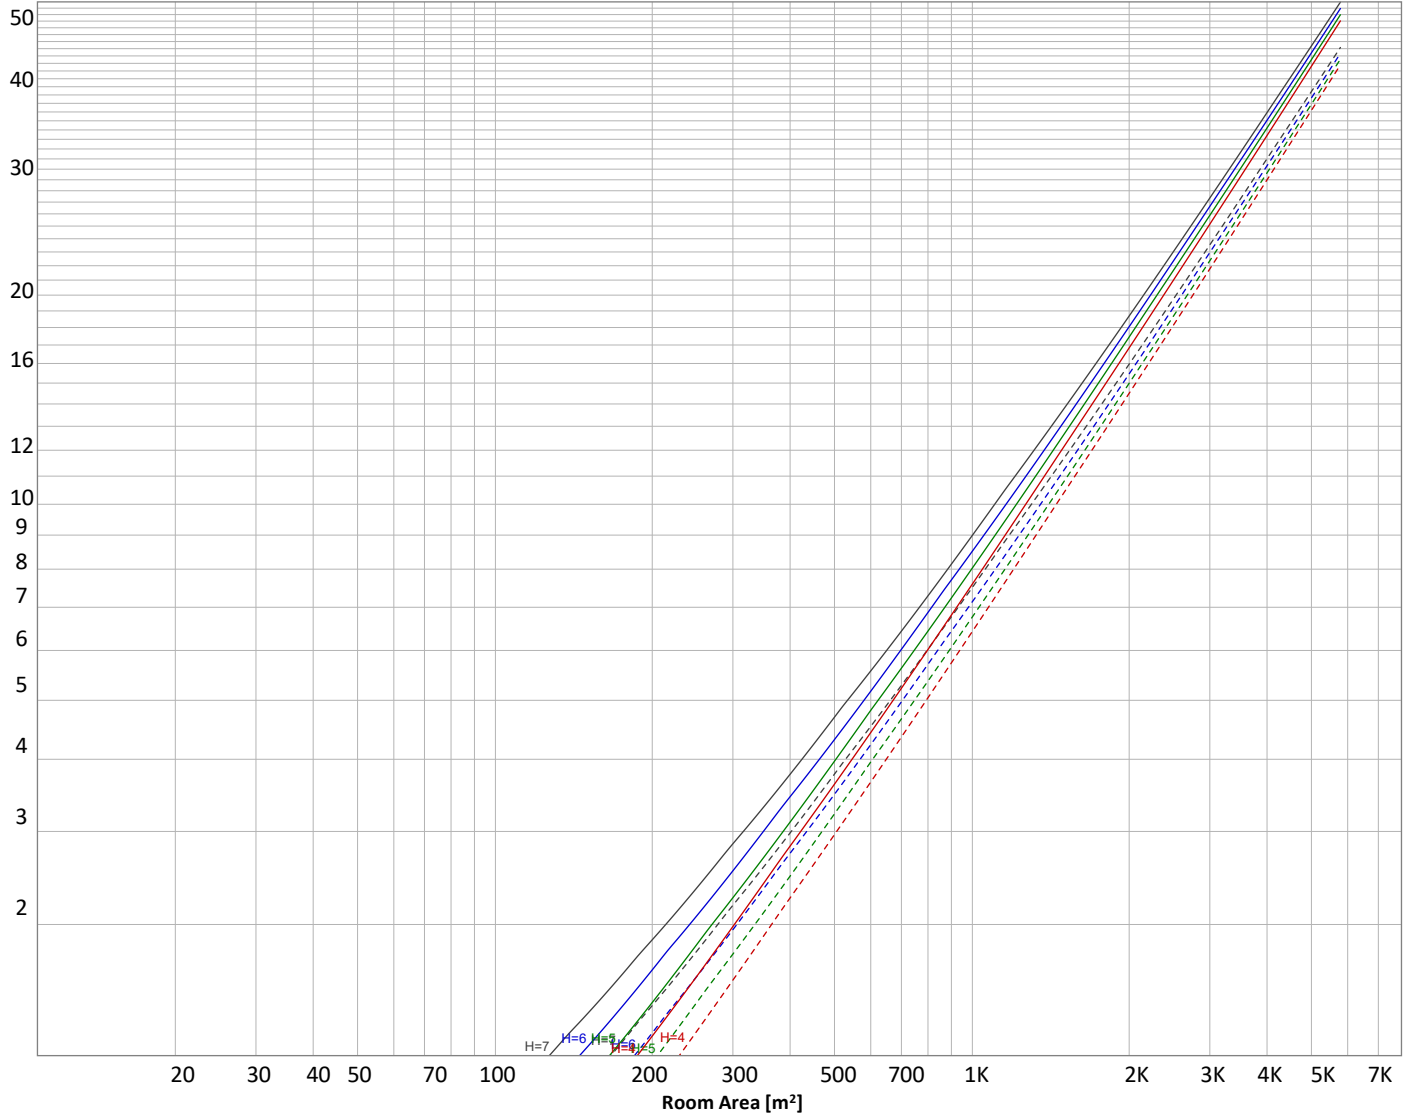

### Conditions

H = Room height	Flux = 14371 lm			
H <sub>down</sub> = Lamp distance from ceiling =	0.00 m	Line type	Ceiling reflectance	ρ(%) Wall reflectance
H <sub>work</sub> = Work area height from floor =	0.00 m	-----	70	50
E <sub>work</sub> = Average lux on work area =	100 lx	—————	50	30
				Floor reflectance
				20

### Zonal Lumen Summary

0°-10°	10°-20°	20°-30°	30°-40°	40°-50°	50°-60°	60°-70°	70°-80°	80°-90°
480 lm	1384 lm	2119 lm	2582 lm	2707 lm	2440 lm	1739 lm	795 lm	107 lm
90°-100°	100°-110°	110°-120°	120°-130°	130°-140°	140°-150°	150°-160°	160°-170°	170°-180°
1,23 lm	1,51 lm	2,31 lm	2,89 lm	3,18 lm	2,87 lm	2,27 lm	1,55 lm	0,549 lm

# Light Measurement Report

Print date: 20-1-2025

Measurement date and time: 20-1-2025 08:55:42 – Measurement no. VFR-250120-3029-MS

Measurement tracking No. and Link: [VT250120-003518](#)

Operator:



## Outdoor Light Planning

### Lumen per Zone

Zone (γ)	Lumen	% Total
0-10°	{LUM00-10} lm	#VALUE!
10-20°	{LUM10-20} lm	#VALUE!
20-30°	{LUM20-30} lm	#VALUE!
30-40°	{LUM30-40} lm	#VALUE!
40-50°	{LUM40-50} lm	#VALUE!
50-60°	{LUM50-60} lm	#VALUE!
60-70°	{LUM60-70} lm	#VALUE!
70-80°	{LUM70-80} lm	#VALUE!
80-90°	{LUM80-90} lm	#VALUE!
90-100°	{LUM90-100} lm	#VALUE!
100-110°	{LUM100-110} lm	#VALUE!
110-120°	{LUM110-120} lm	#VALUE!
120-130°	{LUM120-130} lm	#VALUE!
130-140°	{LUM130-140} lm	#VALUE!
140-150°	{LUM140-150} lm	#VALUE!
150-160°	{LUM150-160} lm	#VALUE!
160-170°	{LUM160-170} lm	#VALUE!
170-180°	{LUM170-180} lm	#VALUE!
<b>Total</b>	<b>0 lm</b>	<b>#VALUE!</b>

### Intensity peaks

Max intensity	{PEAK} cd
Intensity, 90°	{INT90} cd
Intensity, 0°	{INT0} cd

### Zonal Lumen summary


Zone (γ)	Lumen	% Total
0-30°	{LUM00-30} lm	#VALUE!
0-40°	{LUM00-40} lm	#VALUE!
0-60°	{LUM00-60} lm	#VALUE!
60-90°	{LUM60-90} lm	#VALUE!
70-100°	{LUM70-100} lm	#VALUE!
90-120°	{LUM90-120} lm	#VALUE!
0-90°	{LUM00-90} lm	#VALUE!
90-180°	{LUM90-180} lm	#VALUE!
0-180°	{LUM00-180} lm	#VALUE!

### BUG rating

	Lumen	% Total
<b>Forward light</b>		
Low(0-30°)	{BUG0} lm	#VALUE!
Medium(30-60°)	{BUG1} lm	#VALUE!
High(60-80°)	{BUG2} lm	#VALUE!
Very high(80-90°)	{BUG3} lm	#VALUE!
<b>Back light</b>		
Low(0-30°)	{BUG4} lm	#VALUE!
Medium(30-60°)	{BUG5} lm	#VALUE!
High(60-80°)	{BUG6} lm	#VALUE!
Very high(80-90°)	{BUG7} lm	#VALUE!
<b>Uplight</b>		
Low(90-100°)	{BUG8} lm	#VALUE!
High(100-180°)	{BUG9} lm	#VALUE!

## IESNA TM-15-07 Luminaire Classification System For Outdoor Luminaires

**BUG rating B3 U2 G1**

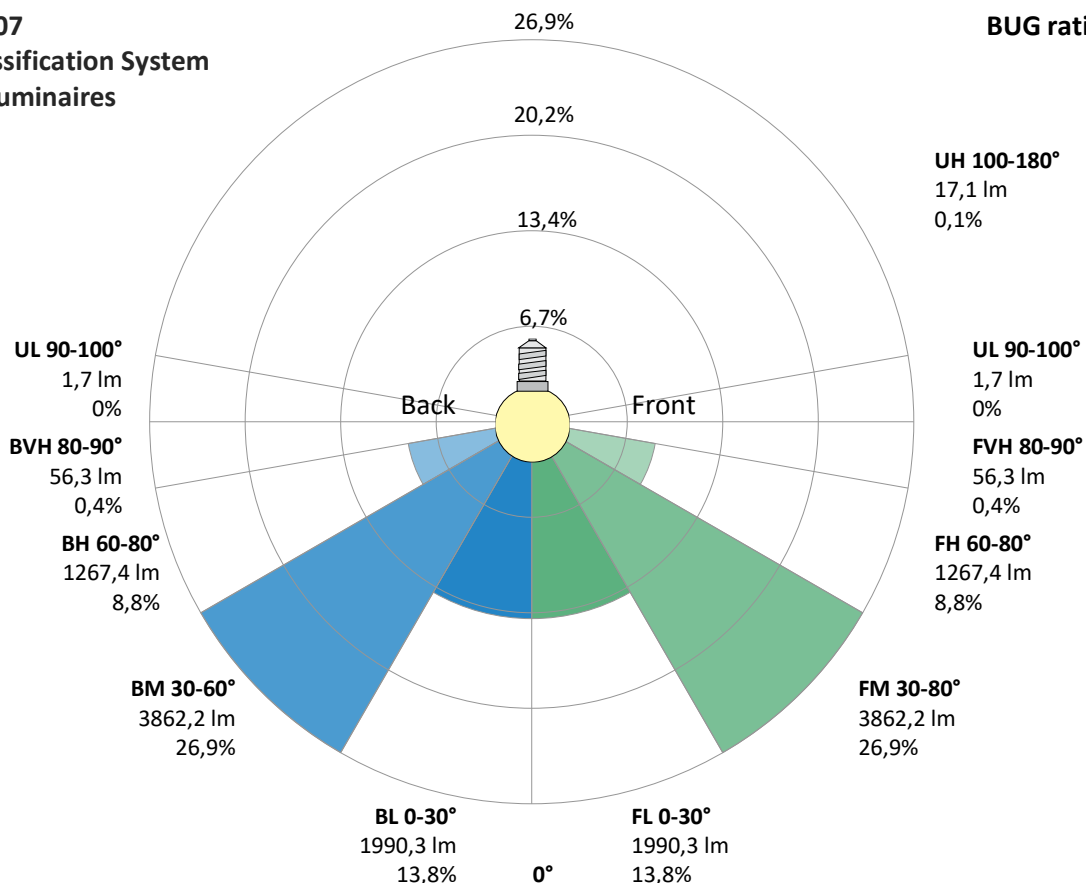

# Light Measurement Report

Print date: 20-1-2025

Measurement date and time: 20-1-2025 08:55:42 – Measurement no. VFR-250120-3029-MS

Measurement tracking No. and Link: [VT250120-003518](#)

Operator:




## Power Details


### Input Power

Power feed to light source	102,5 W
Frequency of input power	50 Hz
RMS Input voltage feed, $V_{RMS}$	230 V
RMS Input current feed, $I_{RMS}$	0,450 A
Volt-Ampere or apparent power = $V_{RMS} * I_{RMS}$	103,46 VA
Displacement factor of AC power feed	0,99
Power factor of AC current feed	0,99
Total harmonic distortion of the current	8,17%
Total harmonic distortion of the voltage	0,07%

### Input Power Curve

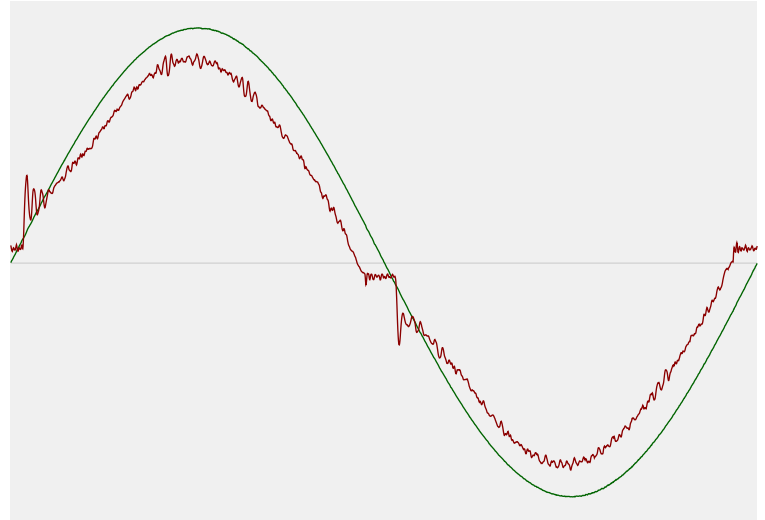

### Efficiency

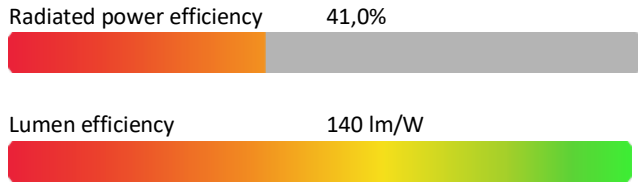

## Stabilization Details

### Warmup Conditions

Stable period	15 min
Stable change max	2,0%
Minimum time	15 min

### Color Temperature Change

CCT start	3994 K
CCT shift	+6 K
CCT end	4000 K


### Warmup Result

Total warmup time	Lamp stabilized in 15 min 2 sec
Warmup variation	-0,4%

### Output Change

Output start	14415 lm
Output change	-44 lm
Output end	14371 lm

### Stabilization Curve

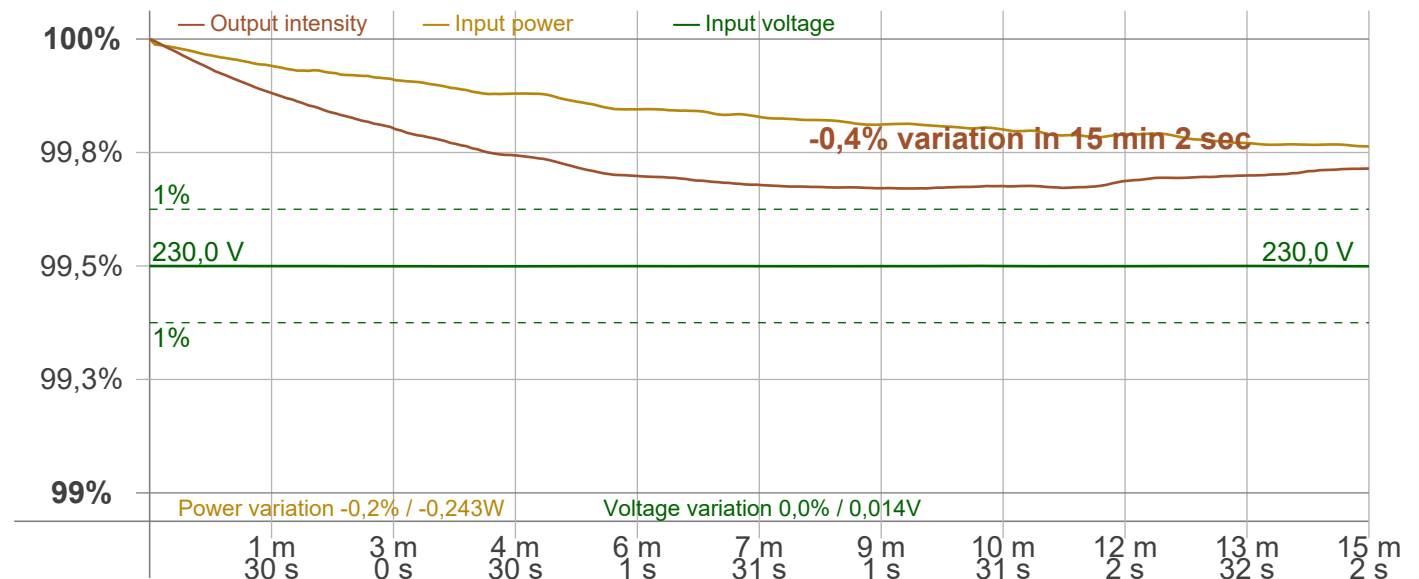

# Light Measurement Report

Print date: 20-1-2025

Measurement date and time: 20-1-2025 08:55:42 – Measurement no. VFR-250120-3029-MS

Measurement tracking No. and Link: [VT250120-003518](#)

Operator:



## Flicker /TLA details

Flicker Meter Type Viso Systems LabFlicker  
 Frequency of input power 50 Hz  
 Flicker/TLA sample rate 20000 samples/s

**Measurement time**  
 PstLM 180 sec  
 All other indices 1,2 sec

### Flicker indices according to Illuminating Engineering Society (IES)

Flicker frequency 100 Hz  
 Percent Flicker 0,53 %  
 Flicker index 0

### Flicker indices according to California Energy Commission (CEC) 2016b

JA8/10 40 Hz 0,06 %  
 JA8/10 90 Hz 0,11 %  
 JA8/10 200 Hz 0,42 %  
 JA8/10 400 Hz 0,44 %  
 JA8/10 1000 Hz 0,5 %


### TLA indices (re IEC TR 61547-1, IEC 61000-3-3 and IEC 61000-4-15)

PstLM value (F < 80 Hz) 0,05  
 SVM value (80 < F < 2000 Hz) 0,01

### Flicker indices according to Lighting Research Center (2015)

Perception metric, Assist Mp 0,03

### Flicker frame (frame of one flicker period in time domain)

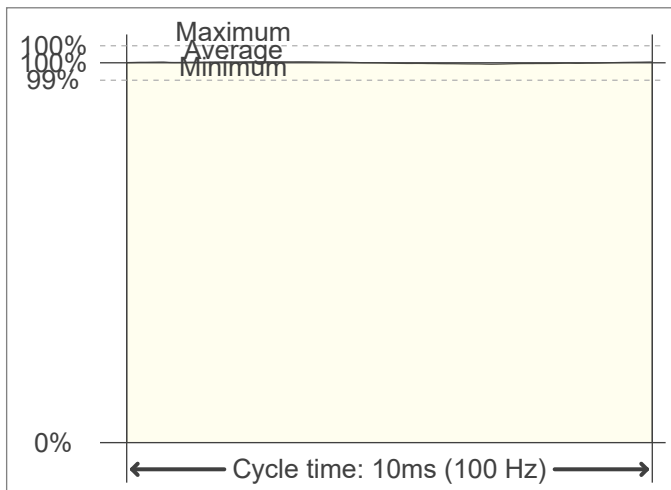

### Flicker FFT (flicker curve in frequency domain)



### IEEE 1789 Frequency/modulation plot

