

Light Measurement Report

Print date: 22-1-2025

Measurement date and time: 22-1-2025 15:41:00 – Measurement no. VFR-250122-3060-MS

Measurement tracking No. and Link: [VT250122-001817](#)

Operator:



Laboratory and Equipment

Laboratory Owner and Location
Goniospectrometer System and Type
Sensor Name, Calibr. Date and Serial No.
Spectrometer Manufacturer and Model

Viso Systems, Copenhagen V, Denmark
LabSpion – Type C, horizontal
LabSensor Model2 – 11-1-2024 – 3130191315
Ibsen Photonics, Denmark – Freedom VIS (Custom Viso)

Measurement Conditions

Number of C-planes and Resolution
 γ (gamma)-Resolution
Test Distance
Input Power, Power and Displ. Factors
Input RMS Voltage and Current
Frequency of Input Power
Warm-up Time and Variation

12 planes – 30°
5°
3,25 m
147,3 W – PF 0,99 – DPF 0,99
230 V – 0,650 A
50 Hz
Lamp stabilized in 15 min 3 sec – 2,0%

Tested Light Source



Product Name
Item No. and Manufacturer
Product Description (line 1)

802660-4000K
802660-4000K – Dutchfulfillment
LED HIGHBAY | KALIK | 150W | PHILIPS DRIVER | IP65 | 120°

Main Light Measurement Results

Output – Total Lumen (Up% / Down%)
Efficiency
Peak Intensity and Beam Angle
Correlated Color Temperature, Target/Measured
Color Rendering Index
Color Rendering TM30-18
Color Shift, CIE duv and MacAdam Steps
Flicker

20908 lm – 0,13% / 99,87%
142 lm/W
7340 cd – 114,6°
CCT = 4000 K / 4058 K
CRI 81,0
 R_f 83,2 – R_g 92,5
Duv 0,0040 – SDCM 3,3
SVM 0,01 – PstLM 0,07

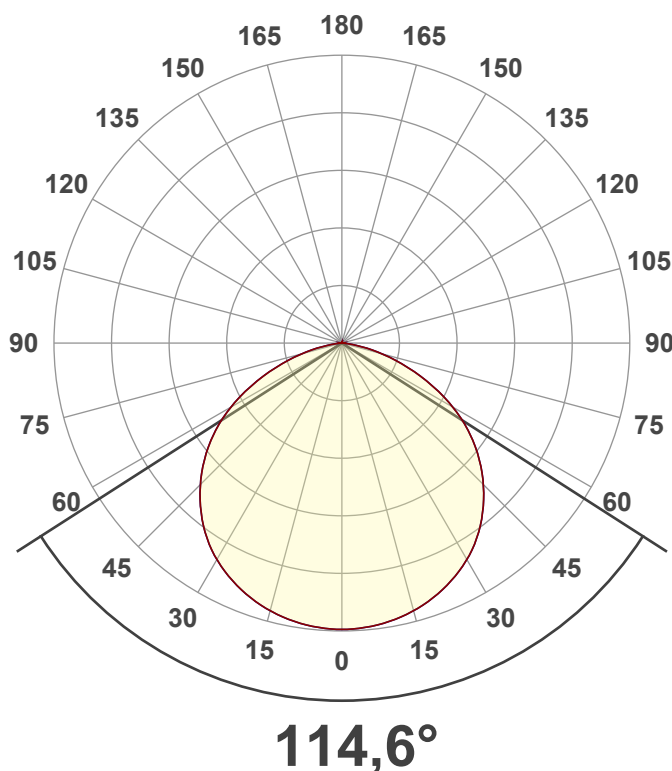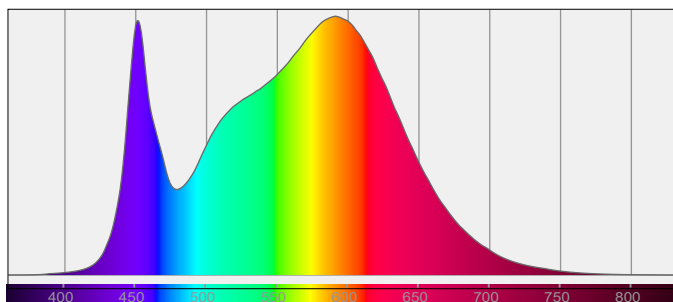

Light Measurement Report

Print date: 22-1-2025

Measurement date and time: 22-1-2025 15:41:00 – Measurement no. VFR-250122-3060-MS


Measurement tracking No. and Link: [VT250122-001817](https://www.viso-systems.com/VT250122-001817)

Operator:



Luminous Intensity diagram

Unit: 0-100% of peak intensity

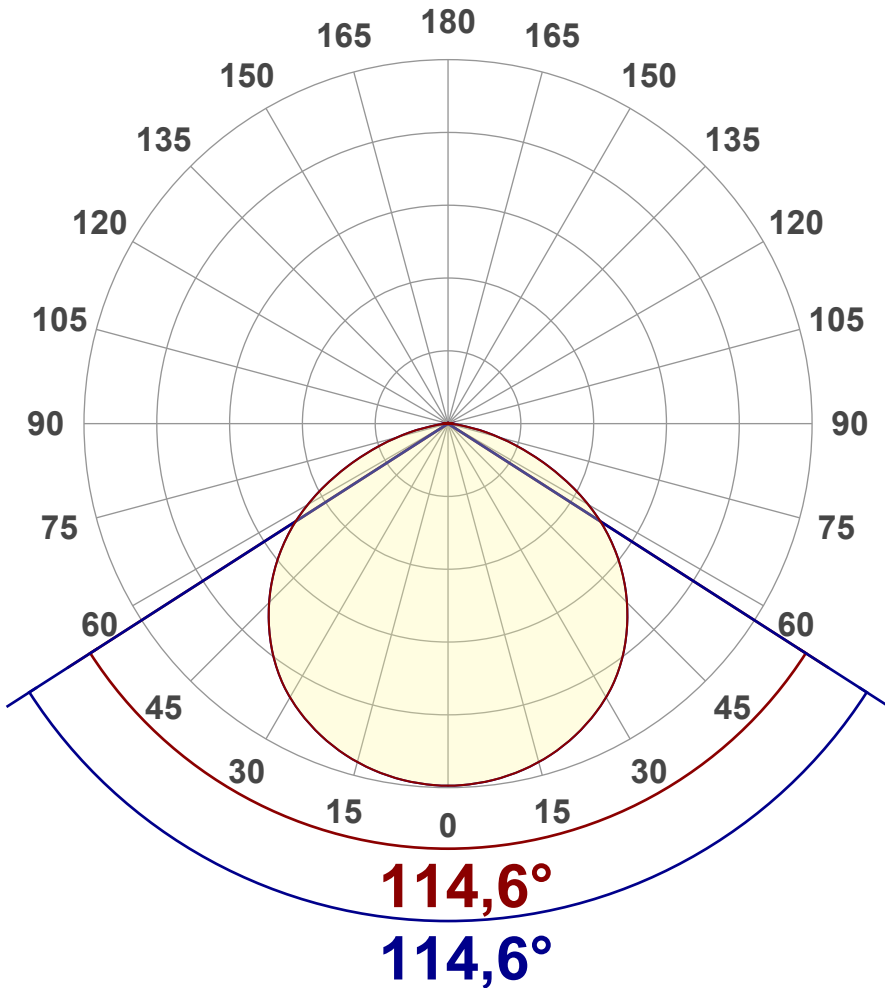

Main Values

Output (total Lumen)	20908 lm
Lumen Up% / Down%	0,13% / 99,87%
Peak Intensity	7340 cd
Beam Angle (50%)	114,6°
Beam Angle (90%)	114,6°
Beam Angle (10%)	114,6°

Cut-off Angle

Average 2,5%	168,1°
--------------	--------

Field Angle

Average 10%	155,6°
-------------	--------


Intensity Ratio

In 120° cone	81,7%
In 90° cone	55,4%

C000-C180

C090-C270

Linear distribution diagram - Intensity (candela) vs γ -angle

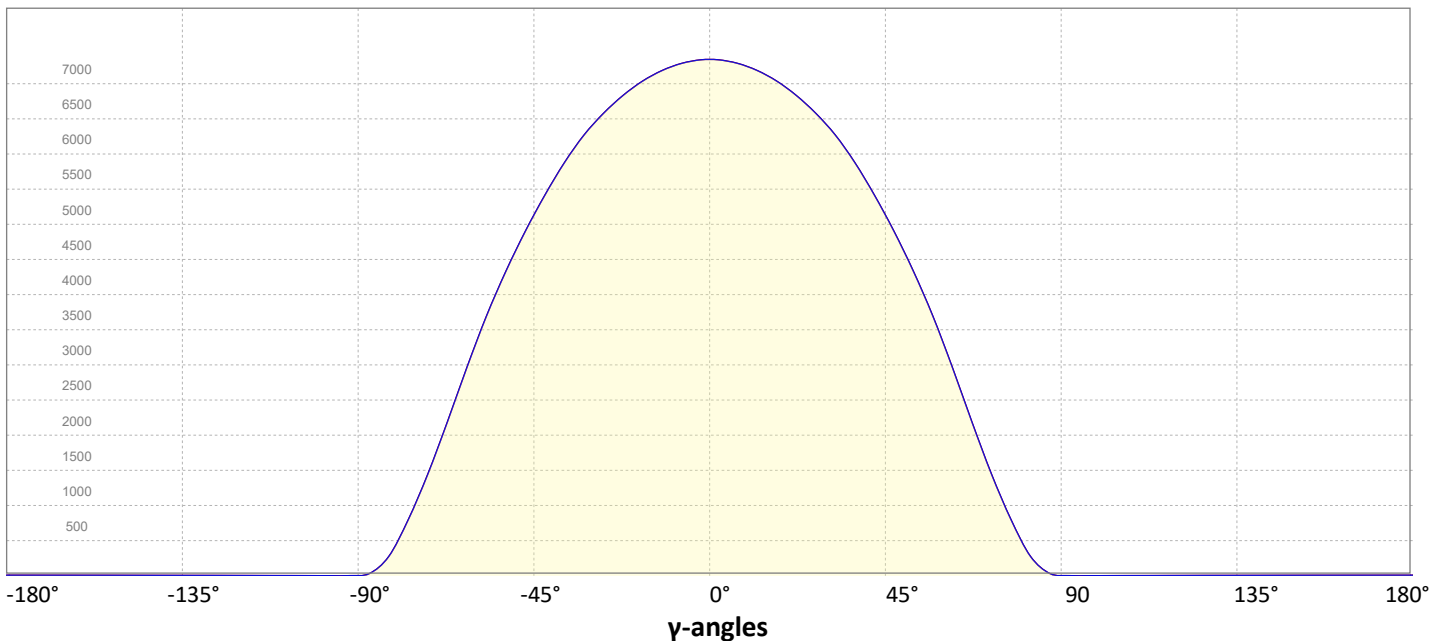

Light Measurement Report

Print date: 22-1-2025


Measurement date and time: 22-1-2025 15:41:00 – Measurement no. VFR-250122-3060-MS

Measurement tracking No. and Link: [VT250122-001817](#)

Operator:




Iso-intensity Diagram (Iso-candela)

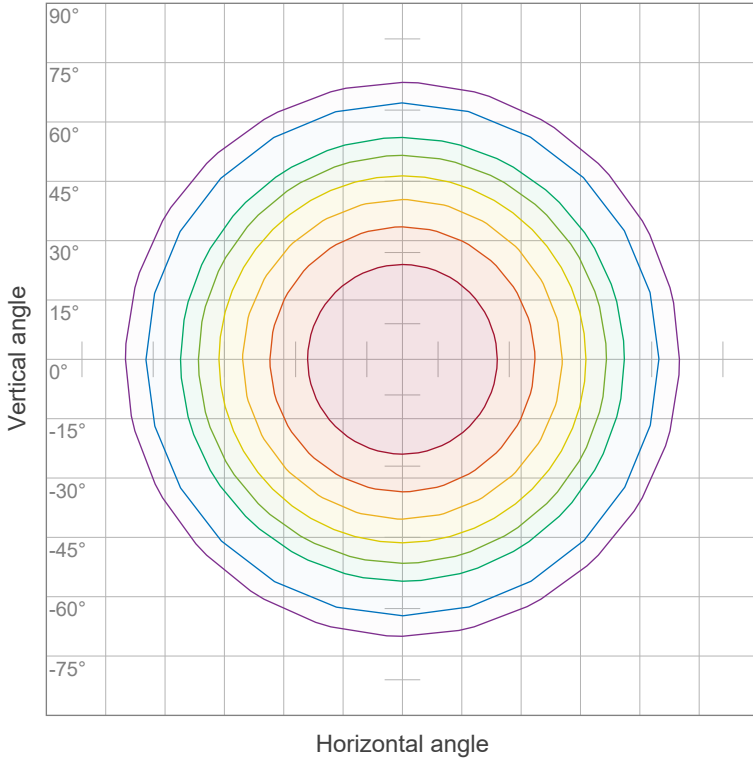

90 %	6605,9 cd
80 %	5871,9 cd
70 %	5138,0 cd
60 %	4404,0 cd
50 %	3670,0 cd
40 %	2936,0 cd
30 %	2202,0 cd
20 %	1468,0 cd
10 %	734,0 cd

Peak intensity: 7339,9 cd
Number of c-planes: 12

Iso-illuminance Diagram (Iso-lux)

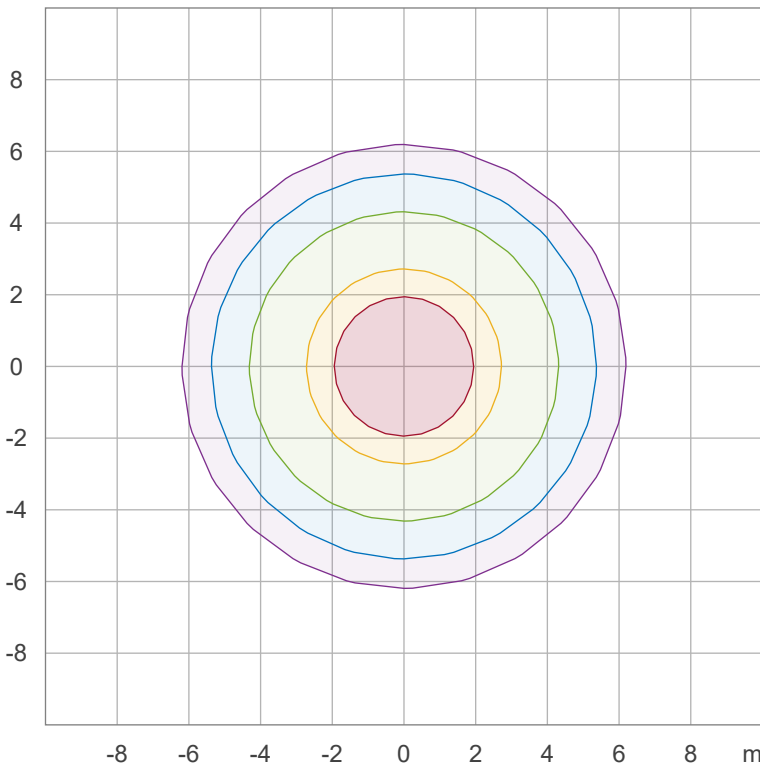

50,0 %	407,8 lx
30,0 %	244,7 lx
10,0 %	81,6 lx
5,0 %	40,8 lx
3,0 %	24,5 lx

Peak illuminance: 815,5 lx
Mounting height: 3,0 m
Number of c-planes: 12

Light Measurement Report

Print date: 22-1-2025

Measurement date and time: 22-1-2025 15:41:00 – Measurement no. VFR-250122-3060-MS

Measurement tracking No. and Link: [VT250122-001817](https://vt250122-001817)

Operator:




Color details


Correlated Color Temperature, Target CCT = 4000 K
 Correlated Color Temperature, Measured CCT = 4058 K
 Color Rendering Index CRI 81,0
 Color Rendering Index, R9 (red component) R9 = -7,9
 Color Rendering TM30-18 R_f 83,2 – R_g 92,5
 Color Quality Scale CQS = 81,1

MacAdam Steps SDCM = 3,3
 Color coordinates CIE 1931 (x;y) = (0,381;0,377)
 Color coordinate CIEs 1960 (u;v) = (0,225;0,334)
 Color deviation from BBL Duv = 0,0040
 Color coordinate CIEs 1976 (CIELUV) (u';v') = (0,225;0,502)


CIE 1931

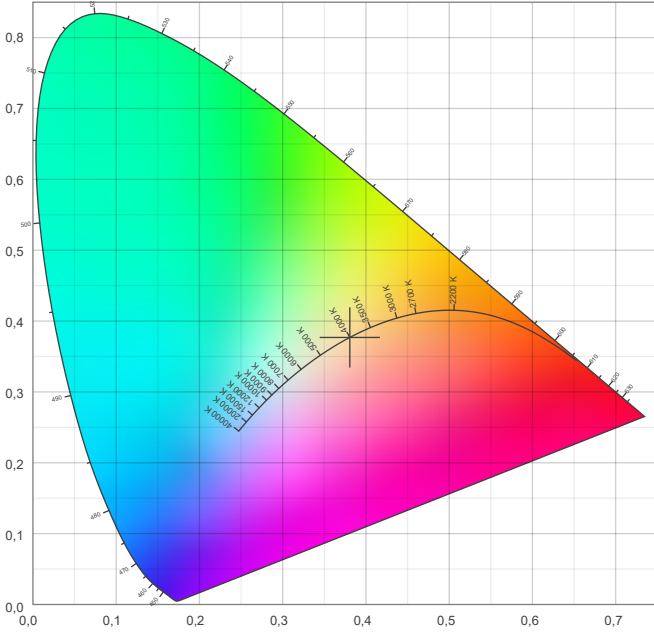

CIE 1931 – zoomed on Planckian locus

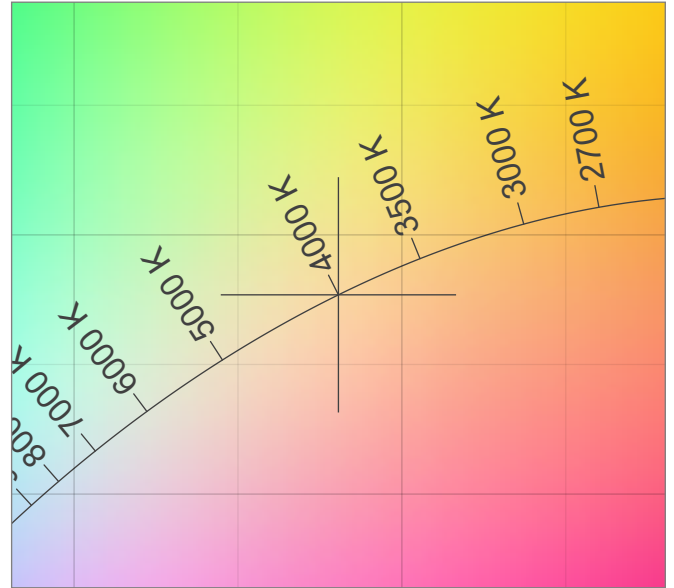


Color Rendering Index per reference color (CIE 1995)

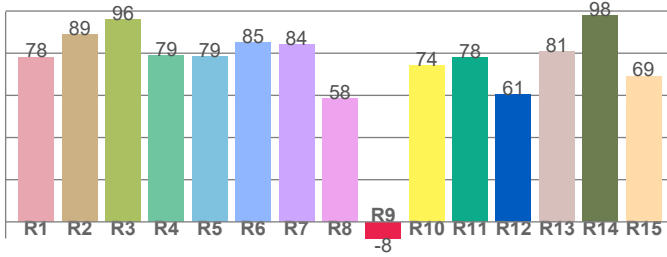


CRI R values, only R1-R8 are used to calculate final CRI value

R1	R2	R3	R4	R5	R6	R7	R8	R9	R10	R11	R12	R13	R14	R15
78,2	88,8	96,1	78,8	78,6	85,1	84,1	58,4	-7,9	74,3	77,9	60,5	81,0	98,1	69,2

Spectral power distribution (SPD) / W/nm – 0-100%

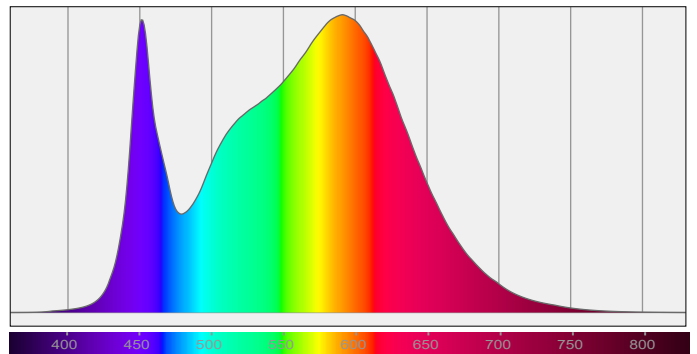


TM30-18 Rf-values per hue bin

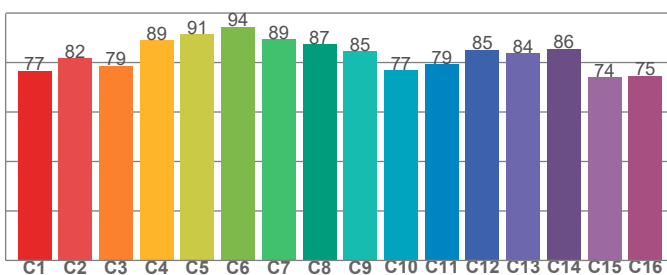

TM30 C values, 16 binned values out of total of 99 C values

C1	C2	C3	C4	C5	C6	C7	C8	C9	C10	C11	C12	C13	C14	C15	C16
76,7	81,7	78,8	89,1	91,4	94,4	89,4	87,5	84,6	76,8	79,4	85,1	83,9	85,5	74,1	74,6

Color Quality Scale by reference color

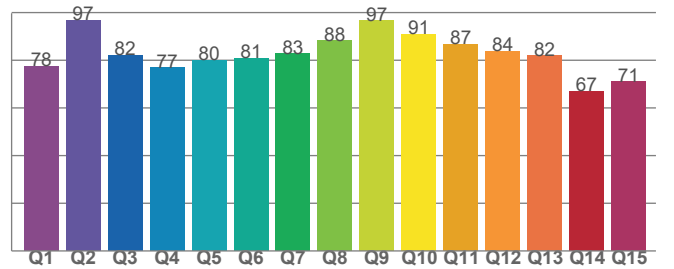

CQS Q values

Q1	Q2	Q3	Q4	Q5	Q6	Q7	Q8	Q9	Q10	Q11	Q12	Q13	Q14	Q15
77,5	96,8	82,1	76,8	79,9	80,9	82,8	88,1	96,6	90,9	86,7	83,9	82,0	66,9	71,1

Light Measurement Report

Print date: 22-1-2025


Measurement date and time: 22-1-2025 15:41:00 – Measurement no. VFR-250122-3060-MS

Measurement tracking No. and Link: [VT250122-001817](https://www.viso-systems.com/VT250122-001817)

Operator:



Beam Details

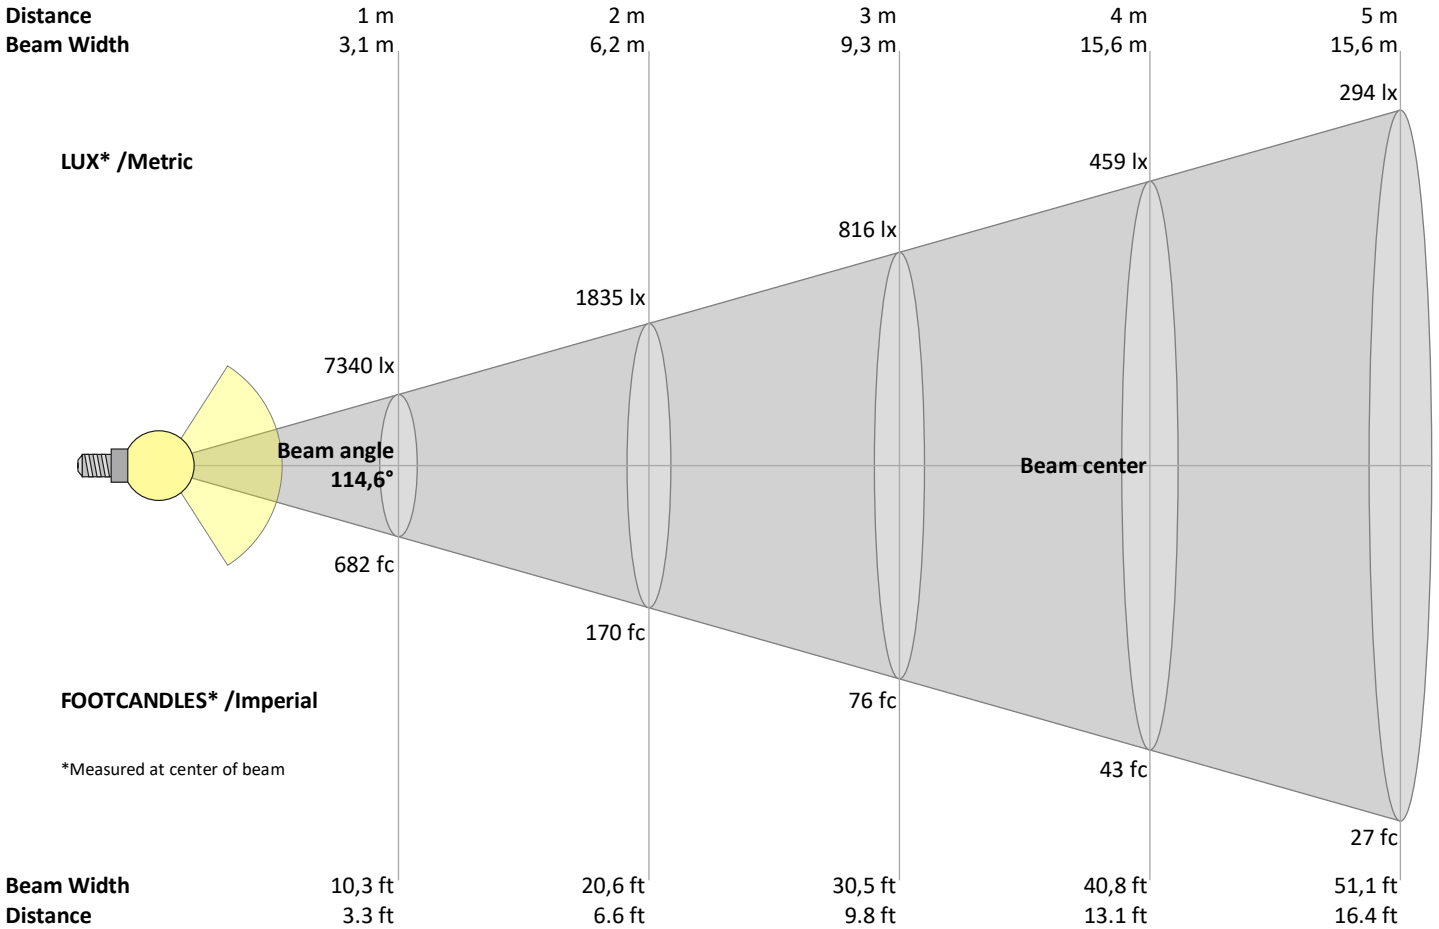

Beam intensities from 1 – 20 m

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	m
3,3	6,6	9,8	13,1	16,4	19,7	23	26,2	29,5	32,8	36,1	39,4	42,7	45,9	49,2	52,5	55,8	59,1	62,3	65,6	ft
7340	1835	816	459	294	204	150	115	91	73	61	51	43	37	33	29	25	23	20	18	lux
681,9	170,5	75,8	42,6	27,3	18,9	13,9	10,7	8,4	6,8	5,6	4,7	4	3,5	3	2,7	2,4	2,1	1,9	1,7	fc

Intensities in 0° c-plane

0°	5°	10°	15°	20°	25°	30°	35°	40°	45°	50°	55°	60°	65°	70°	75°	80°	85°	90°	95°	γ
7340	7311	7232	7102	6922	6689	6404	6048	5617	5126	4579	3969	3277	2522	1766	1078	501	136	14	2	cd
100%	100%	99%	97%	94%	91%	87%	82%	77%	70%	62%	54%	45%	34%	24%	15%	7%	2%	0%	0%	of 0°val

Intensities in 90° c-plane

0°	5°	10°	15°	20°	25°	30°	35°	40°	45°	50°	55°	60°	65°	70°	75°	80°	85°	90°	95°	γ
7340	7311	7232	7102	6922	6689	6404	6048	5617	5126	4579	3969	3277	2522	1766	1078	501	136	14	2	cd
100%	100%	99%	97%	94%	91%	87%	82%	77%	70%	62%	54%	45%	34%	24%	15%	7%	2%	0%	0%	of 0°val

Intensities in 180° c-plane

0°	5°	10°	15°	20°	25°	30°	35°	40°	45°	50°	55°	60°	65°	70°	75°	80°	85°	90°	95°	γ
7340	7311	7232	7102	6922	6689	6404	6048	5617	5126	4579	3969	3277	2522	1766	1078	501	136	14	2	cd
100%	100%	99%	97%	94%	91%	87%	82%	77%	70%	62%	54%	45%	34%	24%	15%	7%	2%	0%	0%	of 0°val

Intensities in 270° c-plane

0°	5°	10°	15°	20°	25°	30°	35°	40°	45°	50°	55°	60°	65°	70°	75°	80°	85°	90°	95°	γ
7340	7311	7232	7102	6922	6689	6404	6048	5617	5126	4579	3969	3277	2522	1766	1078	501	136	14	2	cd
100%	100%	99%	97%	94%	91%	87%	82%	77%	70%	62%	54%	45%	34%	24%	15%	7%	2%	0%	0%	of 0°val

Light Measurement Report

Print date: 22-1-2025

Measurement date and time: 22-1-2025 15:41:00 – Measurement no. VFR-250122-3060-MS

Measurement tracking No. and Link: [VT250122-001817](#)

Operator:



Light Planning – UGR table

Uncorrected, comprehensive UGR table according to 117-1995

Reflectances		70	70	50	50	30	70	70	50	50	30
	ρ Ceiling	70	70	50	50	30	70	70	50	50	30
	ρ Walls	50	30	50	30	30	50	30	50	30	30
	ρ Floor	20	20	20	20	20	20	20	20	20	20
Room size		Viewed Crosswise					Viewed Endwise				
H = mounting height above eye level		(Viewing direction orthogonal to lamp length axis)					(Viewing direction parallel to lamp length axis)				
X	Y										
2H	2H	31,8	33,0	32,1	33,3	33,6	31,8	33,0	32,1	33,3	33,6
	3H	32,9	34,2	33,3	34,4	34,7	32,9	34,2	33,3	34,4	34,7
	4H	33,3	34,5	33,7	34,7	35,0	33,3	34,5	33,7	34,7	35,0
	6H	33,5	34,6	33,8	34,8	35,2	33,5	34,6	33,8	34,8	35,2
	8H	33,5	34,5	33,9	34,8	35,3	33,5	34,5	33,9	34,8	35,3
	12H	33,5	34,5	33,9	34,8	35,3	33,5	34,5	33,9	34,8	35,3
4H	2H	32,3	33,5	32,7	33,8	34,0	32,3	33,5	32,7	33,8	34,0
	3H	33,7	34,7	34,1	35,0	35,5	33,7	34,7	34,1	35,0	35,5
	4H	34,1	35,0	34,5	35,4	35,9	34,1	35,0	34,5	35,4	35,9
	6H	34,3	35,2	34,8	35,5	35,9	34,3	35,2	34,8	35,5	35,9
	8H	34,4	35,1	34,9	35,5	35,9	34,4	35,1	34,9	35,5	35,9
	12H	34,3	35,0	34,8	35,4	35,9	34,3	35,0	34,8	35,4	35,9
8H	4H	34,2	35,0	34,7	35,4	35,8	34,2	35,0	34,7	35,4	35,8
	6H	34,5	35,1	35,1	35,6	36,1	34,5	35,1	35,1	35,6	36,1
	8H	34,6	35,1	35,2	35,7	36,3	34,6	35,1	35,2	35,7	36,3
	12H	34,6	35,1	35,2	35,6	36,2	34,6	35,1	35,2	35,6	36,2
12H	4H	34,2	34,9	34,7	35,3	35,8	34,2	34,9	34,7	35,3	35,8
	6H	34,6	35,1	35,1	35,6	36,2	34,6	35,1	35,1	35,6	36,2
	8H	34,6	35,1	35,2	35,6	36,2	34,6	35,1	35,2	35,6	36,2

Variations with the observer position for the luminaire spacings, S:

S = 1.0H	0,1 / -0,2	0,1 / -0,2
S = 1.5H	0,3 / -0,4	0,3 / -0,4
S = 2.0H	0,8 / -1,0	0,8 / -1,0

Coefficients of Utilization

Ceiling reflectance	80	70	50	30	10	0
Wall reflectance	70 50 30	10 70 50	30 10 50	30 10 50	30 10 50	30 10 0
Floor reflectance	20 20 20	20 20 20	20 20 20	20 20 20	20 20 20	20 20 0
RCR	(RCR: Room Cavity Ratio)					
Room Values are expressed as percentage of Lumen delivered to the task surface						
0	119 119 119	119 116 116	116 116 111	111 111 106	106 106 102	102 102 100
1	109 105 101	97 107 103	99 96 98	95 93 94	92 90 91	89 87 85
2	100 92 85	80 97 90	84 79 86	81 77 83	79 75 80	76 73 71
3	91 81 73	66 88 79	72 66 76	70 64 73	68 63 71	66 62 60
4	83 71 63	56 81 70	62 56 68	61 55 65	59 54 63	58 53 51
5	76 64 55	48 74 63	54 48 61	53 47 59	52 47 57	51 46 44
6	71 57 48	42 69 56	48 42 55	47 42 53	46 41 51	45 41 39
7	65 52 43	37 64 51	43 37 50	42 37 48	41 36 47	41 36 34
8	61 47 39	33 59 47	39 33 45	38 33 44	37 33 43	37 32 30
9	57 43 35	30 55 43	35 30 42	34 29 41	34 29 40	34 29 27
10	53 40 32	27 52 40	32 27 39	32 27 38	31 27 37	31 26 25

Light Measurement Report

Print date: 22-1-2025

Measurement date and time: 22-1-2025 15:41:00 – Measurement no. VFR-250122-3060-MS

Measurement tracking No. and Link: [VT250122-001817](#)


Operator:



Luminaire budgetary diagram

Uncorrected, comprehensive UGR table according to 117-1995

LAMPS (number of lamps)

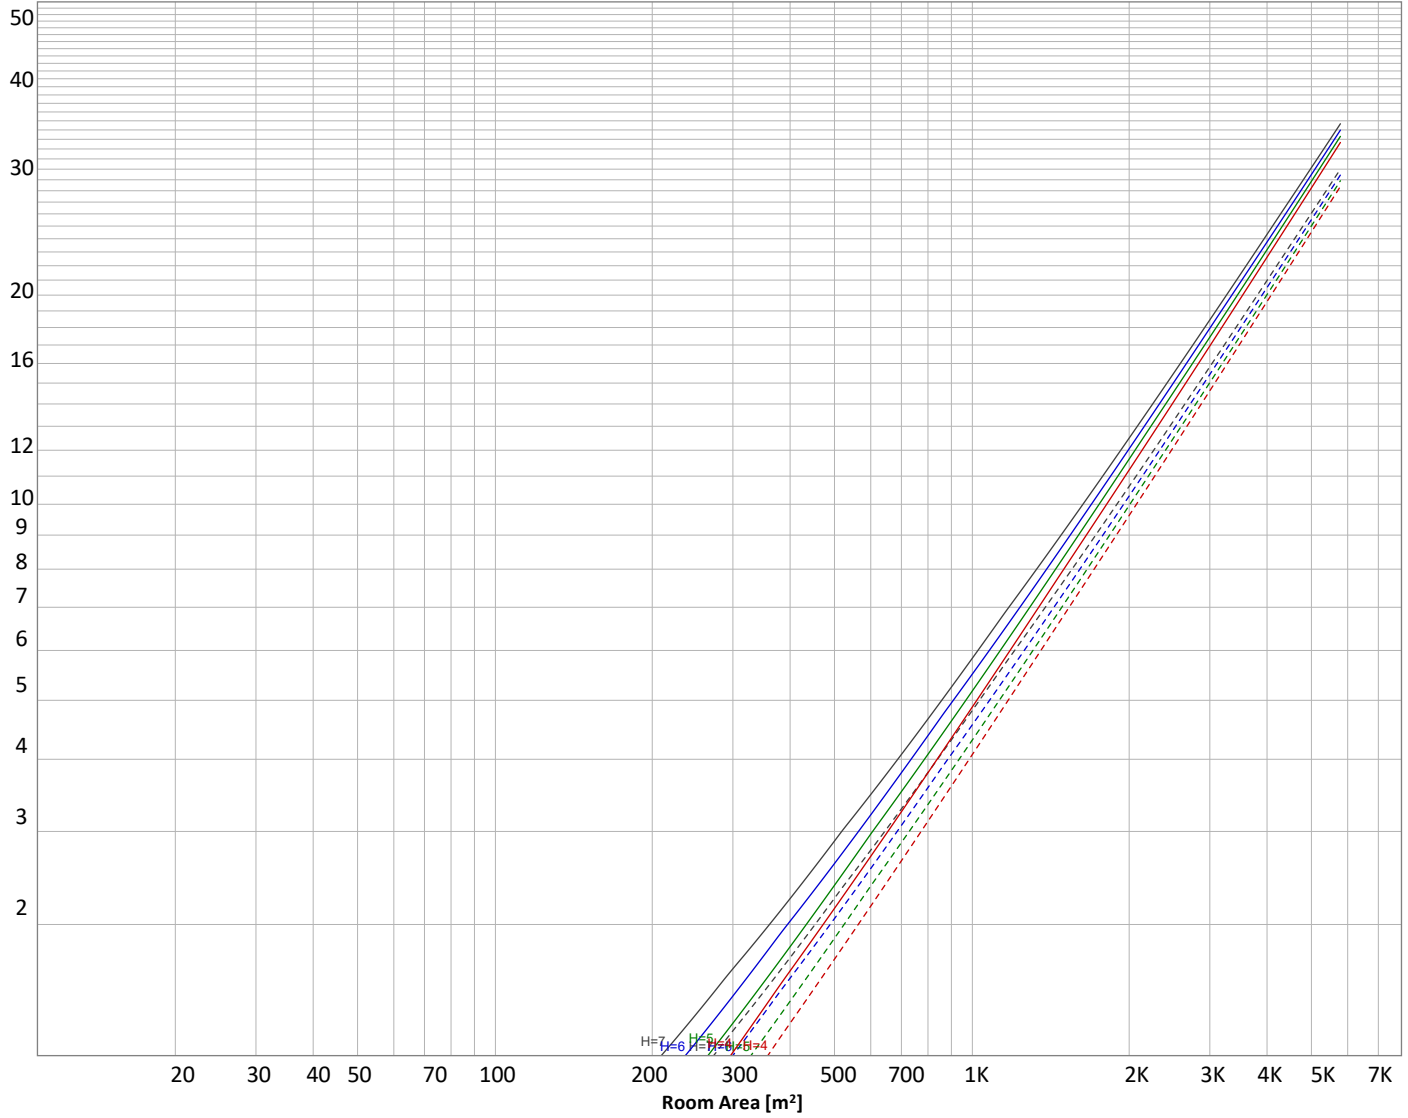

Conditions

H = Room height	Flux = 20908 lm			
H _{down} = Lamp distance from ceiling =	0.00 m	Line type	Ceiling reflectance	ρ(%) Wall reflectance
H _{work} = Work area height from floor =	0.00 m	-----	70	50
E _{work} = Average lux on work area =	100 lx	_____	50	30
				Floor reflectance
				20

Zonal Lumen Summary

0°-10°	10°-20°	20°-30°	30°-40°	40°-50°	50°-60°	60°-70°	70°-80°	80°-90°
696 lm	2009 lm	3089 lm	3789 lm	3958 lm	3548 lm	2495 lm	1141 lm	156 lm
90°-100°	100°-110°	110°-120°	120°-130°	130°-140°	140°-150°	150°-160°	160°-170°	170°-180°
1,90 lm	2,50 lm	3,54 lm	4,55 lm	4,57 lm	4,20 lm	3,48 lm	2,26 lm	0,803 lm

Light Measurement Report

Print date: 22-1-2025

Measurement date and time: 22-1-2025 15:41:00 – Measurement no. VFR-250122-3060-MS

Measurement tracking No. and Link: [VT250122-001817](#)

Operator:



Outdoor Light Planning

Lumen per Zone

Zone (γ)	Lumen	% Total
0-10°	{LUM00-10} lm	#VALUE!
10-20°	{LUM10-20} lm	#VALUE!
20-30°	{LUM20-30} lm	#VALUE!
30-40°	{LUM30-40} lm	#VALUE!
40-50°	{LUM40-50} lm	#VALUE!
50-60°	{LUM50-60} lm	#VALUE!
60-70°	{LUM60-70} lm	#VALUE!
70-80°	{LUM70-80} lm	#VALUE!
80-90°	{LUM80-90} lm	#VALUE!
90-100°	{LUM90-100} lm	#VALUE!
100-110°	{LUM100-110} lm	#VALUE!
110-120°	{LUM110-120} lm	#VALUE!
120-130°	{LUM120-130} lm	#VALUE!
130-140°	{LUM130-140} lm	#VALUE!
140-150°	{LUM140-150} lm	#VALUE!
150-160°	{LUM150-160} lm	#VALUE!
160-170°	{LUM160-170} lm	#VALUE!
170-180°	{LUM170-180} lm	#VALUE!
Total	0 lm	#VALUE!

Intensity peaks

Max intensity	{PEAK} cd
Intensity, 90°	{INT90} cd
Intensity, 0°	{INT0} cd

Zonal Lumen summary


Zone (γ)	Lumen	% Total
0-30°	{LUM00-30} lm	#VALUE!
0-40°	{LUM00-40} lm	#VALUE!
0-60°	{LUM00-60} lm	#VALUE!
60-90°	{LUM60-90} lm	#VALUE!
70-100°	{LUM70-100} lm	#VALUE!
90-120°	{LUM90-120} lm	#VALUE!
0-90°	{LUM00-90} lm	#VALUE!
90-180°	{LUM90-180} lm	#VALUE!
0-180°	{LUM00-180} lm	#VALUE!

BUG rating

	Lumen	% Total
Forward light		
Low(0-30°)	{BUG0} lm	#VALUE!
Medium(30-60°)	{BUG1} lm	#VALUE!
High(60-80°)	{BUG2} lm	#VALUE!
Very high(80-90°)	{BUG3} lm	#VALUE!
Back light		
Low(0-30°)	{BUG4} lm	#VALUE!
Medium(30-60°)	{BUG5} lm	#VALUE!
High(60-80°)	{BUG6} lm	#VALUE!
Very high(80-90°)	{BUG7} lm	#VALUE!
Uplight		
Low(90-100°)	{BUG8} lm	#VALUE!
High(100-180°)	{BUG9} lm	#VALUE!

IESNA TM-15-07 Luminaire Classification System For Outdoor Luminaires

BUG rating B4 U2 G2

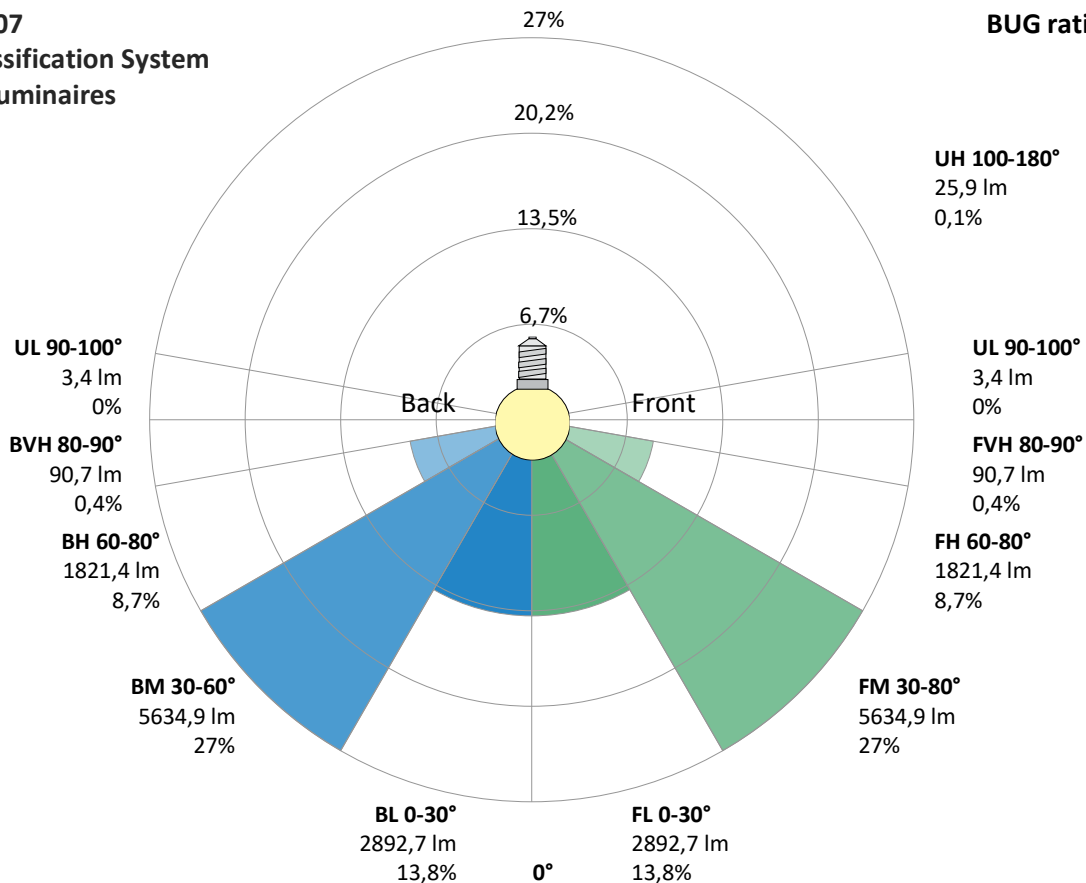

Light Measurement Report

Print date: 22-1-2025

Measurement date and time: 22-1-2025 15:41:00 – Measurement no. VFR-250122-3060-MS

Measurement tracking No. and Link: [VT250122-001817](#)

Operator:




Power Details


Input Power

Power feed to light source	147,3 W
Frequency of input power	50 Hz
RMS Input voltage feed, V_{RMS}	230 V
RMS Input current feed, I_{RMS}	0,650 A
Volt-Ampere or apparent power = $V_{RMS} * I_{RMS}$	149,34 VA
Displacement factor of AC power feed	0,99
Power factor of AC current feed	0,99
Total harmonic distortion of the current	8,25%
Total harmonic distortion of the voltage	0,07%

Input Power Curve

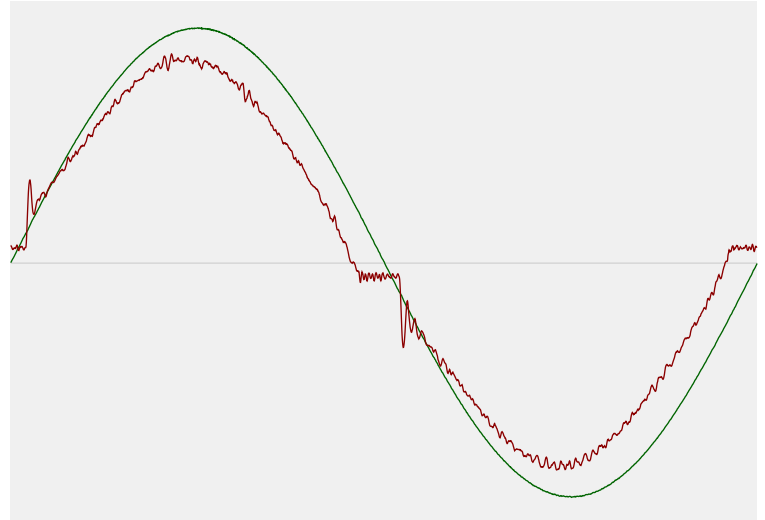

Efficiency

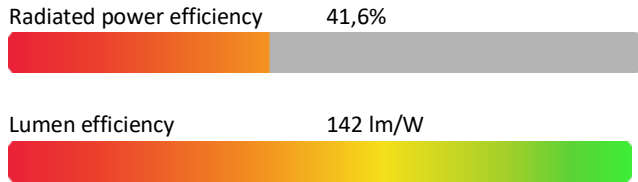

Stabilization Details

Warmup Conditions

Stable period	15 min
Stable change max	2,0%
Minimum time	15 min

Color Temperature Change

CCT start	3999 K
CCT shift	+1 K
CCT end	4000 K


Warmup Result

Total warmup time	Lamp stabilized in 15 min 3 sec
Warmup variation	-0,2%

Output Change

Output start	20940 lm
Output change	-32 lm
Output end	20908 lm

Stabilization Curve

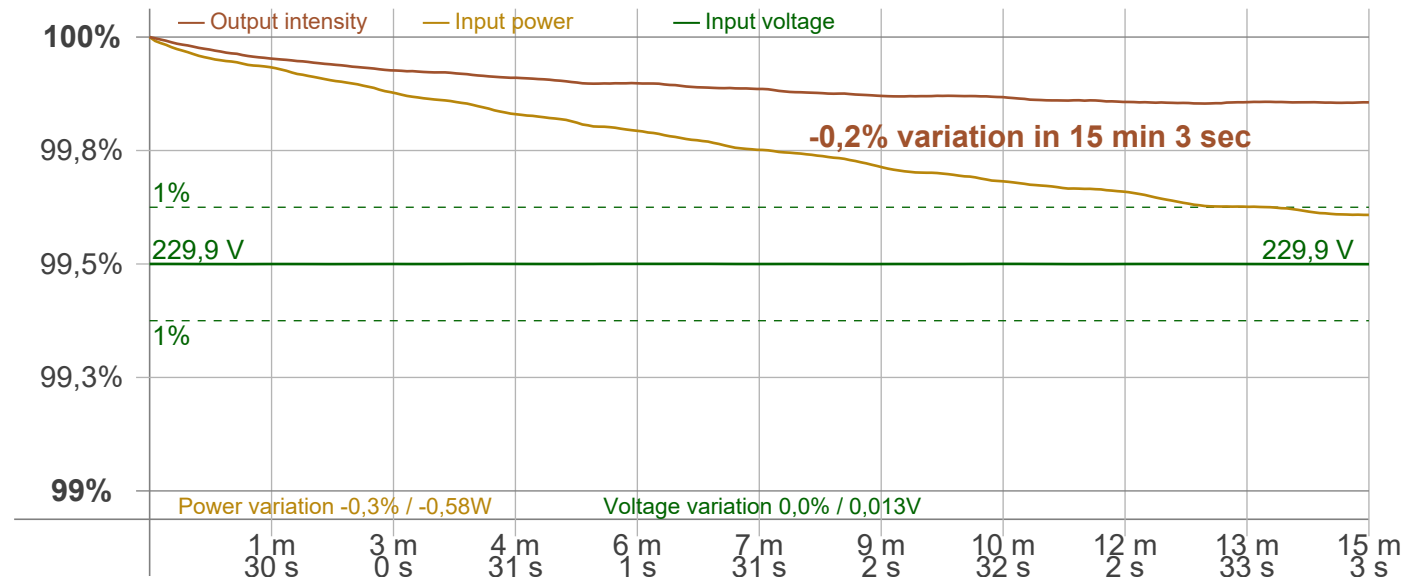

Light Measurement Report

Print date: 22-1-2025

Measurement date and time: 22-1-2025 15:41:00 – Measurement no. VFR-250122-3060-MS

Measurement tracking No. and Link: [VT250122-001817](#)

Operator:



Flicker /TLA details

Flicker Meter Type Viso Systems LabFlicker
 Frequency of input power 50 Hz
 Flicker/TLA sample rate 20000 samples/s

Measurement time
 PstLM 180 sec
 All other indices 1,2 sec

Flicker indices according to Illuminating Engineering Society (IES)

Flicker frequency 86,58 Hz
 Percent Flicker 0,48 %
 Flicker index 0

Flicker indices according to California Energy Commission (CEC) 2016b

JA8/10 40 Hz 0,12 %
 JA8/10 90 Hz 0,17 %
 JA8/10 200 Hz 0,41 %
 JA8/10 400 Hz 0,43 %
 JA8/10 1000 Hz 0,45 %


TLA indices (re IEC TR 61547-1, IEC 61000-3-3 and IEC 61000-4-15)

PstLM value (F < 80 Hz) 0,07
 SVM value (80 < F < 2000 Hz) 0,01


Flicker indices according to Lighting Research Center (2015)

Perception metric, Assist Mp 0,05

Flicker frame (frame of one flicker period in time domain)

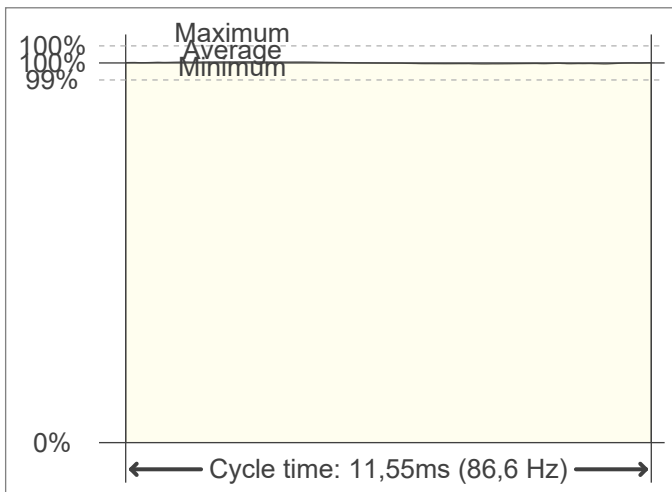

Flicker FFT (flicker curve in frequency domain)

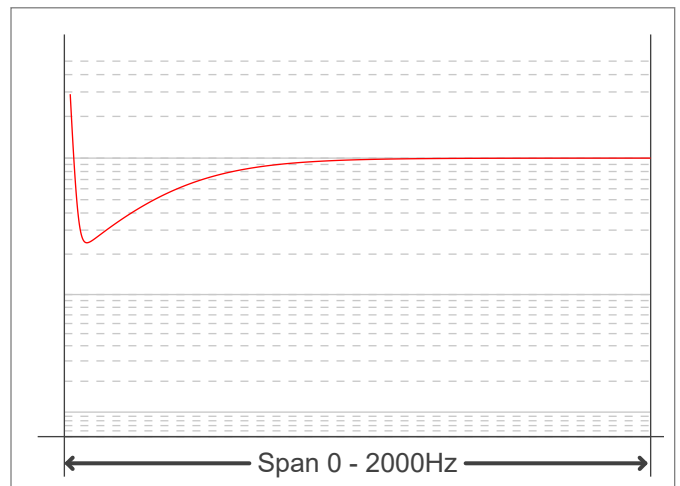

IEEE 1789 Frequency/modulation plot

