

Light Measurement Report

Print date: 16-5-2025

Measurement date and time: 16-5-2025 10:56:30 – Measurement no. VFR-250516-1292-MS

Measurement tracking No. and Link: [VT250516-001163](#)

Operator:



Laboratory and Equipment

Laboratory Owner and Location
Goniospectrometer System and Type
Sensor Name, Calibr. Date and Serial No.
Spectrometer Manufacturer and Model

Viso Systems, Copenhagen V, Denmark
LabSpion – Type C, horizontal
LabSensor Model2 – 11-1-2024 – 3130191315
Ibsen Photonics, Denmark – Freedom VIS (Custom Viso)

Measurement Conditions

Number of C-planes and Resolution
 γ (gamma)-Resolution
Test Distance
Input Power, Power and Displ. Factors
Input RMS Voltage and Current
Frequency of Input Power
Warm-up Time and Variation

24 planes – 15°
5°
2,58 m
40,0 W – PF 0,97 – DPF 0,99
230 V – 0,180 A
50 Hz
Lamp stabilized in 18 min 8 sec – 2,0%

Tested Light Source



Product Name
Item No. and Manufacturer
Product Description (line 1)

RPD-W40-3000K
RPD-W40-3000K – Dutchfulfillment
3-FASE RAILSPOT 38° WIT 40W DIMBAAR CRI>97

Main Light Measurement Results

Output – Total Lumen (Up% / Down%)
Efficiency
Peak Intensity and Beam Angle
Correlated Color Temperature, Target/Measured
Color Rendering Index
Color Rendering TM30-18
Color Shift, CIE duv and MacAdam Steps
Flicker

3084 lm – 0,07% / 99,93%
77 lm/W
6121 cd – 32,5°
CCT = 3000 K / 3033 K
CRI 98,0
 R_f 94,4 – R_g 101,2
Duv -0,0010 – SDCM 1,7
SVM 0,03 – PstLM 0,36

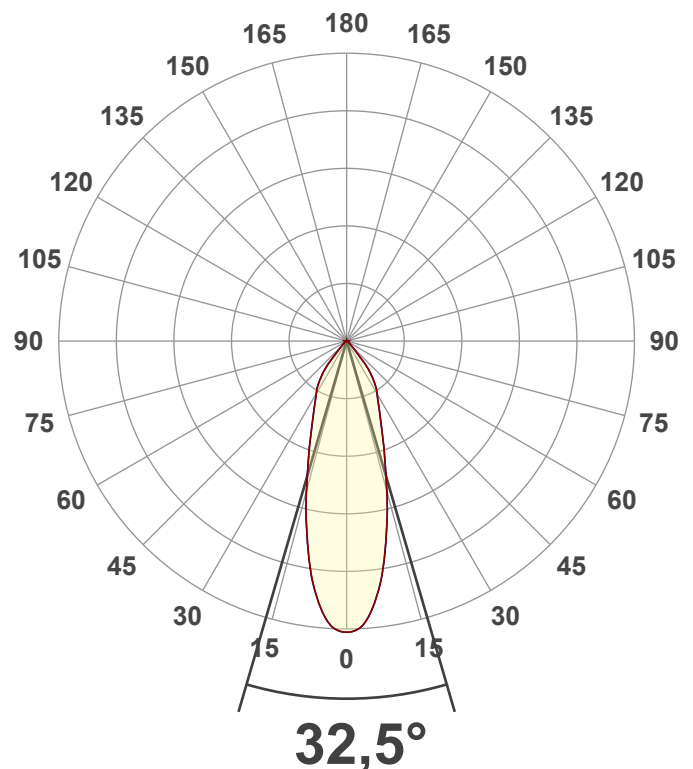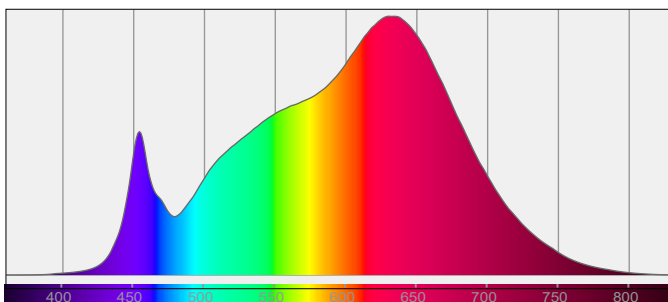

Light Measurement Report

Print date: 16-5-2025

Measurement date and time: 16-5-2025 10:56:30 – Measurement no. VFR-250516-1292-MS


Measurement tracking No. and Link: [VT250516-001163](#)

Operator:



Luminous Intensity diagram

Unit: 0-100% of peak intensity

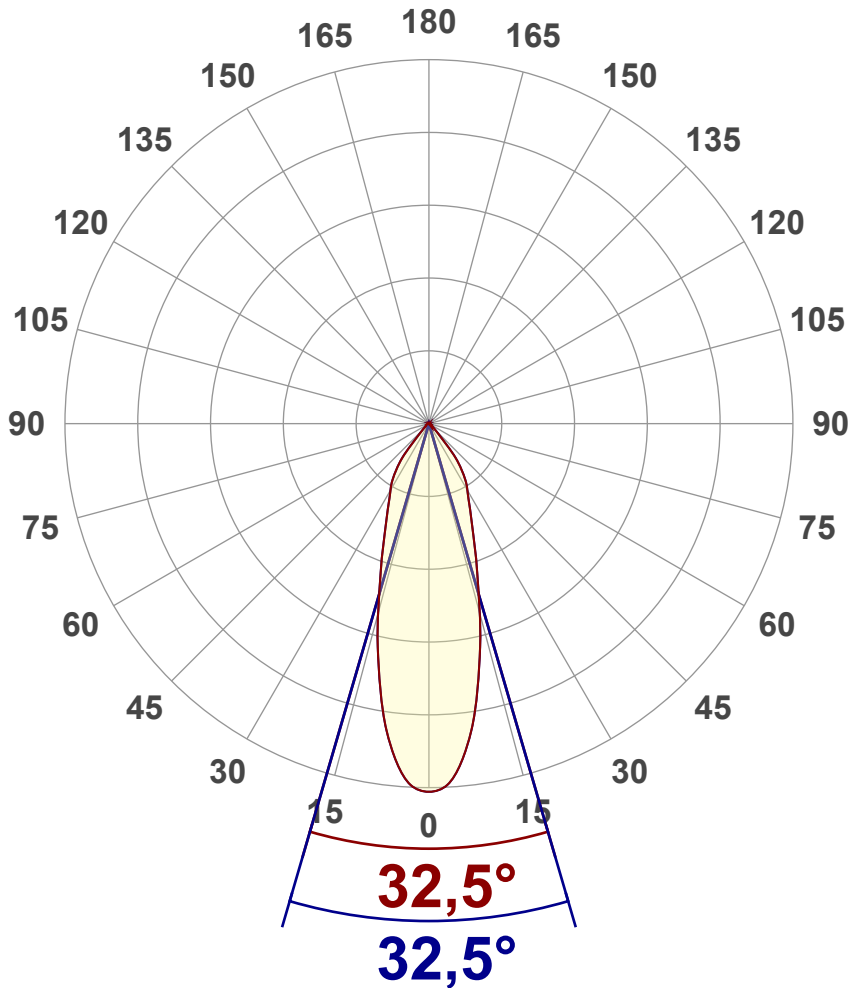

Main Values

Output (total Lumen)	3084 lm
Lumen Up% / Down%	0,07% / 99,93%
Peak Intensity	6121 cd
Beam Angle (50%)	32,5°
Beam Angle (90%)	32,5°
Beam Angle (10%)	32,5°

Cut-off Angle

Average 2,5%	91,1°
--------------	-------

Field Angle

Average 10%	78,2°
-------------	-------


Intensity Ratio

In 120° cone	97,8%
In 90° cone	94,6%

C000-C180

C090-C270

Linear distribution diagram - Intensity (candela) vs γ -angle

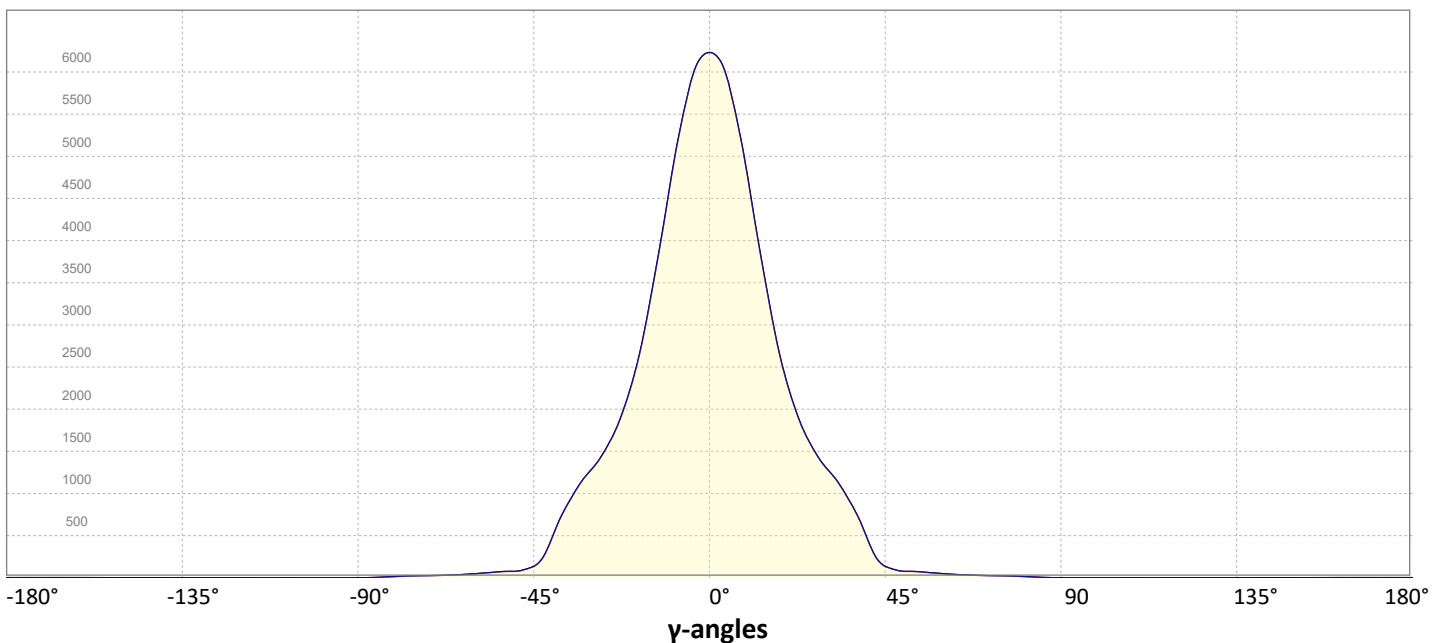

Light Measurement Report

Print date: 16-5-2025


Measurement date and time: 16-5-2025 10:56:30 – Measurement no. VFR-250516-1292-MS

Measurement tracking No. and Link: [VT250516-001163](#)

Operator:



Iso-intensity Diagram (Iso-candela)

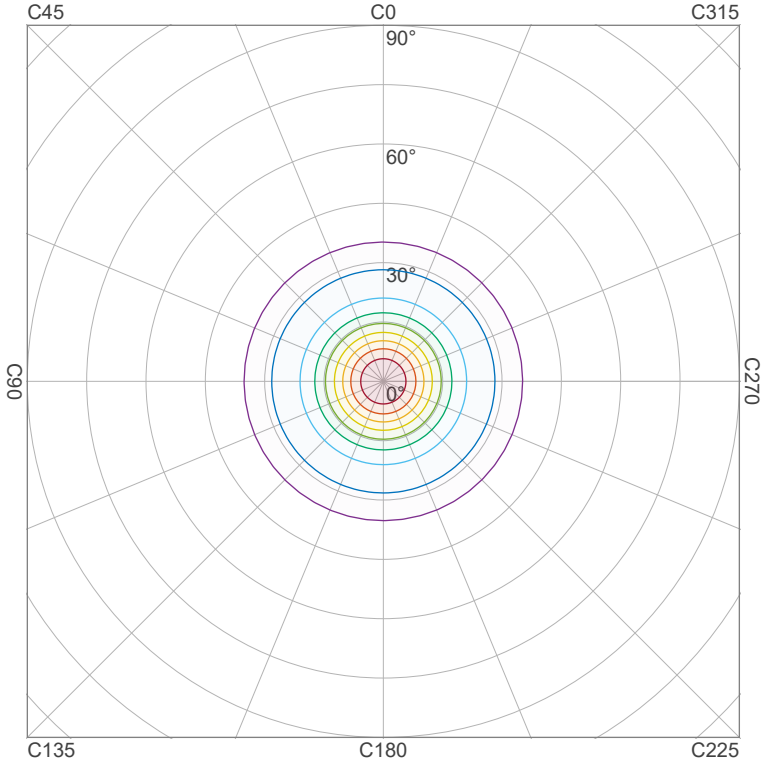


90 %	5508,7 cd
80 %	4896,6 cd
70 %	4284,6 cd
60 %	3672,5 cd
50 %	3060,4 cd
40 %	2448,3 cd
30 %	1836,2 cd
20 %	1224,2 cd
10 %	612,1 cd

Peak intensity: 6120,8 cd

Number of c-planes: 24

Iso-illuminance Diagram (Iso-lux)

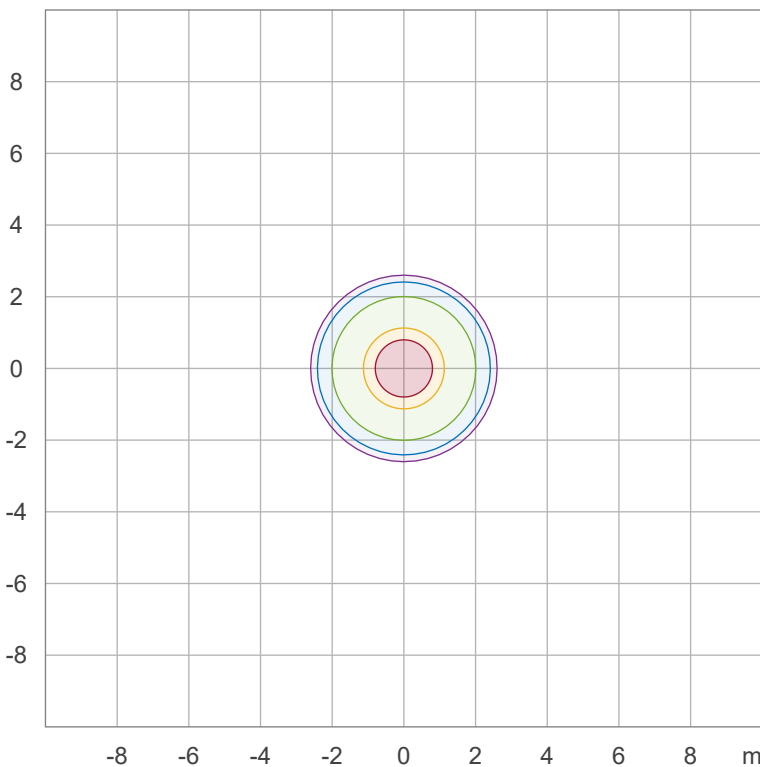

50,0 %	340,0 lx
30,0 %	204,0 lx
10,0 %	68,0 lx
5,0 %	34,0 lx
3,0 %	20,4 lx

Peak illuminance: 680,1 lx

Mounting height: 3,0 m

Number of c-planes: 24

Light Measurement Report

Print date: 16-5-2025

Measurement date and time: 16-5-2025 10:56:30 – Measurement no. VFR-250516-1292-MS

Measurement tracking No. and Link: [VT250516-001163](#)

Operator:



Color details

Correlated Color Temperature, Target CCT = 3000 K
 Correlated Color Temperature, Measured CCT = 3033 K
 Color Rendering Index CRI 98,0
 Color Rendering Index, R9 (red component) R9 = 90,4
 Color Rendering TM30-18 R_f 94,4 – R_g 101,2
 Color Quality Scale CQS = 94,8

MacAdam Steps SDCM = 1,7
 Color coordinates CIE 1931 (x;y) = (0,437;0,404)
 Color coordinate CIEs 1960 (u;v) = (0,251;0,348)
 Color deviation from BBL Duv = -0,0010
 Color coordinate CIEs 1976 (CIELUV) (u';v') = (0,251;0,521)


CIE 1931



CIE 1931 – zoomed on Planckian locus




Color Rendering Index per reference color (CIE 1995)

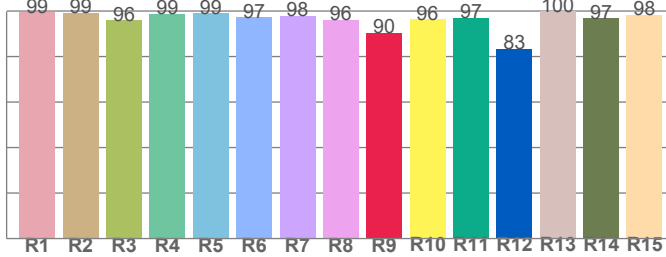


CRI R values, only R1-R8 are used to calculate final CRI value

R1	R2	R3	R4	R5	R6	R7	R8	R9	R10	R11	R12	R13	R14	R15
99,4	99,2	96,1	98,8	98,9	97,3	97,9	96,2	90,4	96,3	97,0	83,5	99,9	96,8	98,4

Spectral power distribution (SPD) / W/nm – 0-100%

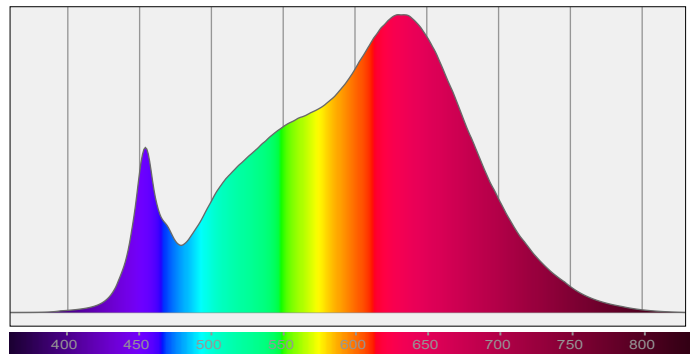


TM30-18 R_f-values per hue bin

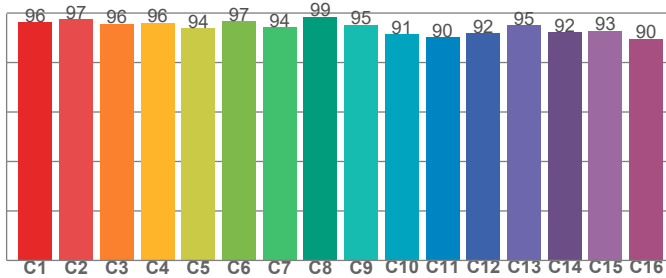

TM30 C values, 16 binned values out of total of 99 C values

C1	C2	C3	C4	C5	C6	C7	C8	C9	C10	C11	C12	C13	C14	C15	C16
96,2	97,5	95,6	96,1	93,8	96,7	94,2	98,5	95,3	91,4	90,3	91,8	95,0	92,2	92,9	89,6

Color Quality Scale by reference color

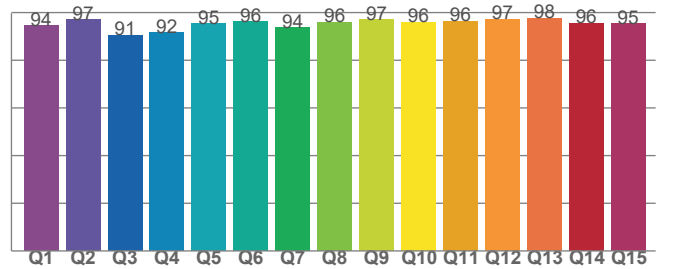

CQS Q values

Q1	Q2	Q3	Q4	Q5	Q6	Q7	Q8	Q9	Q10	Q11	Q12	Q13	Q14	Q15
94,5	97,0	90,6	91,5	95,4	96,2	93,7	95,9	97,1	95,9	96,4	97,2	97,5	95,7	95,3

Light Measurement Report

Print date: 16-5-2025


Measurement date and time: 16-5-2025 10:56:30 – Measurement no. VFR-250516-1292-MS

Measurement tracking No. and Link: [VT250516-001163](https://www.viso-systems.com/VT250516-001163)

Operator:



Beam Details

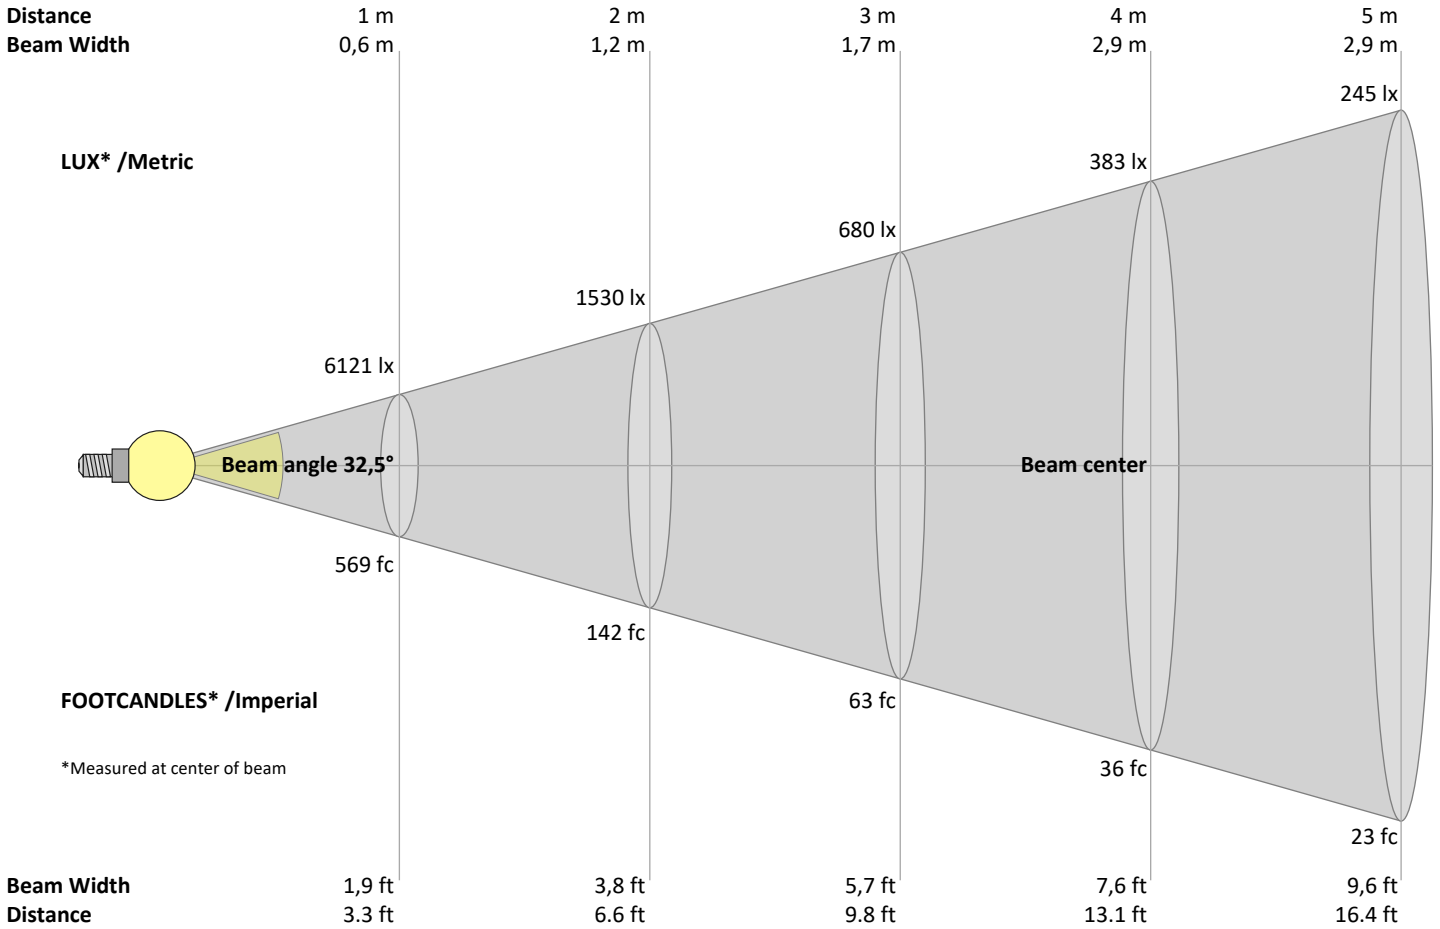

Beam intensities from 1 – 20 m

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	m
3,3	6,6	9,8	13,1	16,4	19,7	23	26,2	29,5	32,8	36,1	39,4	42,7	45,9	49,2	52,5	55,8	59,1	62,3	65,6	ft
6121	1530	680	383	245	170	125	96	76	61	51	43	36	31	27	24	21	19	17	15	lux
568,6	142,2	63,2	35,5	22,7	15,8	11,6	8,9	7	5,7	4,7	3,9	3,4	2,9	2,5	2,2	2	1,8	1,6	1,4	fc

Intensities in 0° c-plane

0°	2°	4°	6°	8°	10°	12°	14°	16°	18°	20°	22°	24°	26°	28°	30°	32°	34°	36°	38°	γ
6121	6121	5927	5571	5207	4665	4123	3610	3123	2643	2333	2022	1781	1599	1420	1303	1186	1046	888	727	cd
100%	100%	97%	91%	85%	76%	67%	59%	51%	43%	38%	33%	29%	26%	23%	21%	19%	17%	15%	12%	of 0°val

Intensities in 90° c-plane

0°	2°	4°	6°	8°	10°	12°	14°	16°	18°	20°	22°	24°	26°	28°	30°	32°	34°	36°	38°	γ
6121	6121	5927	5571	5207	4665	4123	3610	3123	2643	2333	2022	1781	1599	1420	1303	1186	1046	888	727	cd
100%	100%	97%	91%	85%	76%	67%	59%	51%	43%	38%	33%	29%	26%	23%	21%	19%	17%	15%	12%	of 0°val

Intensities in 180° c-plane

0°	2°	4°	6°	8°	10°	12°	14°	16°	18°	20°	22°	24°	26°	28°	30°	32°	34°	36°	38°	γ
6121	6121	5927	5571	5207	4665	4123	3610	3123	2643	2333	2022	1781	1599	1420	1303	1186	1046	888	727	cd
100%	100%	97%	91%	85%	76%	67%	59%	51%	43%	38%	33%	29%	26%	23%	21%	19%	17%	15%	12%	of 0°val

Intensities in 270° c-plane

0°	2°	4°	6°	8°	10°	12°	14°	16°	18°	20°	22°	24°	26°	28°	30°	32°	34°	36°	38°	γ
6121	6121	5927	5571	5207	4665	4123	3610	3123	2643	2333	2022	1781	1599	1420	1303	1186	1046	888	727	cd
100%	100%	97%	91%	85%	76%	67%	59%	51%	43%	38%	33%	29%	26%	23%	21%	19%	17%	15%	12%	of 0°val

Light Measurement Report

Print date: 16-5-2025

Measurement date and time: 16-5-2025 10:56:30 – Measurement no. VFR-250516-1292-MS

Measurement tracking No. and Link: [VT250516-001163](#)

Operator:



Light Planning – UGR table

Uncorrected, comprehensive UGR table according to 117-1995

Reflectances		70	70	50	50	30	70	70	50	50	30
	ρ Ceiling	70	70	50	50	30	70	70	50	50	30
	ρ Walls	50	30	50	30	30	50	30	50	30	30
	ρ Floor	20	20	20	20	20	20	20	20	20	20
Room size		Viewed Crosswise					Viewed Endwise				
H = mounting height above eye level		(Viewing direction orthogonal to lamp length axis)					(Viewing direction parallel to lamp length axis)				
X	Y										
2H	2H	20,8	21,5	21,0	21,7	21,9	20,8	21,5	21,0	21,7	21,9
	3H	20,7	21,4	21,1	21,6	21,8	20,7	21,4	21,1	21,6	21,8
	4H	20,7	21,4	21,1	21,6	21,9	20,7	21,4	21,1	21,6	21,9
	6H	20,8	21,4	21,0	21,7	22,0	20,8	21,4	21,0	21,7	22,0
	8H	20,7	21,3	21,0	21,6	22,0	20,7	21,3	21,0	21,6	22,0
	12H	20,7	21,3	21,0	21,6	22,0	20,7	21,3	21,0	21,6	22,0
4H	2H	20,6	21,3	20,9	21,5	21,8	20,6	21,3	20,9	21,5	21,8
	3H	20,6	21,2	21,0	21,6	22,0	20,6	21,2	21,0	21,6	22,0
	4H	20,6	21,1	21,0	21,6	22,1	20,6	21,1	21,0	21,6	22,1
	6H	20,7	21,2	21,2	21,5	21,9	20,7	21,2	21,2	21,5	21,9
	8H	20,6	21,2	21,2	21,5	21,9	20,6	21,2	21,2	21,5	21,9
	12H	20,6	21,0	21,1	21,4	21,9	20,6	21,0	21,1	21,4	21,9
8H	4H	20,6	21,1	21,1	21,4	21,8	20,6	21,1	21,1	21,4	21,8
	6H	20,7	21,0	21,2	21,5	22,0	20,7	21,0	21,2	21,5	22,0
	8H	20,7	21,0	21,2	21,5	22,1	20,7	21,0	21,2	21,5	22,1
	12H	20,7	20,9	21,3	21,4	22,0	20,7	20,9	21,3	21,4	22,0
12H	4H	20,5	20,9	21,0	21,3	21,8	20,5	20,9	21,0	21,3	21,8
	6H	20,7	20,9	21,2	21,5	22,1	20,7	20,9	21,2	21,5	22,1
	8H	20,7	20,9	21,3	21,4	22,0	20,7	20,9	21,3	21,4	22,0

Variations with the observer position for the luminaire spacings, S:

S = 1.0H	3,8 / -4,4	3,8 / -4,4
S = 1.5H	6,3 / -5,0	6,3 / -5,0
S = 2.0H	8,2 / -5,5	8,2 / -5,5

Coefficients of Utilization

Ceiling reflectance	80			70			50			30			10			0		
Wall reflectance	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
Floor reflectance	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	0
RCR	(RCR: Room Cavity Ratio)																	
	Room Values are expressed as percentage of Lumen delivered to the task surface																	
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	113	111	108	106	111	109	106	104	104	103	101	101	99	98	97	96	95	93
2	108	103	99	96	106	101	98	95	98	95	93	95	93	91	92	91	89	87
3	103	97	92	88	101	95	91	87	93	89	86	90	87	84	88	85	83	81
4	98	91	85	81	96	89	84	81	87	83	80	85	82	79	83	80	78	76
5	93	85	80	75	92	84	79	75	83	78	74	81	77	74	79	76	73	72
6	89	81	75	71	88	80	74	70	78	73	70	77	73	69	76	72	69	68
7	85	76	70	66	84	76	70	66	74	69	66	73	69	66	72	68	65	64
8	81	72	67	63	80	72	66	63	71	66	62	70	65	62	69	65	62	60
9	78	69	63	59	77	68	63	59	67	62	59	66	62	59	66	62	59	57
10	75	65	60	56	74	65	60	56	64	59	56	64	59	56	63	59	56	55

Light Measurement Report

Print date: 16-5-2025

Measurement date and time: 16-5-2025 10:56:30 – Measurement no. VFR-250516-1292-MS

Measurement tracking No. and Link: [VT250516-001163](#)


Operator:



Luminaire budgetary diagram

Uncorrected, comprehensive UGR table according to 117-1995

LAMPS (number of lamps)

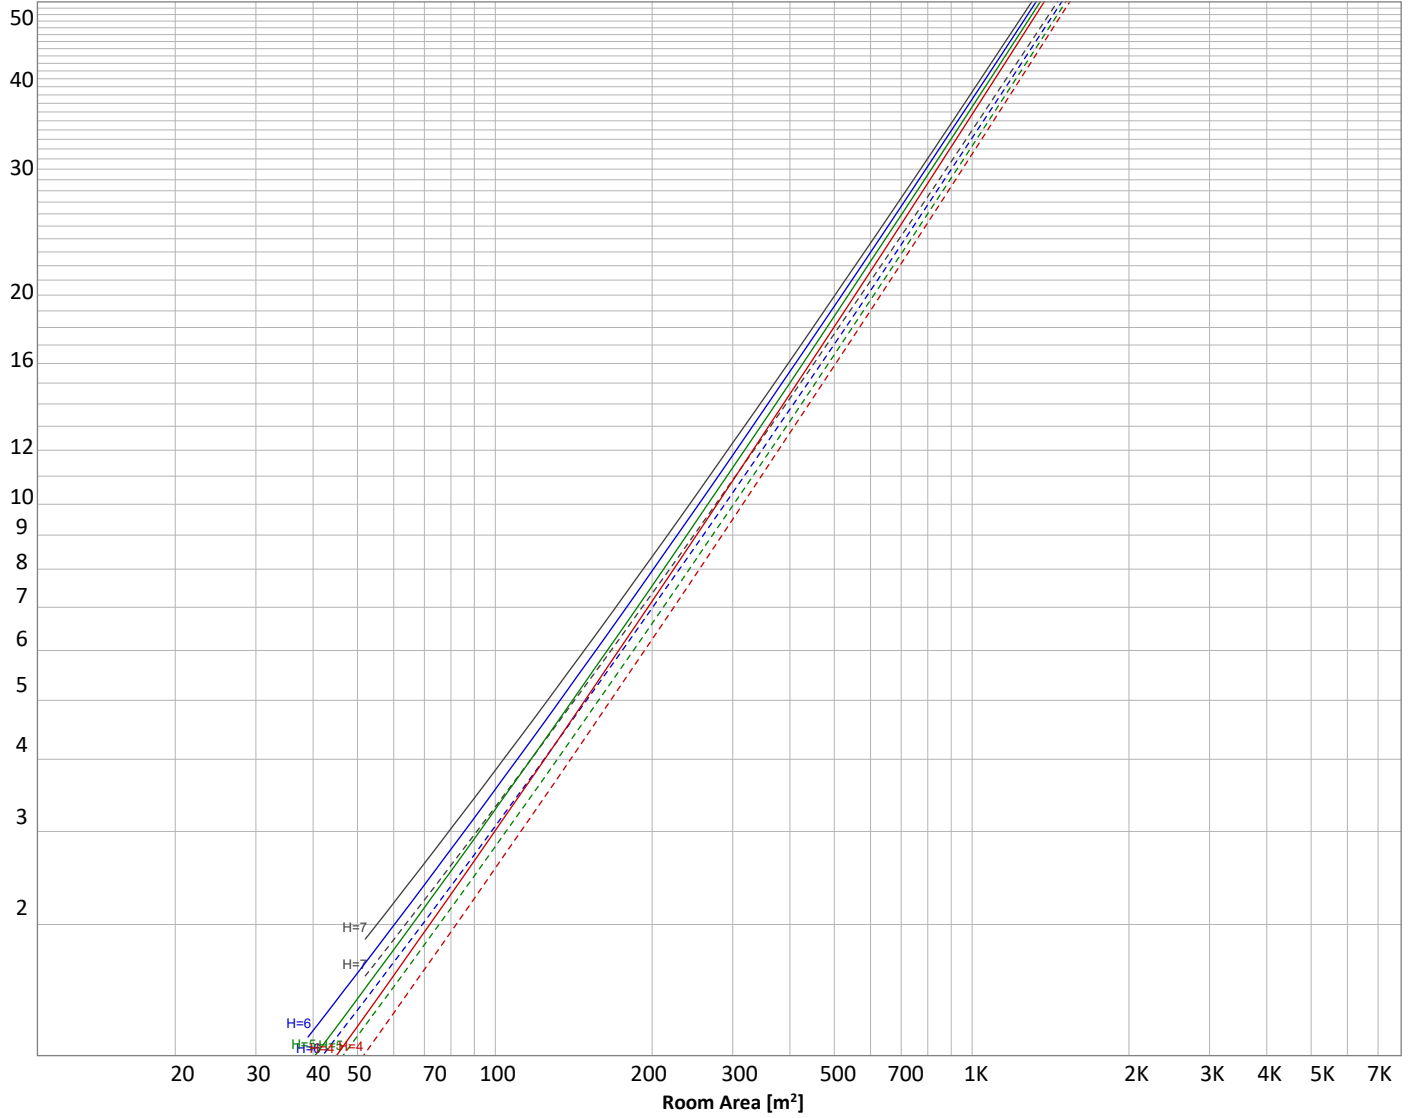

Conditions

H = Room height	Flux = 3084 lm	$\rho(\%)$			
H _{down} = Lamp distance from ceiling =	0.00 m	Line type	Ceiling reflectance	Wall reflectance	Floor reflectance
H _{work} = Work area height from floor =	0.00 m	-----	70	50	30
E _{work} = Average lux on work area =	100 lx	_____	50	30	20

Zonal Lumen Summary

0°-10°	10°-20°	20°-30°	30°-40°	40°-50°	50°-60°	60°-70°	70°-80°	80°-90°
524 lm	923 lm	776 lm	596 lm	138 lm	59,1 lm	35,1 lm	23,6 lm	6,47 lm
90°-100°	100°-110°	110°-120°	120°-130°	130°-140°	140°-150°	150°-160°	160°-170°	170°-180°
0,047 lm	0,002 lm	0,001 lm	0,015 lm	0,165 lm	0,511 lm	0,657 lm	0,586 lm	0,196 lm

Light Measurement Report

Print date: 16-5-2025

Measurement date and time: 16-5-2025 10:56:30 – Measurement no. VFR-250516-1292-MS

Measurement tracking No. and Link: [VT250516-001163](#)

Operator:



Outdoor Light Planning

Lumen per Zone

Zone (γ)	Lumen	% Total
0-10°	524 lm	17,0%
10-20°	923 lm	29,9%
20-30°	776 lm	25,2%
30-40°	596 lm	19,3%
40-50°	138 lm	4,5%
50-60°	59 lm	1,9%
60-70°	35 lm	1,1%
70-80°	24 lm	0,8%
80-90°	6 lm	0,2%
90-100°	0 lm	0,0%
100-110°	0 lm	0,0%
110-120°	0 lm	0,0%
120-130°	0 lm	0,0%
130-140°	0 lm	0,0%
140-150°	1 lm	0,0%
150-160°	1 lm	0,0%
160-170°	1 lm	0,0%
170-180°	0 lm	0,0%
Total	3084 lm	100,0%

Intensity peaks

Max intensity	6121 cd
Intensity, 90°	1 cd
Intensity, 0°	6121 cd

Zonal Lumen summary


Zone (γ)	Lumen	% Total
0-30°	2223 lm	72,1%
0-40°	2819 lm	91,4%
0-60°	3017 lm	97,8%
60-90°	65 lm	2,1%
70-100°	30 lm	1,0%
90-120°	0 lm	0,0%
0-90°	3082 lm	99,9%
90-180°	2 lm	0,1%
0-180°	3084 lm	100,0%

BUG rating

	Lumen	% Total
Forward light		
Low(0-30°)	1109 lm	35,9%
Medium(30-60°)	400 lm	13,0%
High(60-80°)	29 lm	1,0%
Very high(80-90°)	3 lm	0,1%
Back light		
Low(0-30°)	1109 lm	35,9%
Medium(30-60°)	400 lm	13,0%
High(60-80°)	29 lm	1,0%
Very high(80-90°)	3 lm	0,1%
Uplight		
Low(90-100°)	0 lm	0,0%
High(100-180°)	2 lm	0,1%

IESNA TM-15-07 Luminaire Classification System For Outdoor Luminaires

BUG rating B3 U1 G0

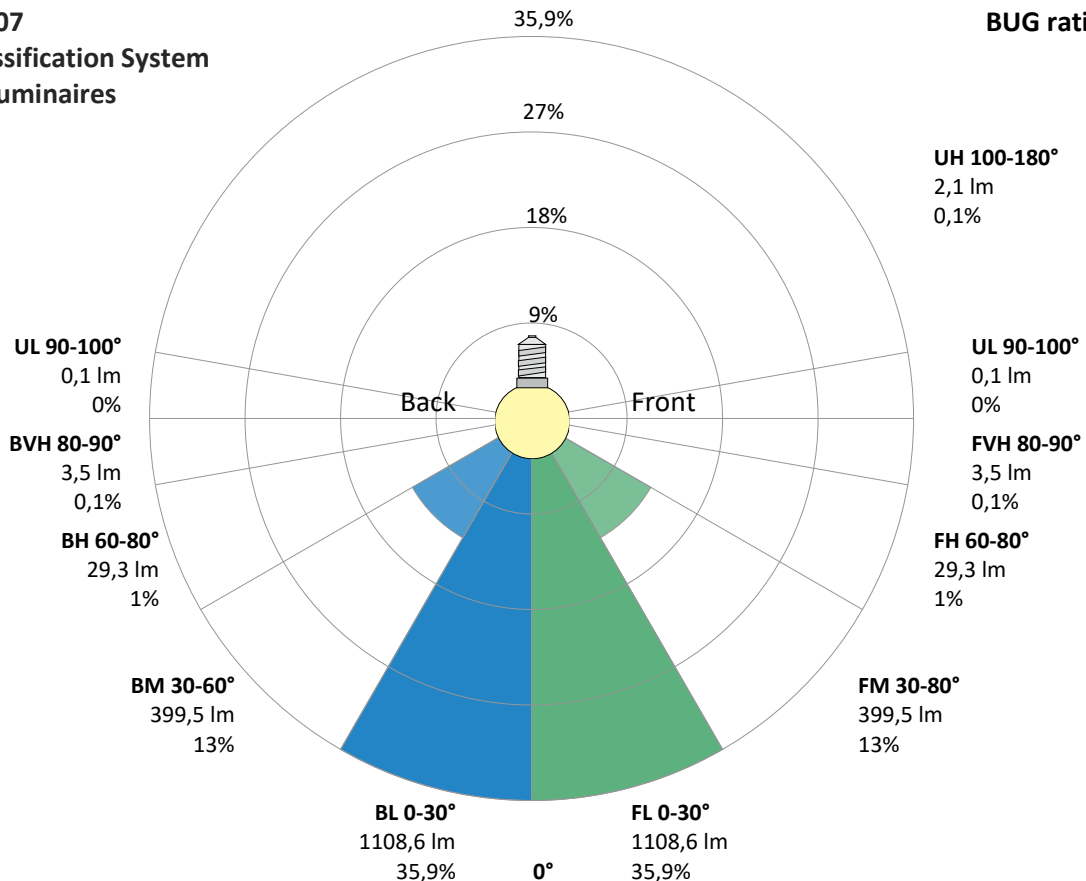

Light Measurement Report

Print date: 16-5-2025

Measurement date and time: 16-5-2025 10:56:30 – Measurement no. VFR-250516-1292-MS

Measurement tracking No. and Link: [VT250516-001163](#)

Operator:




Power Details

Input Power

Power feed to light source	40,0 W
Frequency of input power	50 Hz
RMS Input voltage feed, V_{RMS}	230 V
RMS Input current feed, I_{RMS}	0,180 A
Volt-Ampere or apparent power = $V_{RMS} * I_{RMS}$	41,32 VA
Displacement factor of AC power feed	0,99
Power factor of AC current feed	0,97
Total harmonic distortion of the current	18,75%
Total harmonic distortion of the voltage	0,07%

Input Power Curve

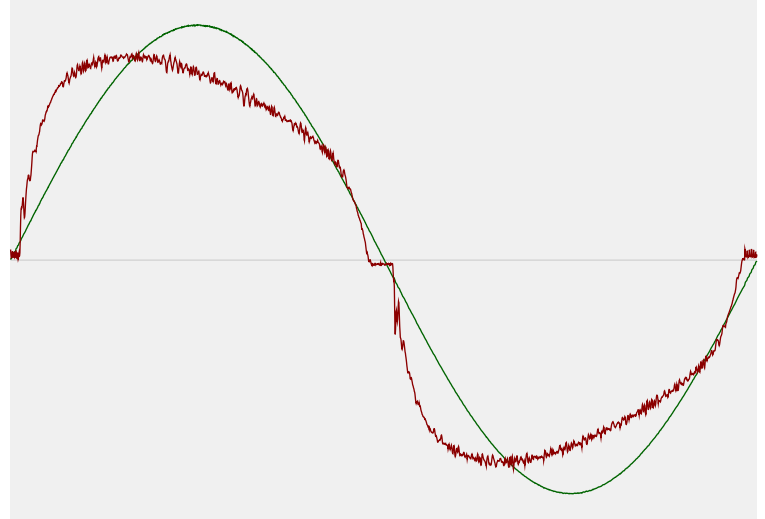

Efficiency

Radiated power efficiency	28,4%
Lumen efficiency	77 lm/W

Stabilization Details

Warmup Conditions

Stable period	15 min
Stable change max	2,0%
Minimum time	15 min

Color Temperature Change

CCT start	3015 K
CCT shift	-15 K
CCT end	3000 K


Warmup Result

Total warmup time	Lamp stabilized in 18 min 8 sec
Warmup variation	-2,8%

Output Change

Output start	3171 lm
Output change	-87 lm
Output end	3084 lm

Stabilization Curve

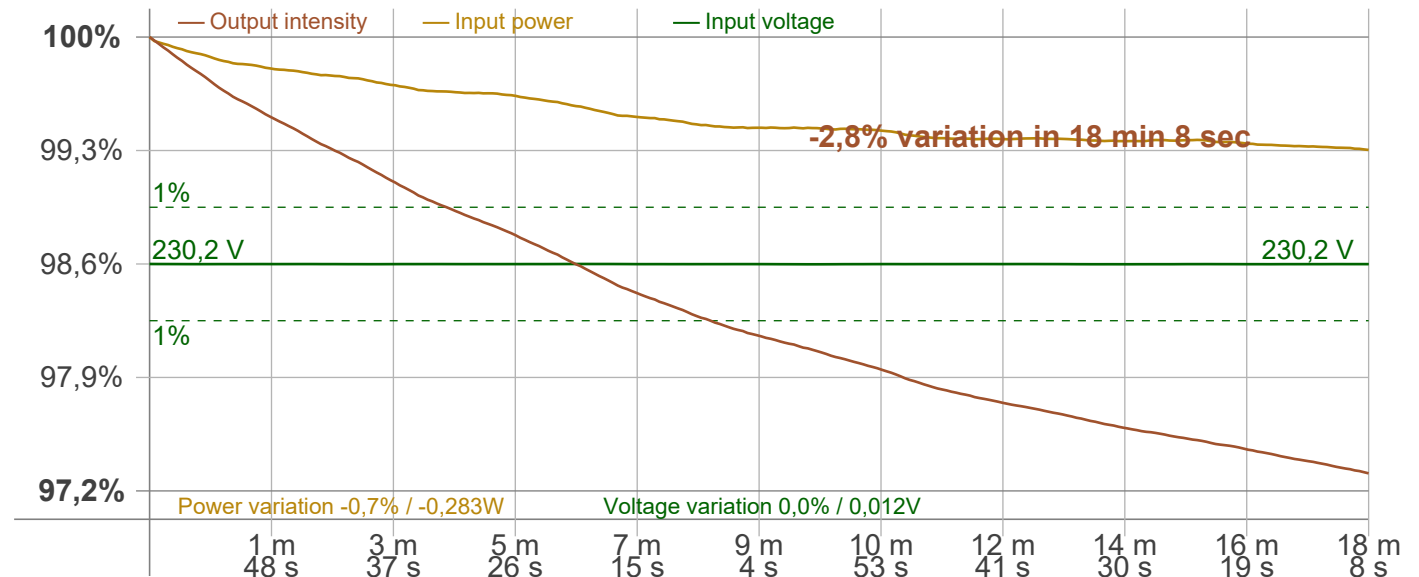

Light Measurement Report

Print date: 16-5-2025

Measurement date and time: 16-5-2025 10:56:30 – Measurement no. VFR-250516-1292-MS

Measurement tracking No. and Link: [VT250516-001163](#)

Operator:



Flicker /TLA details

Flicker Meter Type: Viso Systems LabFlicker
 Frequency of input power: 50 Hz
 Flicker/TLA sample rate: 20000 samples/s

Measurement time
 PstLM: 180 sec
 All other indices: 1,2 sec

Flicker indices according to Illuminating Engineering Society (IES)

Flicker frequency: 98,04 Hz
 Percent Flicker: 1,04 %
 Flicker index: 0

Flicker indices according to California Energy Commission (CEC) 2016b

JA8/10 40 Hz: 0,28 %
 JA8/10 90 Hz: 0,29 %
 JA8/10 200 Hz: 1,03 %
 JA8/10 400 Hz: 1,03 %
 JA8/10 1000 Hz: 1,03 %


TLA indices (re IEC TR 61547-1, IEC 61000-3-3 and IEC 61000-4-15)

PstLM value (F < 80 Hz): 0,36
 SVM value (80 < F < 2000 Hz): 0,03

Flicker indices according to Lighting Research Center (2015)

Perception metric, Assist Mp: 0,21

Flicker frame (frame of one flicker period in time domain)

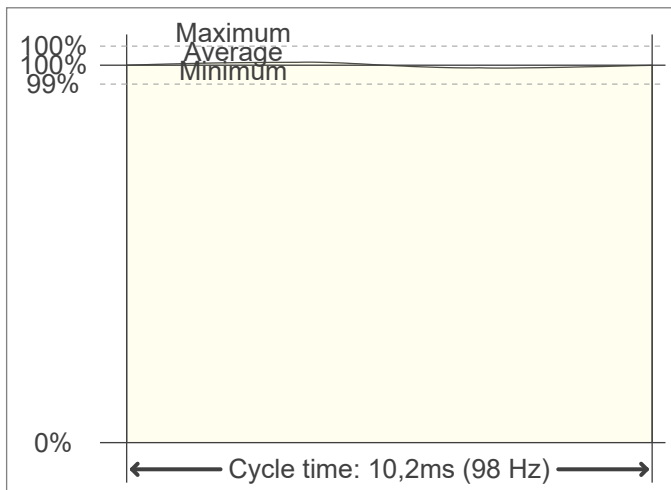

Flicker FFT (flicker curve in frequency domain)



IEEE 1789 Frequency/modulation plot

