

Light Measurement Report

Print date: 5-9-2025

Measurement date and time: 5-9-2025 09:16:08 – Measurement no. VFR-250905-2960-MS

Measurement tracking No. and Link: [VT250905-007355](https://www.viso-systems.com/track/VT250905-007355)

Operator:



Laboratory and Equipment

Laboratory Owner and Location
Goniospectrometer System and Type
Sensor Name, Calibr. Date and Serial No.
Spectrometer Manufacturer and Model

Viso Systems, Copenhagen V, Denmark
LabSpion – Type C, horizontal
LabSensor Model2 – 11-1-2024 – 3130191315
Ibsen Photonics, Denmark – Freedom VIS (Custom Viso)

Measurement Conditions

Number of C-planes and Resolution
 γ (gamma)-Resolution
Test Distance
Input Power, Power and Displ. Factors
Input RMS Voltage and Current
Frequency of Input Power
Warm-up Time and Variation

12 planes – 30°
5°
12,09 m
72,0 W – PF 0,98 – DPF 0,98
230 V – 0,319 A
50 Hz
Lamp stabilized in 15 min 1 sec – 2,0%

Tested Light Source



Product Name
Item No. and Manufacturer
Product Description (line 1)

813710-6500K
813710-6500K – Dutchfulfillment
LICHTLIJN MODULE | TITAN | 65-80W | 90° | CCT-SWITCH

Main Light Measurement Results

Output – Total Lumen (Up% / Down%)
Efficiency
Peak Intensity and Beam Angle
Correlated Color Temperature, Target/Measured
Color Rendering Index
Color Rendering TM30-18
Color Shift, CIE duv and MacAdam Steps
Flicker

12415 lm – 2,38% / 97,62%
172 lm/W
6707 cd – 82,4°
CCT = 6500 K / 6378 K
CRI 82,8
 R_f 83,0 – R_g 96,2
Duv 0,0091 – SDCM 12,2
SVM 0,01 – PstLM 0,02

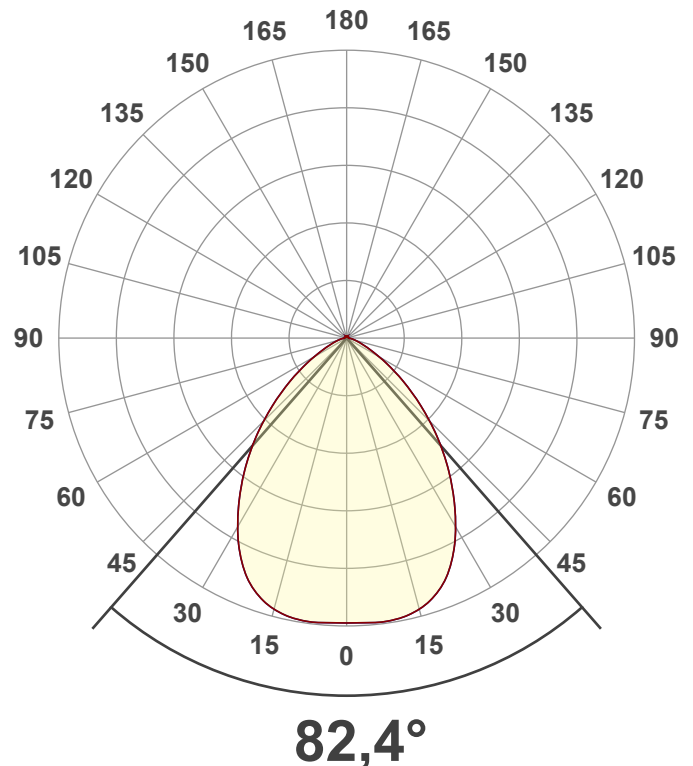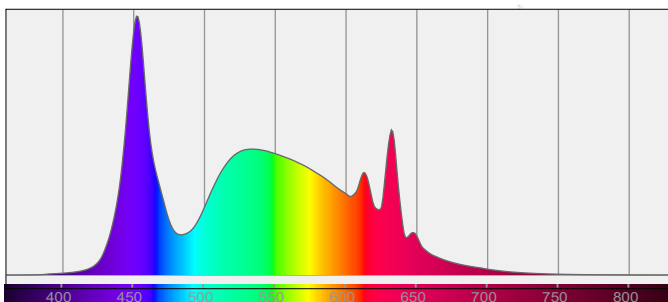

Light Measurement Report

Print date: 5-9-2025

Measurement date and time: 5-9-2025 09:16:08 – Measurement no. VFR-250905-2960-MS


Measurement tracking No. and Link: [VT250905-007355](#)

Operator:



Luminous Intensity diagram

Unit: 0-100% of peak intensity

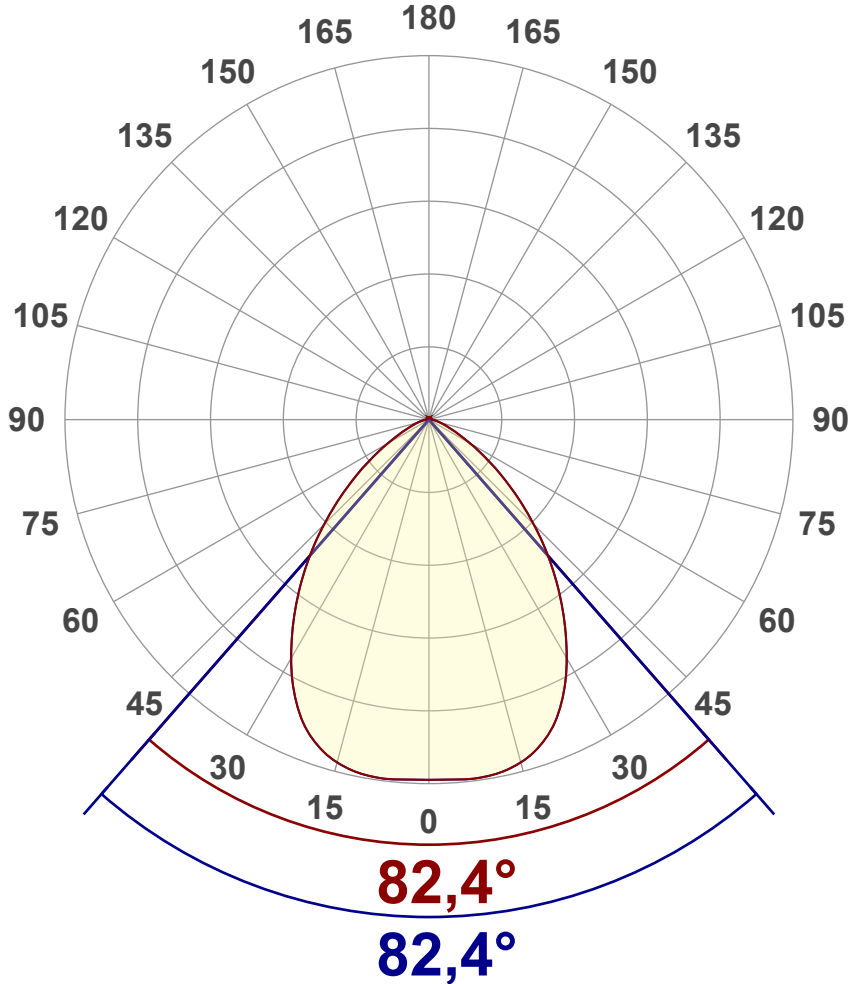

Main Values

Output (total Lumen)	12415 lm
Lumen Up% / Down%	2,38% / 97,62%
Peak Intensity	6707 cd
Beam Angle (50%)	82,4°
Beam Angle (90%)	82,4°
Beam Angle (10%)	82,4°

Cut-off Angle

Average 2,5%	156,3°
--------------	--------

Field Angle

Average 10%	125,7°
-------------	--------


Intensity Ratio

In 120° cone	90,5%
In 90° cone	72,7%

C000-C180

C090-C270

Linear distribution diagram - Intensity (candela) vs γ -angle

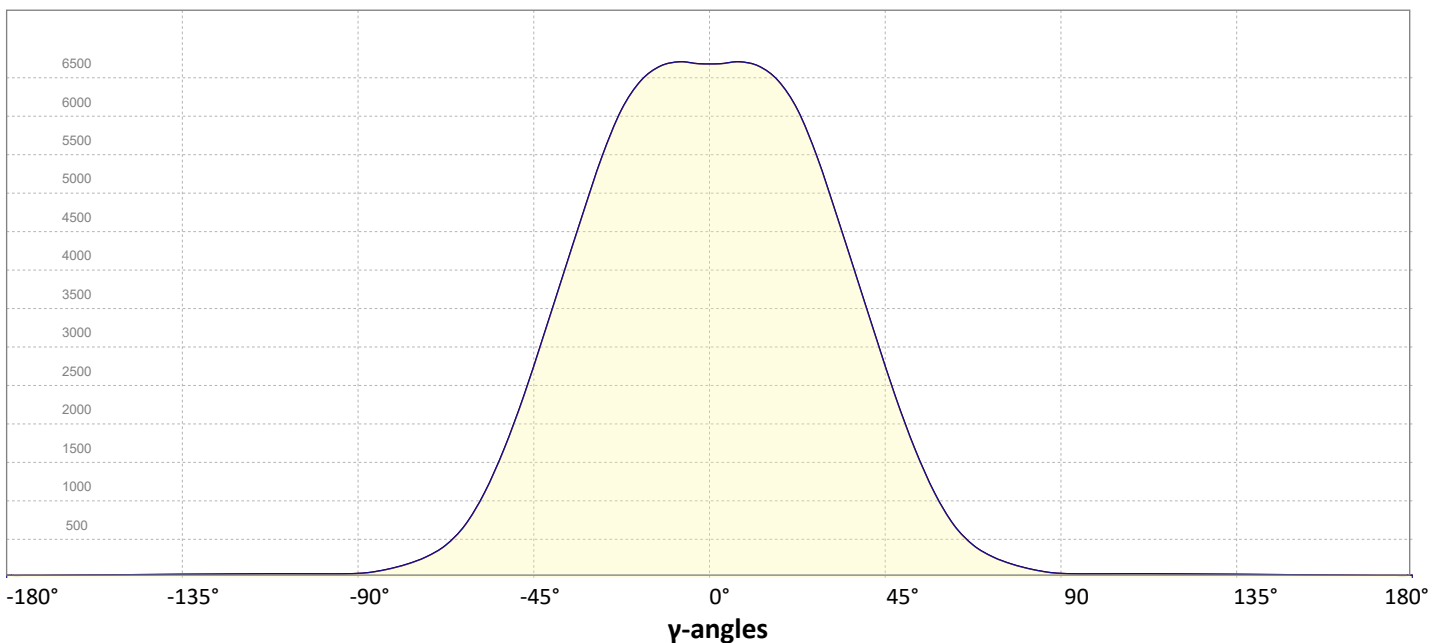

Light Measurement Report

Print date: 5-9-2025


Measurement date and time: 5-9-2025 09:16:08 – Measurement no. VFR-250905-2960-MS

Measurement tracking No. and Link: [VT250905-007355](https://www.viso-systems.com/VT250905-007355)

Operator:



Iso-intensity Diagram (Iso-candela)

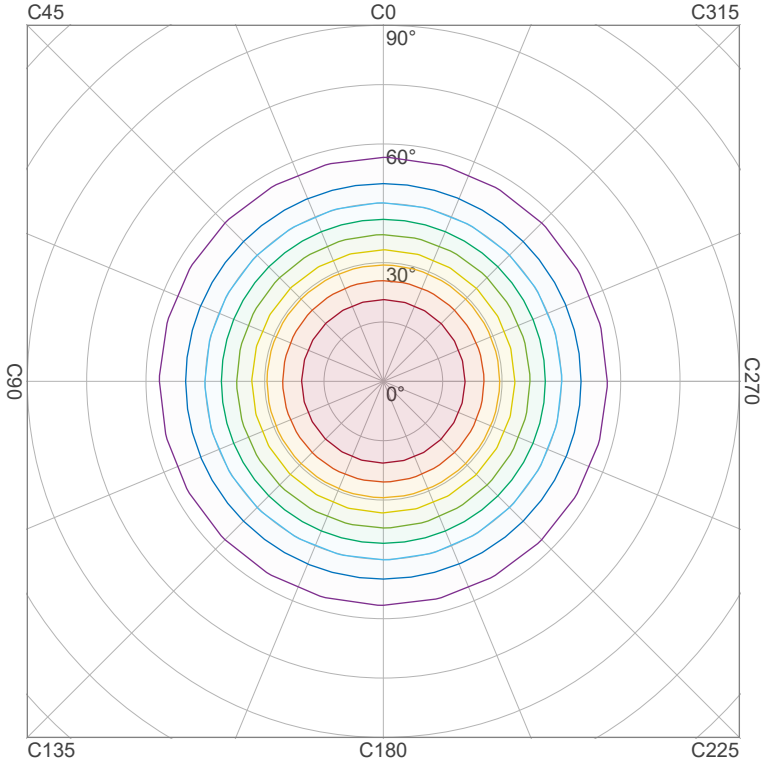


90 %	6033,8 cd
80 %	5363,4 cd
70 %	4693,0 cd
60 %	4022,5 cd
50 %	3352,1 cd
40 %	2681,7 cd
30 %	2011,3 cd
20 %	1340,8 cd
10 %	670,4 cd

Peak intensity: 6704,2 cd

Number of c-planes: 12

Iso-illuminance Diagram (Iso-lux)

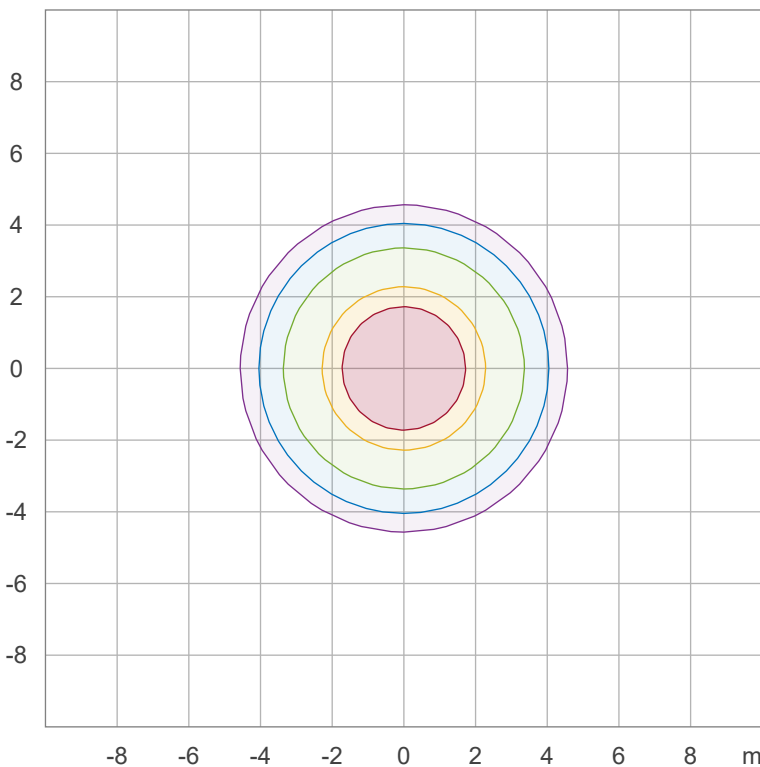

50,0 %	371,2 lx
30,0 %	222,7 lx
10,0 %	74,2 lx
5,0 %	37,1 lx
3,0 %	22,3 lx

Peak illuminance: 742,4 lx

Mounting height: 3,0 m

Number of c-planes: 12

Light Measurement Report

Print date: 5-9-2025

Measurement date and time: 5-9-2025 09:16:08 – Measurement no. VFR-250905-2960-MS

Measurement tracking No. and Link: [VT250905-007355](https://www.viso-systems.com/VT250905-007355)

Operator:




Color details


Correlated Color Temperature, Target CCT = 6500 K
 Correlated Color Temperature, Measured CCT = 6378 K
 Color Rendering Index CRI 82,8
 Color Rendering Index, R9 (red component) R9 = 31,2
 Color Rendering TM30-18 R_f 83,0 – R_g 96,2
 Color Quality Scale CQS = 82,8

MacAdam Steps
 Color coordinates CIE 1931 (x;y) = (0,314;0,324)
 Color coordinate CIEs 1960 (u;v) = (0,200;0,310)
 Color deviation from BBL Duv = 0,0091
 Color coordinate CIEs 1976 (CIELUV) (u';v') = (0,200;0,466)


CIE 1931

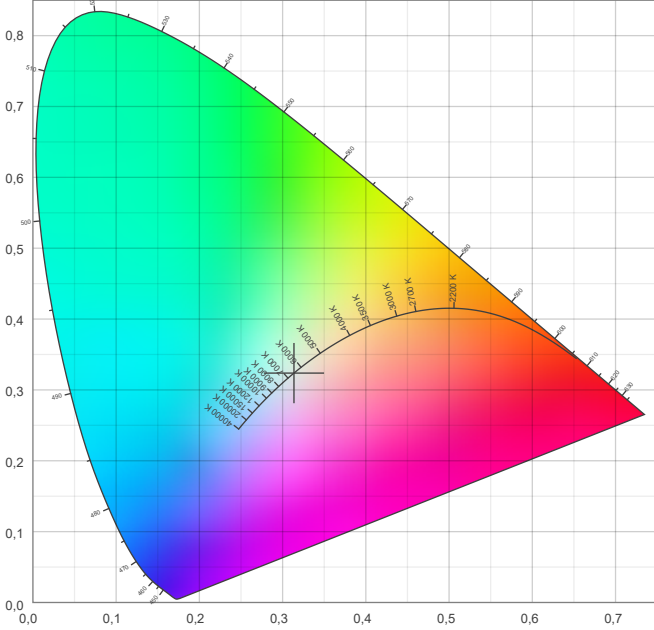

CIE 1931 – zoomed on Planckian locus

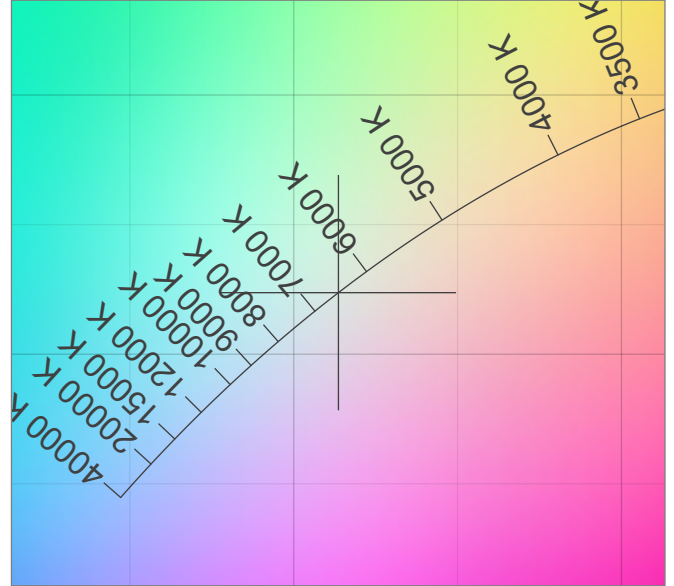


Color Rendering Index per reference color (CIE 1995)

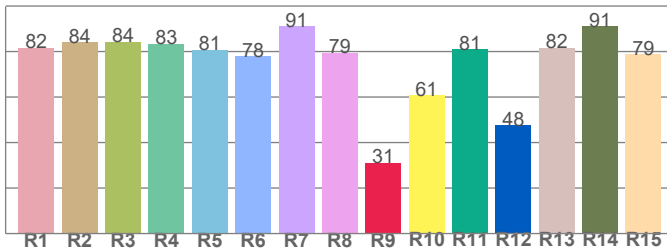


CRI R values, only R1-R8 are used to calculate final CRI value

R1	R2	R3	R4	R5	R6	R7	R8	R9	R10	R11	R12	R13	R14	R15
81,6	84,1	84,3	83,4	80,7	78,1	91,2	79,4	31,2	60,9	80,9	47,7	81,7	91,2	78,9

Spectral power distribution (SPD) / W/nm – 0-100%

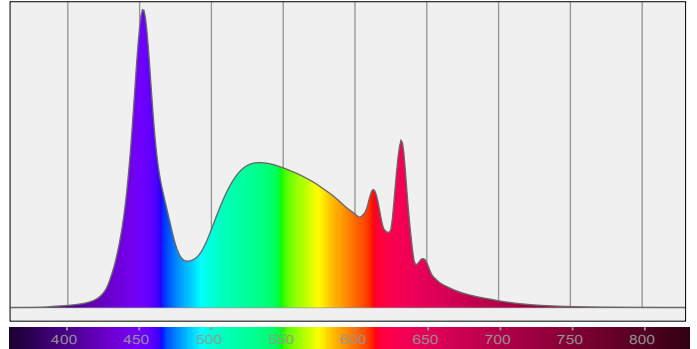


TM30-18 R_f-values per hue bin

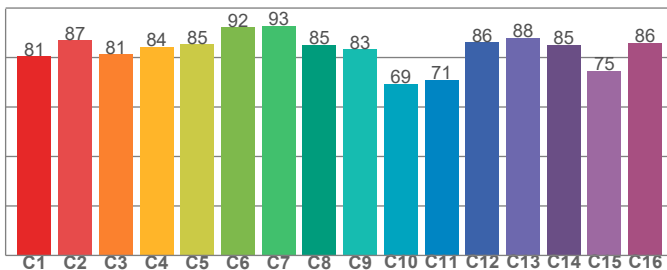

TM30 C values, 16 binned values out of total of 99 C values

C1	C2	C3	C4	C5	C6	C7	C8	C9	C10	C11	C12	C13	C14	C15	C16
80,5	87,1	81,4	84,3	85,4	92,2	92,8	85,2	83,4	69,4	71,1	86,1	88,0	85,2	74,7	86,0

Color Quality Scale by reference color

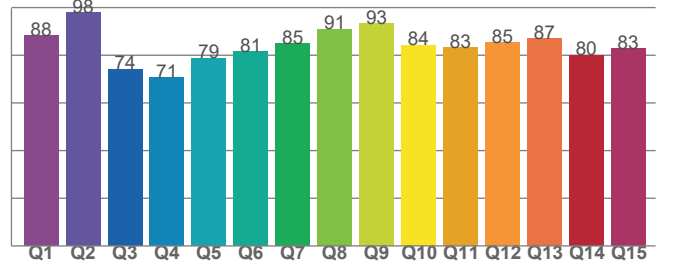

CQS Q values

Q1	Q2	Q3	Q4	Q5	Q6	Q7	Q8	Q9	Q10	Q11	Q12	Q13	Q14	Q15
88,2	97,8	74,1	70,6	78,7	81,5	84,8	90,9	93,2	84,3	83,2	85,3	86,9	79,9	82,8

Light Measurement Report

Print date: 5-9-2025


Measurement date and time: 5-9-2025 09:16:08 – Measurement no. VFR-250905-2960-MS

Measurement tracking No. and Link: [VT250905-007355](https://www.viso-systems.com/VT250905-007355)

Operator:



Beam Details

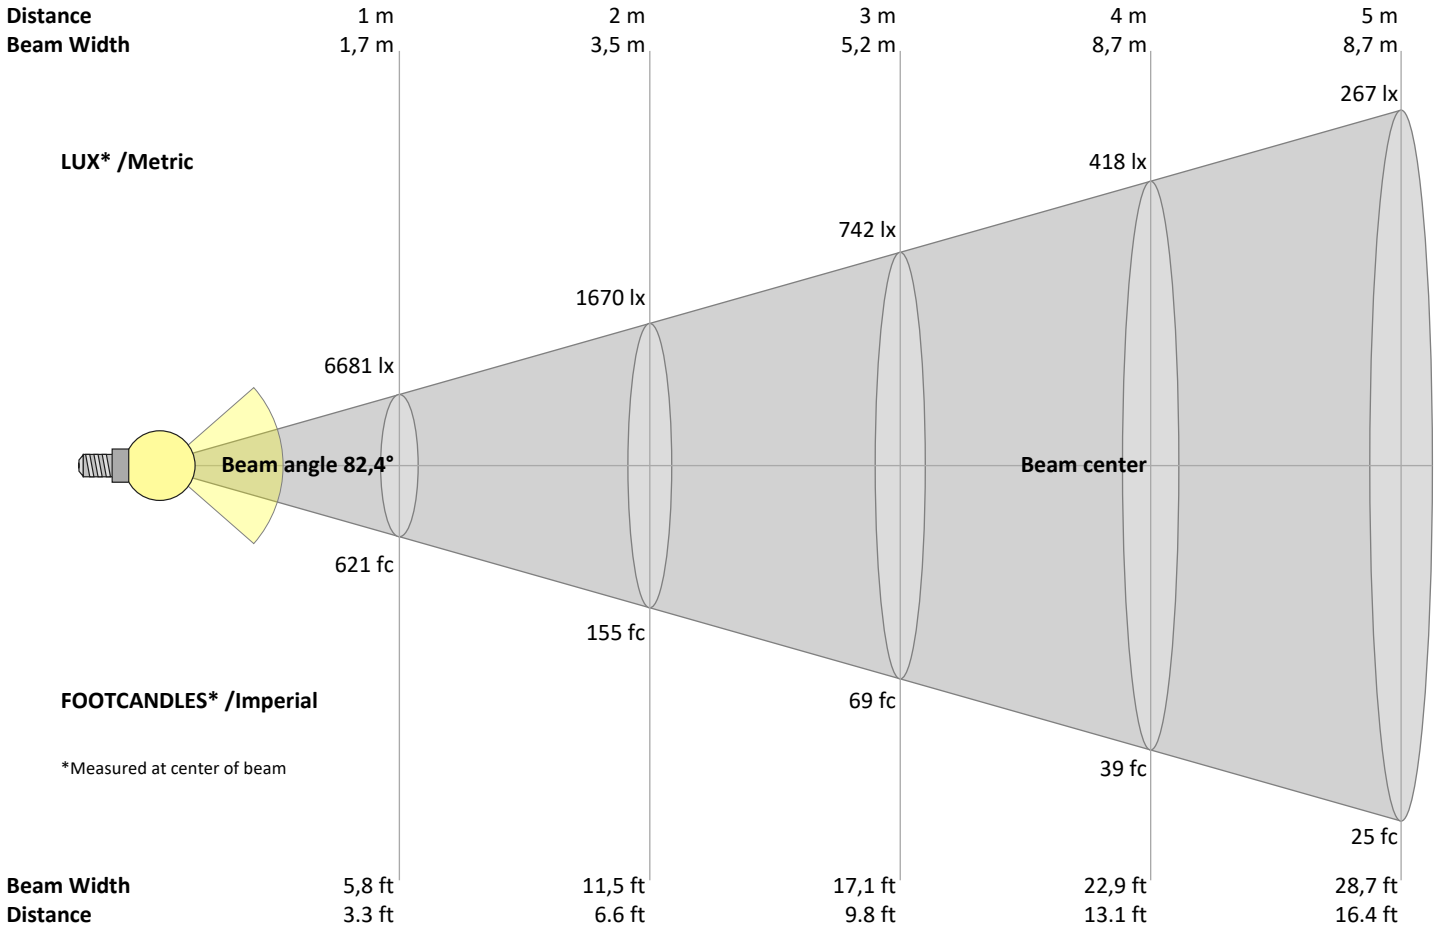

Beam intensities from 1 – 20 m

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	m
3,3	6,6	9,8	13,1	16,4	19,7	23	26,2	29,5	32,8	36,1	39,4	42,7	45,9	49,2	52,5	55,8	59,1	62,3	65,6	ft
6681	1670	742	418	267	186	136	104	82	67	55	46	40	34	30	26	23	21	19	17	lux
620,7	155,2	69	38,8	24,8	17,2	12,7	9,7	7,7	6,2	5,1	4,3	3,7	3,2	2,8	2,4	2,1	1,9	1,7	1,6	fc

Intensities in 0° c-plane

0°	5°	10°	15°	20°	25°	30°	35°	40°	45°	50°	55°	60°	65°	70°	75°	80°	85°	90°	95°	γ
6681	6694	6680	6560	6277	5783	5100	4328	3539	2758	2029	1402	904	558	349	224	143	88	59	51	cd
100%	100%	100%	98%	94%	87%	76%	65%	53%	41%	30%	21%	14%	8%	5%	3%	2%	1%	1%	1%	of 0°val

Intensities in 90° c-plane

0°	5°	10°	15°	20°	25°	30°	35°	40°	45°	50°	55°	60°	65°	70°	75°	80°	85°	90°	95°	γ
6681	6694	6680	6560	6277	5783	5100	4328	3539	2758	2029	1402	904	558	349	224	143	88	59	51	cd
100%	100%	100%	98%	94%	87%	76%	65%	53%	41%	30%	21%	14%	8%	5%	3%	2%	1%	1%	1%	of 0°val

Intensities in 180° c-plane

0°	5°	10°	15°	20°	25°	30°	35°	40°	45°	50°	55°	60°	65°	70°	75°	80°	85°	90°	95°	γ
6681	6694	6680	6560	6277	5783	5100	4328	3539	2758	2029	1402	904	558	349	224	143	88	59	51	cd
100%	100%	100%	98%	94%	87%	76%	65%	53%	41%	30%	21%	14%	8%	5%	3%	2%	1%	1%	1%	of 0°val

Intensities in 270° c-plane

0°	5°	10°	15°	20°	25°	30°	35°	40°	45°	50°	55°	60°	65°	70°	75°	80°	85°	90°	95°	γ
6681	6694	6680	6560	6277	5783	5100	4328	3539	2758	2029	1402	904	558	349	224	143	88	59	51	cd
100%	100%	100%	98%	94%	87%	76%	65%	53%	41%	30%	21%	14%	8%	5%	3%	2%	1%	1%	1%	of 0°val

Light Measurement Report

Print date: 5-9-2025

Measurement date and time: 5-9-2025 09:16:08 – Measurement no. VFR-250905-2960-MS

Measurement tracking No. and Link: [VT250905-007355](https://www.viso-systems.com/VT250905-007355)

Operator:



Light Planning – UGR table

Uncorrected, comprehensive UGR table according to 117-1995

Reflectances		70	70	50	50	30	70	70	50	50	30
	ρ Ceiling	70	70	50	50	30	70	70	50	50	30
	ρ Walls	50	30	50	30	30	50	30	50	30	30
	ρ Floor	20	20	20	20	20	20	20	20	20	20
Room size		Viewed Crosswise					Viewed Endwise				
H = mounting height above eye level		(Viewing direction orthogonal to lamp length axis)					(Viewing direction parallel to lamp length axis)				
X	Y										
2H	2H	24,5	25,4	24,7	25,7	26,0	24,8	25,7	25,0	26,0	26,3
	3H	24,6	25,6	25,0	25,9	26,1	25,0	26,0	25,4	26,3	26,5
	4H	24,7	25,6	25,1	25,9	26,2	25,1	26,0	25,5	26,3	26,6
	6H	24,8	25,6	25,1	25,9	26,3	25,2	26,0	25,6	26,4	26,8
	8H	24,8	25,6	25,1	25,9	26,4	25,2	26,0	25,6	26,4	26,8
	12H	24,7	25,5	25,1	25,9	26,4	25,2	26,0	25,6	26,4	26,9
4H	2H	24,5	25,5	24,9	25,8	26,0	24,8	25,7	25,2	26,0	26,3
	3H	24,9	25,7	25,3	26,0	26,5	25,2	26,0	25,6	26,4	26,9
	4H	24,9	25,7	25,4	26,1	26,7	25,3	26,1	25,8	26,5	27,0
	6H	25,0	25,7	25,6	26,1	26,5	25,5	26,2	26,0	26,5	26,9
	8H	25,1	25,7	25,6	26,1	26,5	25,5	26,2	26,1	26,6	27,0
	12H	25,1	25,6	25,6	26,0	26,5	25,6	26,1	26,1	26,6	27,1
8H	4H	24,9	25,6	25,5	26,0	26,4	25,3	25,9	25,8	26,3	26,7
	6H	25,1	25,6	25,6	26,1	26,6	25,5	26,0	26,1	26,5	27,1
	8H	25,2	25,6	25,7	26,1	26,8	25,7	26,1	26,2	26,6	27,3
	12H	25,2	25,6	25,9	26,1	26,8	25,8	26,1	26,4	26,7	27,3
12H	4H	24,9	25,4	25,4	25,9	26,4	25,3	25,8	25,8	26,2	26,7
	6H	25,1	25,5	25,7	26,1	26,7	25,5	25,9	26,1	26,5	27,2
	8H	25,2	25,5	25,8	26,1	26,7	25,7	26,0	26,3	26,5	27,2

Variations with the observer position for the luminaire spacings, S:

S = 1.0H	0,4 / -0,9	0,4 / -0,7
S = 1.5H	1,4 / -2,0	1,3 / -1,8
S = 2.0H	2,7 / -3,1	2,6 / -2,8

Coefficients of Utilization

Ceiling reflectance	80			70			50			30			10			0		
Wall reflectance	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
Floor reflectance	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	0
RCR	(RCR: Room Cavity Ratio) Room Values are expressed as percentage of Lumen delivered to the task surface																	
0	118	118	118	118	115	115	115	115	110	110	105	105	105	100	100	100	98	
1	111	107	104	101	108	105	102	99	100	97	95	96	94	92	92	90	89	87
2	103	96	91	86	100	94	89	85	91	86	83	87	84	81	84	81	79	77
3	95	87	80	75	93	85	79	74	82	77	73	79	75	71	76	73	70	68
4	89	79	72	66	86	77	71	65	75	69	64	72	67	63	70	66	62	60
5	83	72	64	59	81	71	63	58	68	62	57	66	61	57	64	60	56	54
6	77	66	58	52	75	65	57	52	63	56	52	61	55	51	59	54	50	49
7	72	60	53	47	70	59	52	47	58	51	47	56	50	46	55	50	46	44
8	68	56	48	43	66	55	48	43	53	47	42	52	46	42	51	46	42	40
9	63	51	44	39	62	51	44	39	50	43	39	48	43	39	47	42	38	37
10	60	48	41	36	58	47	40	36	46	40	36	45	39	35	44	39	35	34

Light Measurement Report

Print date: 5-9-2025

Measurement date and time: 5-9-2025 09:16:08 – Measurement no. VFR-250905-2960-MS

Measurement tracking No. and Link: [VT250905-007355](https://www.viso-systems.com/VT250905-007355)


Operator:



Luminaire budgetary diagram

Uncorrected, comprehensive UGR table according to 117-1995

LAMPS (number of lamps)

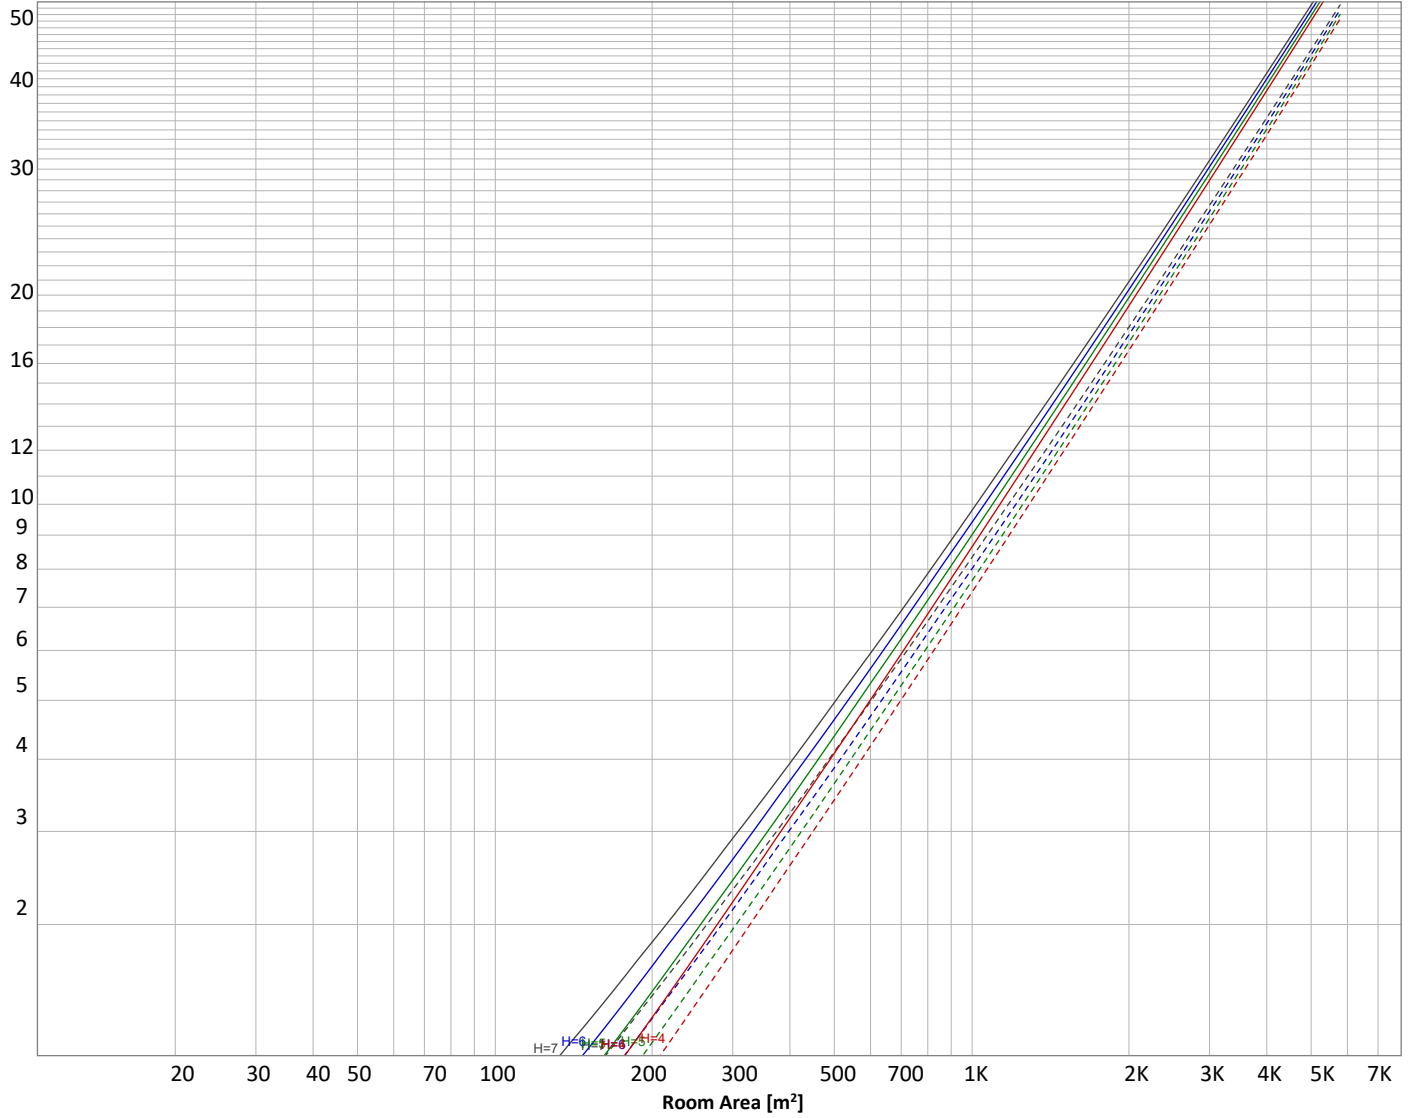

Conditions

H = Room height	Flux = 12415 lm			
H _{down} = Lamp distance from ceiling =	0.00 m	Line type	Ceiling reflectance	ρ(%)
H _{work} = Work area height from floor =	0.00 m	-----	70	Wall reflectance
E _{work} = Average lux on work area =	100 lx	_____	50	30
				Floor reflectance
				20

Zonal Lumen Summary

0°-10°	10°-20°	20°-30°	30°-40°	40°-50°	50°-60°	60°-70°	70°-80°	80°-90°
640 lm	1855 lm	2662 lm	2703 lm	2123 lm	1250 lm	553 lm	237 lm	96,5 lm
90°-100°	100°-110°	110°-120°	120°-130°	130°-140°	140°-150°	150°-160°	160°-170°	170°-180°
56,0 lm	54,3 lm	50,7 lm	43,3 lm	35,3 lm	26,2 lm	17,3 lm	9,73 lm	3,04 lm

Light Measurement Report

Print date: 5-9-2025

Measurement date and time: 5-9-2025 09:16:08 – Measurement no. VFR-250905-2960-MS

Measurement tracking No. and Link: [VT250905-007355](#)

Operator:



Outdoor Light Planning

Lumen per Zone

Zone (γ)	Lumen	% Total
0-10°	{LUM00-10} lm	#VALUE!
10-20°	{LUM10-20} lm	#VALUE!
20-30°	{LUM20-30} lm	#VALUE!
30-40°	{LUM30-40} lm	#VALUE!
40-50°	{LUM40-50} lm	#VALUE!
50-60°	{LUM50-60} lm	#VALUE!
60-70°	{LUM60-70} lm	#VALUE!
70-80°	{LUM70-80} lm	#VALUE!
80-90°	{LUM80-90} lm	#VALUE!
90-100°	{LUM90-100} lm	#VALUE!
100-110°	{LUM100-110} lm	#VALUE!
110-120°	{LUM110-120} lm	#VALUE!
120-130°	{LUM120-130} lm	#VALUE!
130-140°	{LUM130-140} lm	#VALUE!
140-150°	{LUM140-150} lm	#VALUE!
150-160°	{LUM150-160} lm	#VALUE!
160-170°	{LUM160-170} lm	#VALUE!
170-180°	{LUM170-180} lm	#VALUE!
Total	0 lm	#VALUE!

Intensity peaks

Max intensity	{PEAK} cd
Intensity, 90°	{INT90} cd
Intensity, 0°	{INT0} cd

Zonal Lumen summary

Zone (γ)	Lumen	% Total
0-30°	{LUM00-30} lm	#VALUE!
0-40°	{LUM00-40} lm	#VALUE!
0-60°	{LUM00-60} lm	#VALUE!
60-90°	{LUM60-90} lm	#VALUE!
70-100°	{LUM70-100} lm	#VALUE!
90-120°	{LUM90-120} lm	#VALUE!
0-90°	{LUM00-90} lm	#VALUE!
90-180°	{LUM90-180} lm	#VALUE!
0-180°	{LUM00-180} lm	#VALUE!

BUG rating

	Lumen	% Total
Forward light		
Low(0-30°)	{BUG0} lm	#VALUE!
Medium(30-60°)	{BUG1} lm	#VALUE!
High(60-80°)	{BUG2} lm	#VALUE!
Very high(80-90°)	{BUG3} lm	#VALUE!

Back light


Low(0-30°)	{BUG4} lm	#VALUE!
Medium(30-60°)	{BUG5} lm	#VALUE!
High(60-80°)	{BUG6} lm	#VALUE!
Very high(80-90°)	{BUG7} lm	#VALUE!

Uplight

Low(90-100°)	{BUG8} lm	#VALUE!
High(100-180°)	{BUG9} lm	#VALUE!

IESNA TM-15-07 Luminaire Classification System For Outdoor Luminaires

BUG rating B4 U3 G1

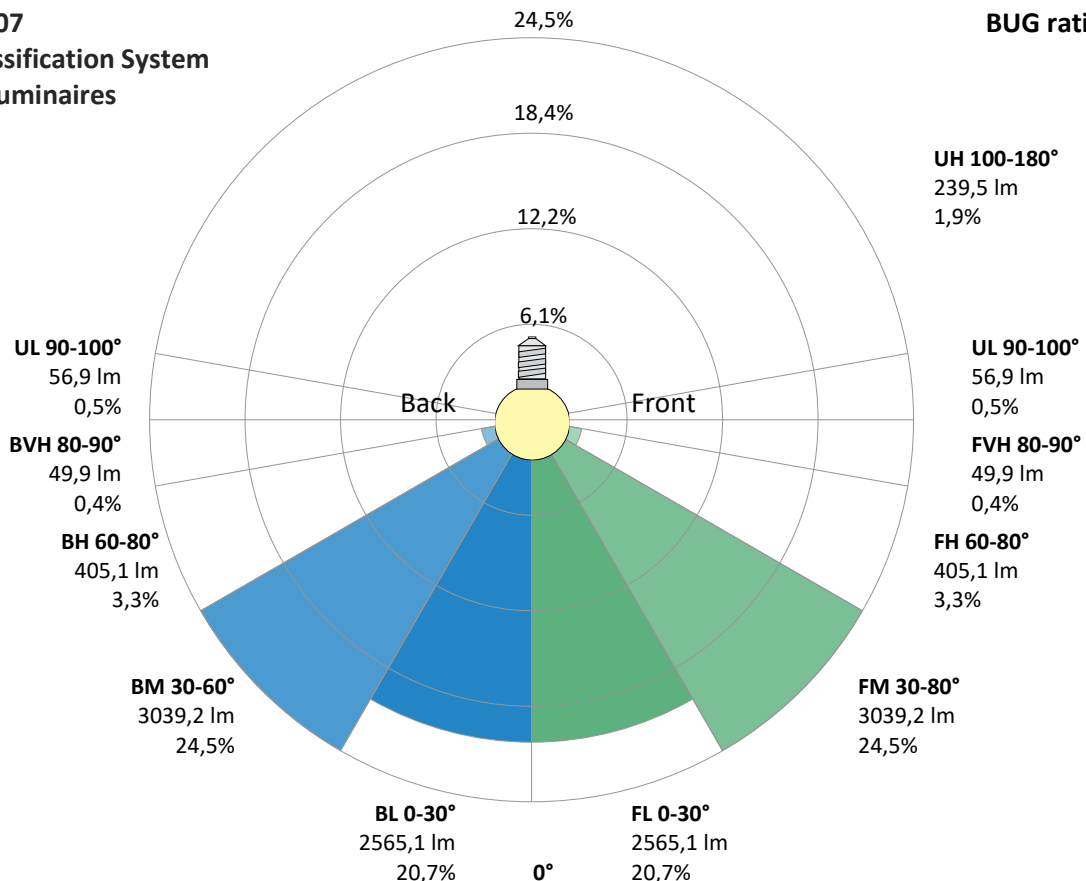

Light Measurement Report

Print date: 5-9-2025

Measurement date and time: 5-9-2025 09:16:08 – Measurement no. VFR-250905-2960-MS

Measurement tracking No. and Link: [VT250905-007355](https://www.viso-systems.com/VT250905-007355)

Operator:




Power Details


Input Power

Power feed to light source	72,0 W
Frequency of input power	50 Hz
RMS Input voltage feed, V_{RMS}	230 V
RMS Input current feed, I_{RMS}	0,319 A
Volt-Ampere or apparent power = $V_{RMS} * I_{RMS}$	73,35 VA
Displacement factor of AC power feed	0,98
Power factor of AC current feed	0,98
Total harmonic distortion of the current	6,14%
Total harmonic distortion of the voltage	0,06%

Input Power Curve

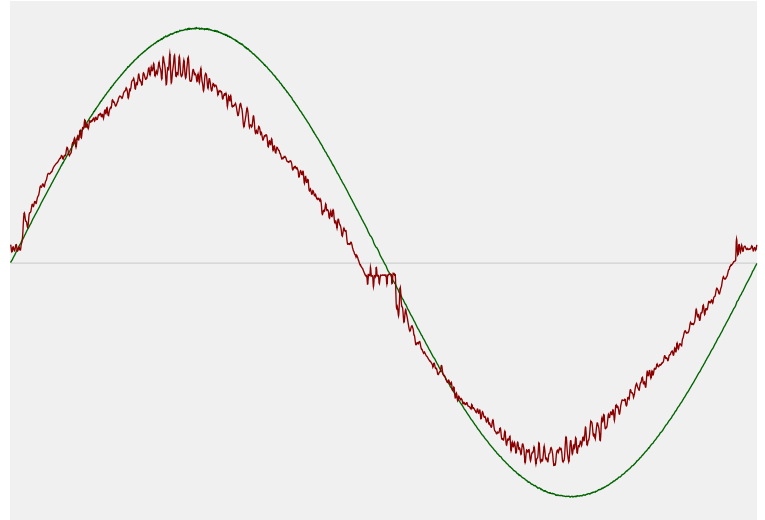

Efficiency

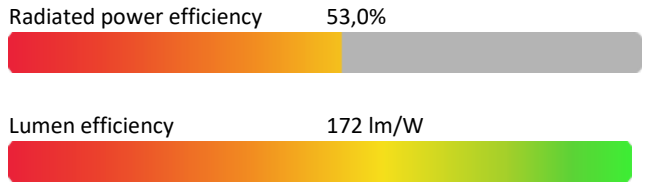

Stabilization Details

Warmup Conditions

Stable period	15 min
Stable change max	2,0%
Minimum time	15 min

Color Temperature Change

CCT start	6500 K
CCT shift	+0 K
CCT end	6500 K


Warmup Result

Total warmup time	Lamp stabilized in 15 min 1 sec
Warmup variation	-0,2%

Output Change

Output start	12431 lm
Output change	-16 lm
Output end	12415 lm

Stabilization Curve

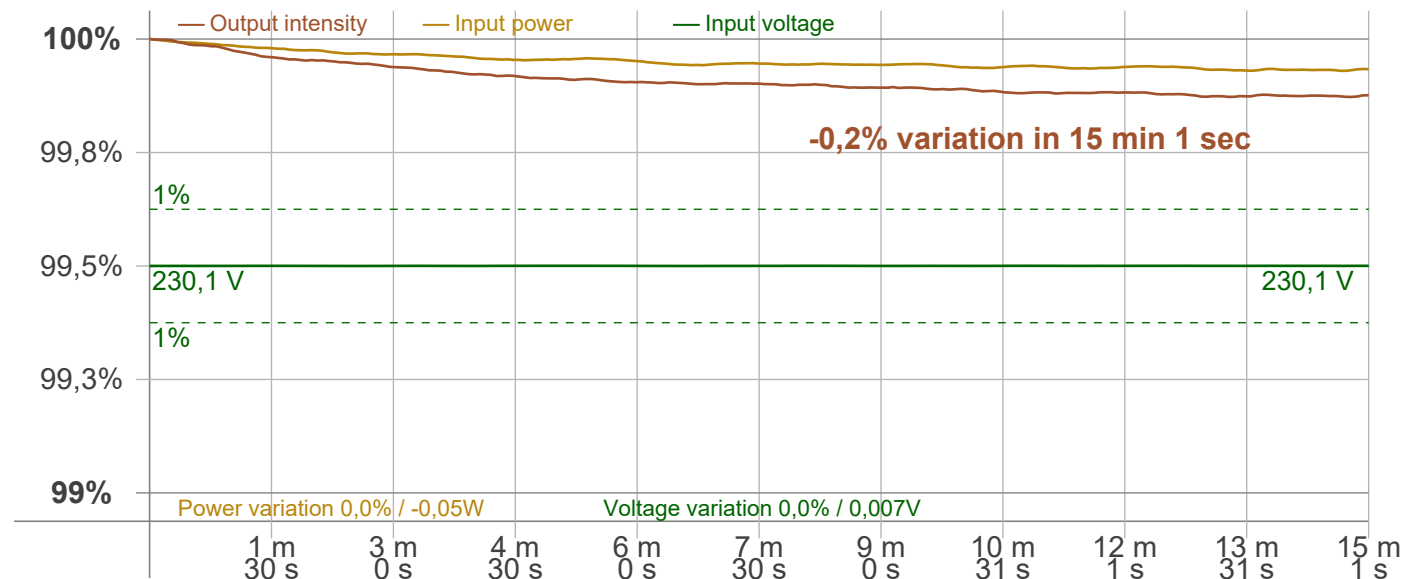

Light Measurement Report

Print date: 5-9-2025

Measurement date and time: 5-9-2025 09:16:08 – Measurement no. VFR-250905-2960-MS

Measurement tracking No. and Link: [VT250905-007355](https://www.viso-systems.com/VT250905-007355)

Operator:



Flicker /TLA details

Flicker Meter Type Viso Systems LabFlicker
 Frequency of input power 50 Hz
 Flicker/TLA sample rate 20000 samples/s

Measurement time
 PstLM 180 sec
 All other indices 1,2 sec

Flicker indices according to Illuminating Engineering Society (IES)

Flicker frequency 99,5 Hz
 Percent Flicker 0,29 %
 Flicker index 0

Flicker indices according to California Energy Commission (CEC) 2016b

JA8/10 40 Hz 0,02 %
 JA8/10 90 Hz 0,02 %
 JA8/10 200 Hz 0,28 %
 JA8/10 400 Hz 0,28 %
 JA8/10 1000 Hz 0,28 %


TLA indices (re IEC TR 61547-1, IEC 61000-3-3 and IEC 61000-4-15)

PstLM value (F < 80 Hz) 0,02
 SVM value (80 < F < 2000 Hz) 0,01

Flicker indices according to Lighting Research Center (2015)

Perception metric, Assist Mp 0,01

Flicker frame (frame of one flicker period in time domain)

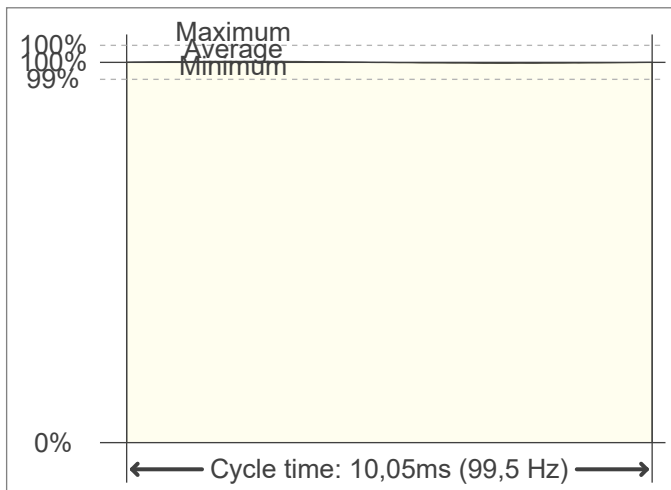

Flicker FFT (flicker curve in frequency domain)



IEEE 1789 Frequency/modulation plot

