

Light Measurement Report

Print date: 7-5-2025

Measurement date and time: 7-5-2025 08:56:14 – Measurement no. VFR-250507-1117-MS

Measurement tracking No. and Link: [VT250507-007924](#)

Operator:



Laboratory and Equipment

Laboratory Owner and Location

Goniospectrometer System and Type

Sensor Name, Calibr. Date and Serial No.

Spectrometer Manufacturer and Model

Viso Systems, Copenhagen V, Denmark

LabSpion – Type C, horizontal

LabSensor Model2 – 11-1-2024 – 3130191315

Ibsen Photonics, Denmark – Freedom VIS (Custom Viso)

Measurement Conditions

Number of C-planes and Resolution

γ (gamma)-Resolution

Test Distance

Input Power, Power and Displ. Factors

Input RMS Voltage and Current

Frequency of Input Power

Warm-up Time and Variation

24 planes – 15°

5°

2,00 m

19,5 W – PF 0,91 – DPF 0,99

230 V – 0,092 A

50 Hz

Lamp stabilized in 32 min 2 sec – 2,0%

Tested Light Source

Product Name

Item No. and Manufacturer

Product Description (line 1)

845673-4000K

845673-4000K – Dutchfulfillment

3-FASE RAILSPOT ELARA 20W WIT

Main Light Measurement Results

Output – Total Lumen (Up% / Down%)

Efficiency

Peak Intensity and Beam Angle

Correlated Color Temperature, Target/Measured

Color Rendering Index

Color Rendering TM30-18

Color Shift, CIE duv and MacAdam Steps

Flicker

1600 lm – 0,05% / 99,95%

82 lm/W

2814 cd – 44,7°



CCT = 4000 K / 3958 K

CRI 81,5

R_f 83,6 – R_g 95,8

Duv 0,0017 – SDCM 1,8

SVM 0,07 – PstLM 0,02

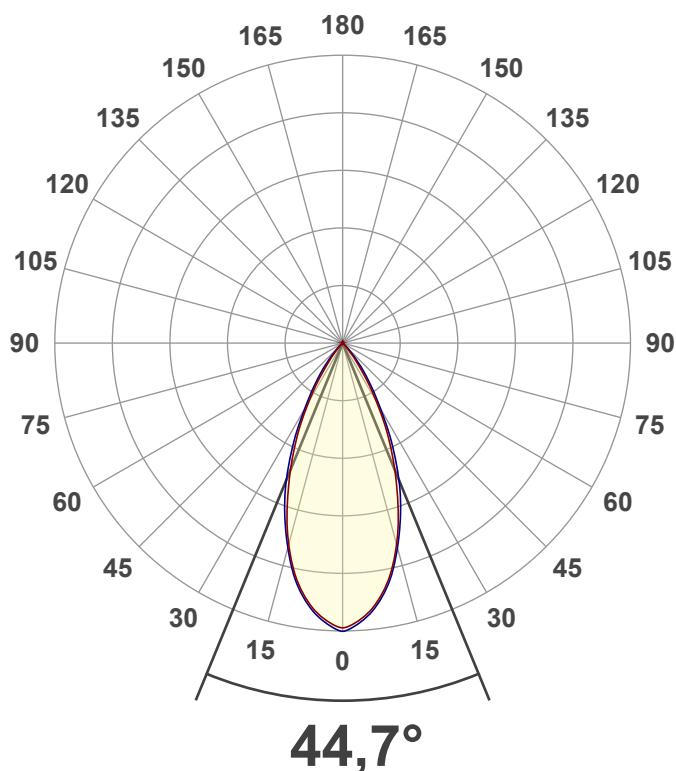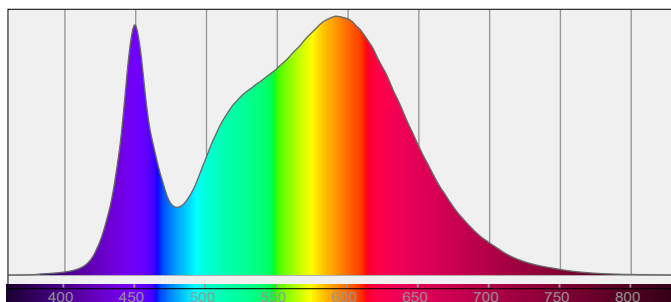

Light Measurement Report

Print date: 7-5-2025

Measurement date and time: 7-5-2025 08:56:14 – Measurement no. VFR-250507-1117-MS


Measurement tracking No. and Link: [VT250507-007924](#)

Operator:



Luminous Intensity diagram

Unit: 0-100% of peak intensity

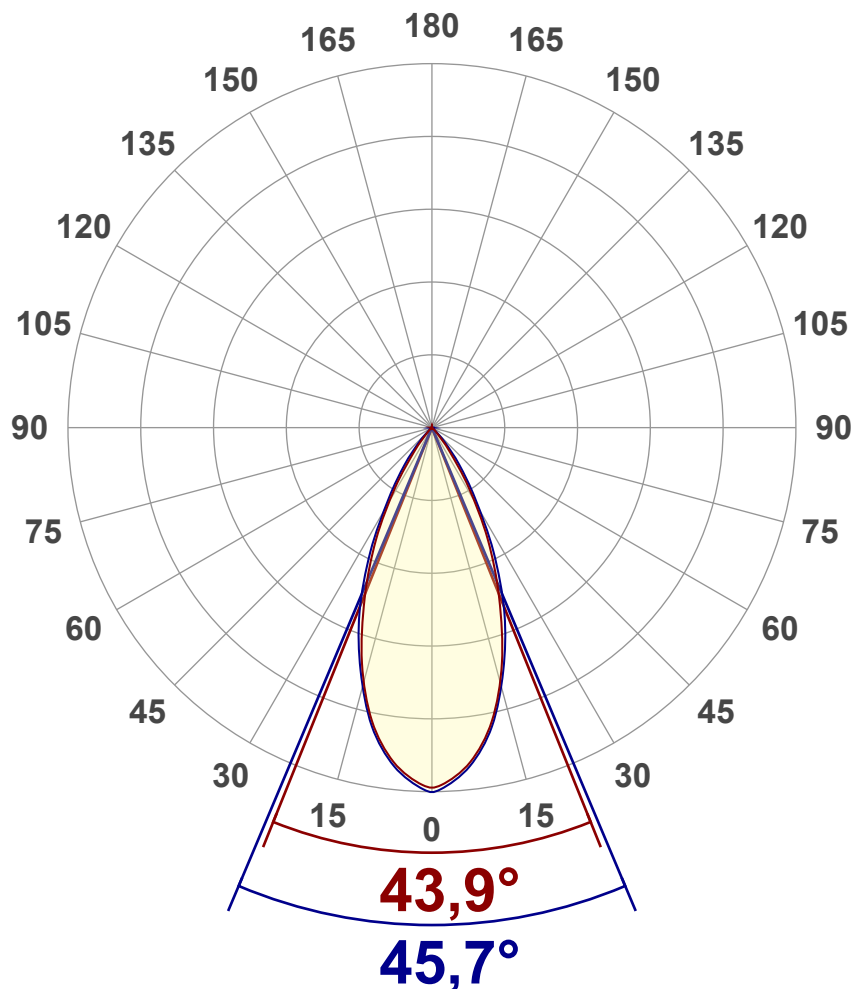

Main Values

Output (total Lumen)	1600 lm
Lumen Up% / Down%	0,05% / 99,95%
Peak Intensity	2814 cd
Beam Angle (50%)	44,7°
Beam Angle (90%)	45,7°
Beam Angle (10%)	44,3°

Cut-off Angle

Average 2,5%	85,2°
--------------	-------

Field Angle

Average 10%	73,1°
-------------	-------


Intensity Ratio

In 120° cone	99,6%
In 90° cone	98,9%

C000-C180

C090-C270

Linear distribution diagram - Intensity (candela) vs γ-angle

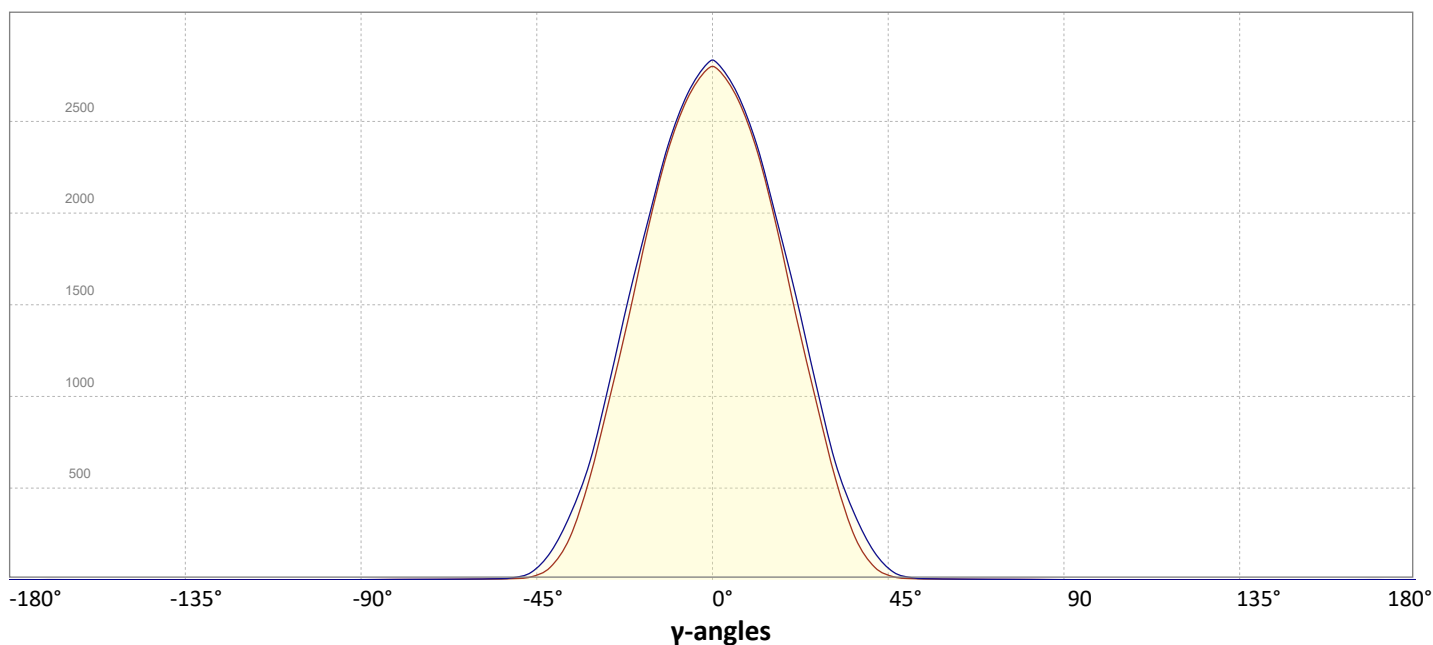


Light Measurement Report


Print date: 7-5-2025
Measurement date and time: 7-5-2025 08:56:14 – Measurement no. VFR-250507-1117-MS
Measurement tracking No. and Link: [VT250507-007924](#)
Operator:



Iso-intensity Diagram (Iso-candela)

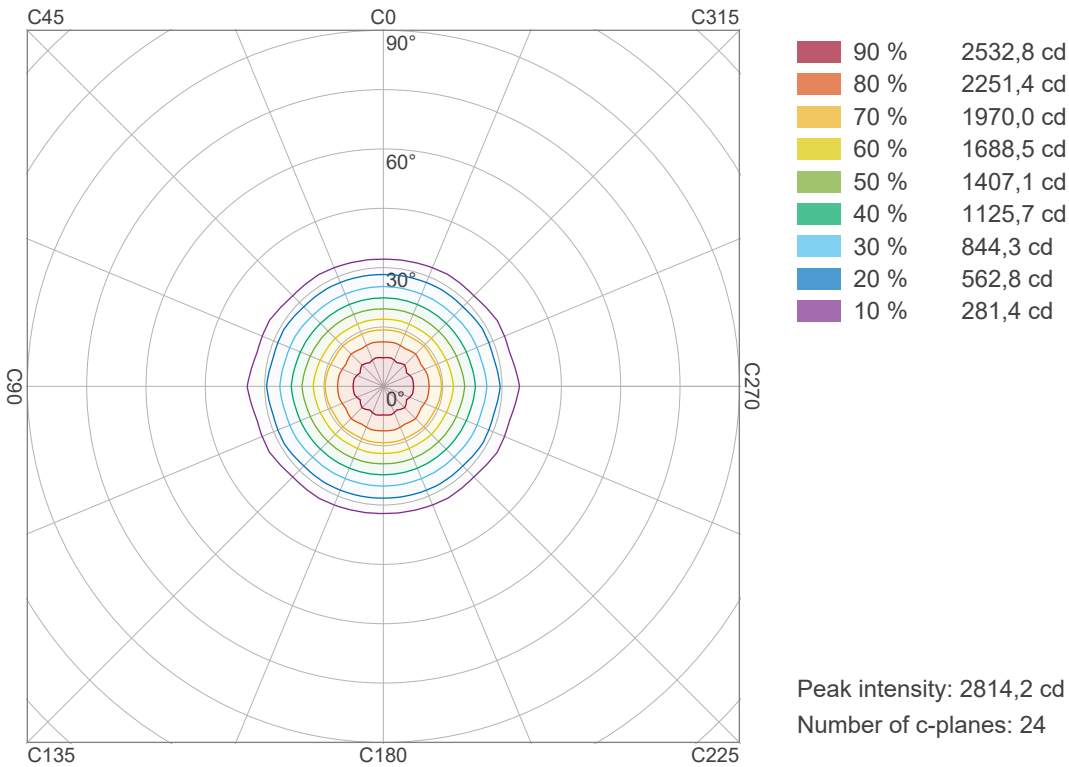

Iso-illuminance Diagram (Iso-lux)

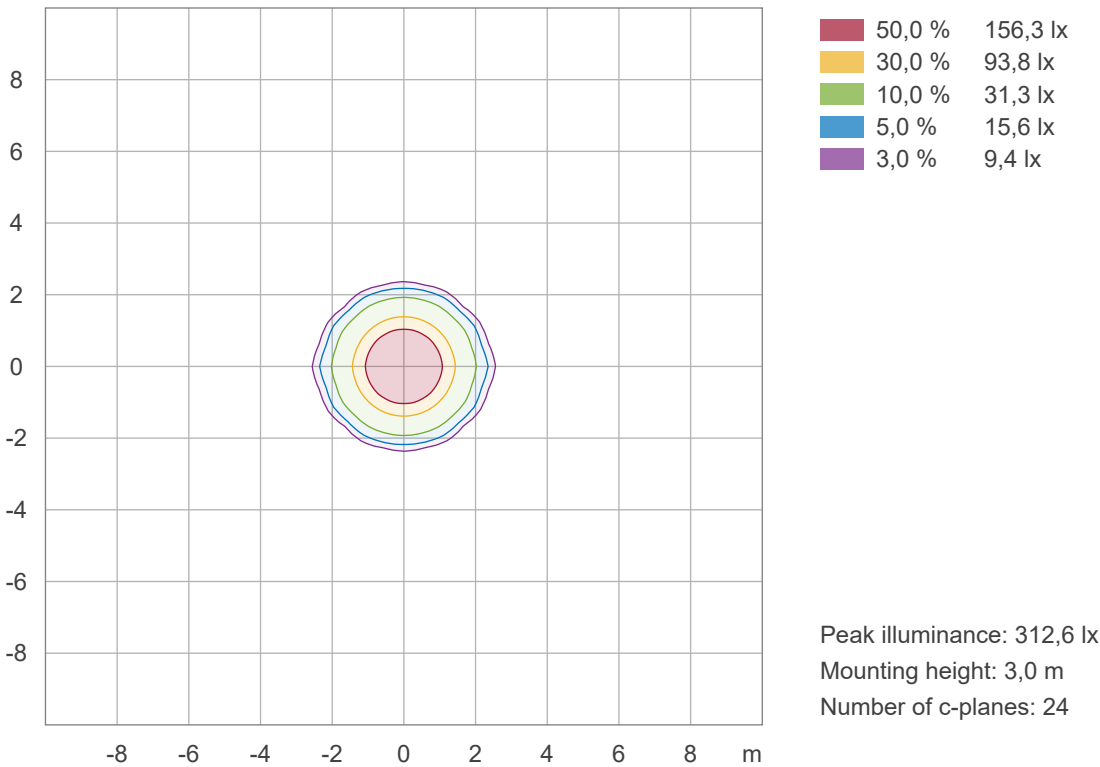

Light Measurement Report

Print date: 7-5-2025

Measurement date and time: 7-5-2025 08:56:14 – Measurement no. VFR-250507-1117-MS

Measurement tracking No. and Link: [VT250507-007924](https://vfr-250507-1117-MS)

Operator:




Color details


Correlated Color Temperature, Target CCT = 4000 K
Correlated Color Temperature, Measured CCT = 3958 K
Color Rendering Index CRI 81,5
Color Rendering Index, R9 (red component) R9 = 2,1
Color Rendering TM30-18 R_f 83,6 – R_g 95,8
Color Quality Scale CQS = 81,4

MacAdam Steps
Color coordinates CIE 1931 (x;y) = (0,381;0,377)
Color coordinate CIEs 1960 (u;v) = (0,225;0,334)
Color deviation from BBL Duv = 0,0017
Color coordinate CIEs 1976 (CIELUV) (u';v') = (0,225;0,502)


CIE 1931

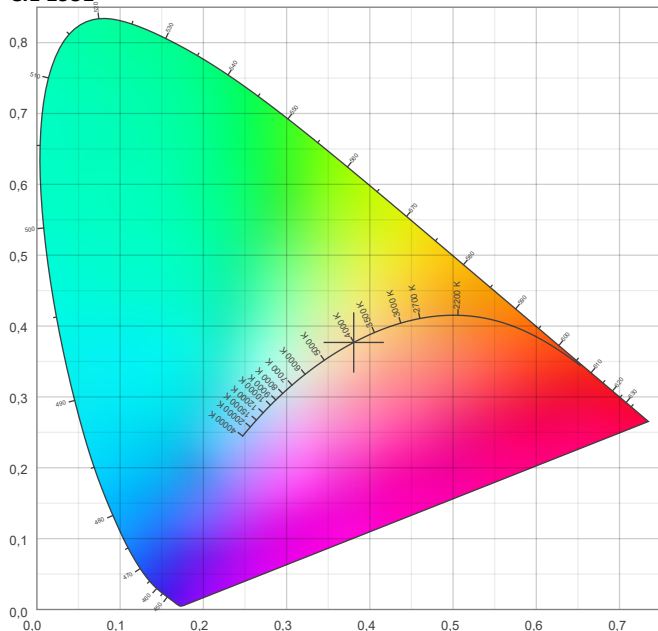

CIE 1931 – zoomed on Planckian locus

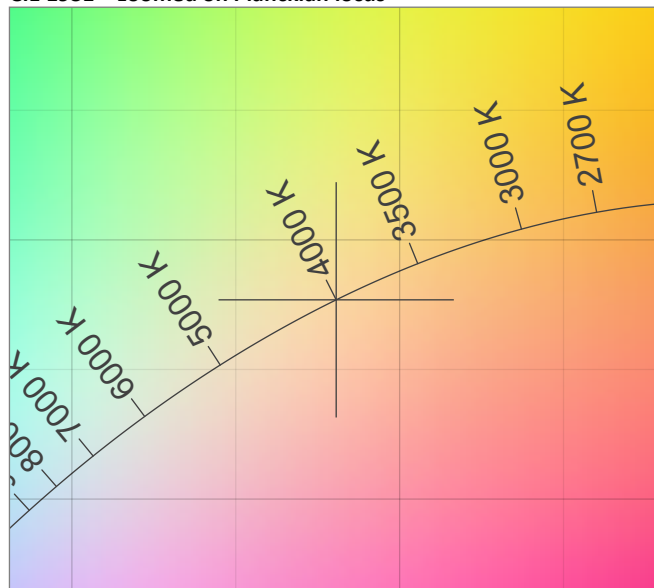


Color Rendering Index per reference color (CIE 1995)

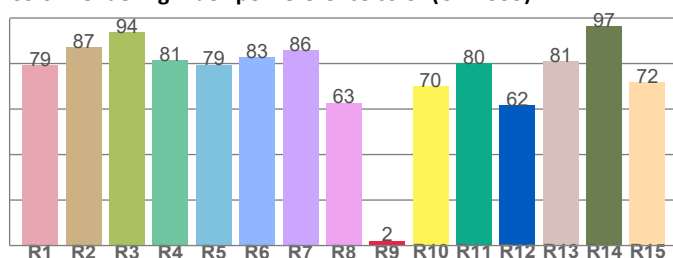


CRI R values, only R1-R8 are used to calculate final CRI value

R1	R2	R3	R4	R5	R6	R7	R8	R9	R10	R11	R12	R13	R14	R15
79,4	87,2	93,7	81,3	79,5	82,7	85,7	62,8	2,1	69,9	80,2	61,7	81,1	96,5	71,9

Spectral power distribution (SPD) / W/nm – 0-100%

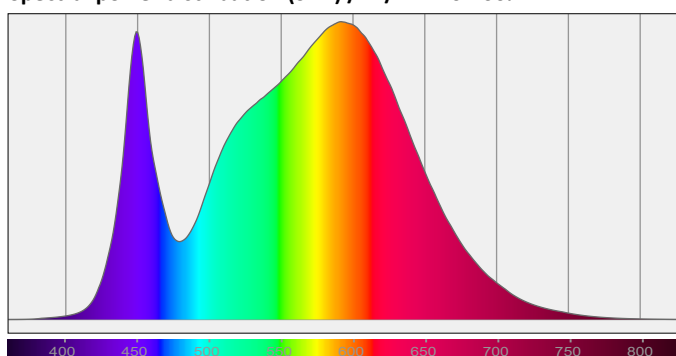


TM30-18 R_f-values per hue bin

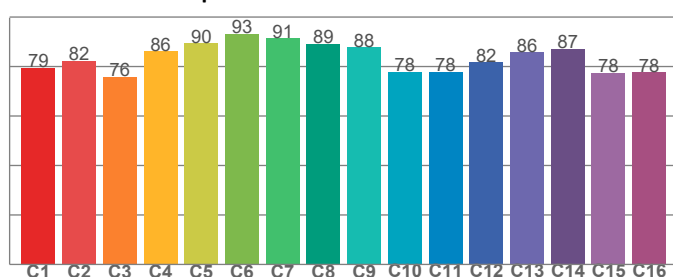

TM30 C values, 16 binned values out of total of 99 C values

C1	C2	C3	C4	C5	C6	C7	C8	C9	C10	C11	C12	C13	C14	C15	C16
79,5	82,3	75,9	86,1	89,5	93,2	91,5	89,3	87,9	77,9	77,9	81,6	85,7	87,2	77,5	77,7

Color Quality Scale by reference color

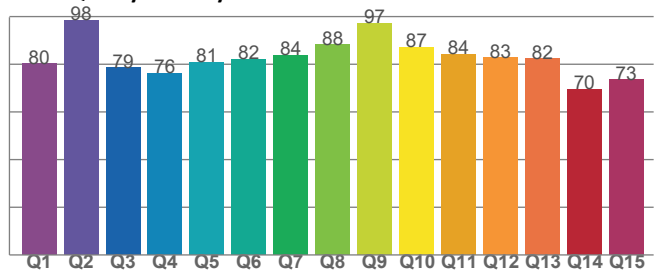

CQS Q values

Q1	Q2	Q3	Q4	Q5	Q6	Q7	Q8	Q9	Q10	Q11	Q12	Q13	Q14	Q15
80,3	98,4	78,6	76,2	81,0	82,2	83,8	88,2	97,3	87,2	84,1	82,7	82,2	69,6	73,4

Light Measurement Report

Print date: 7-5-2025


Measurement date and time: 7-5-2025 08:56:14 – Measurement no. VFR-250507-1117-MS

Measurement tracking No. and Link: [VT250507-007924](#)

Operator:



Beam Details

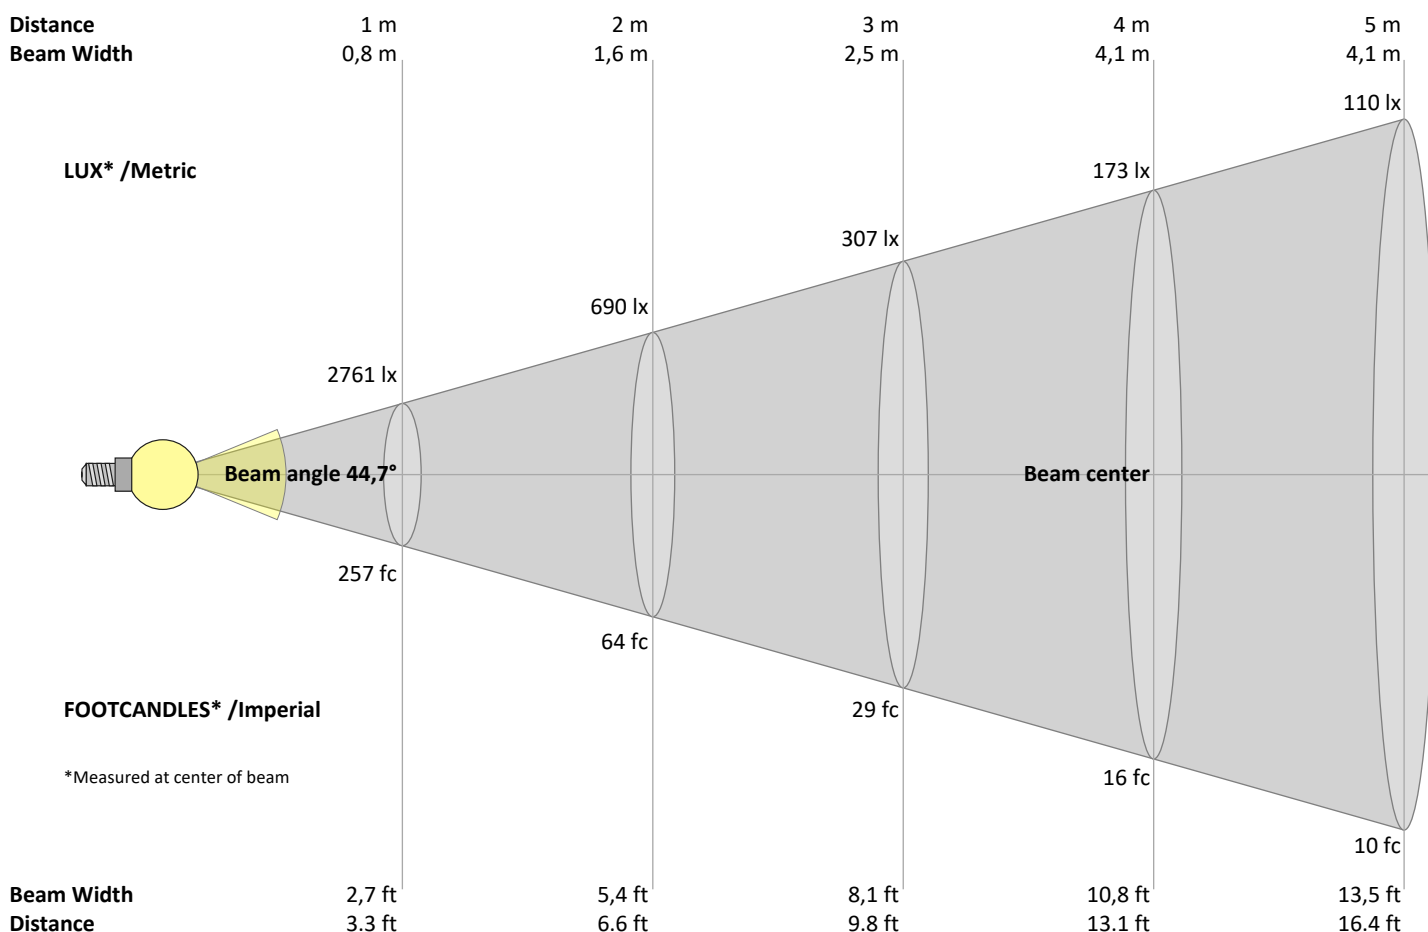

Beam intensities from 1 – 20 m

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	m
3,3	6,6	9,8	13,1	16,4	19,7	23	26,2	29,5	32,8	36,1	39,4	42,7	45,9	49,2	52,5	55,8	59,1	62,3	65,6	ft
2761	690	307	173	110	77	56	43	34	28	23	19	16	14	12	11	10	9	8	7	lux
256,5	64,1	28,5	16	10,3	7,1	5,2	4	3,2	2,6	2,1	1,8	1,5	1,3	1,1	1	0,9	0,8	0,7	0,6	fc

Intensities in 0° c-plane

0°	2°	4°	6°	8°	10°	12°	14°	16°	18°	20°	22°	24°	26°	28°	30°	32°	34°	36°	38°	γ
2761	2765	2701	2636	2534	2419	2292	2124	1957	1770	1575	1383	1202	1022	848	678	518	391	264	183	cd
100%	100%	98%	95%	92%	88%	83%	77%	71%	64%	57%	50%	44%	37%	31%	25%	19%	14%	10%	7%	of 0°val

Intensities in 90° c-plane

0°	2°	4°	6°	8°	10°	12°	14°	16°	18°	20°	22°	24°	26°	28°	30°	32°	34°	36°	38°	γ
2761	2794	2728	2663	2560	2447	2320	2160	1999	1832	1663	1488	1301	1114	938	764	609	494	379	291	cd
100%	101%	99%	96%	93%	89%	84%	78%	72%	66%	60%	54%	47%	40%	34%	28%	22%	18%	14%	11%	of 0°val

Intensities in 180° c-plane

0°	2°	4°	6°	8°	10°	12°	14°	16°	18°	20°	22°	24°	26°	28°	30°	32°	34°	36°	38°	γ
2761	2765	2701	2636	2534	2419	2292	2124	1957	1770	1575	1383	1202	1022	848	678	518	391	264	183	cd
100%	100%	98%	95%	92%	88%	83%	77%	71%	64%	57%	50%	44%	37%	31%	25%	19%	14%	10%	7%	of 0°val

Intensities in 270° c-plane

0°	2°	4°	6°	8°	10°	12°	14°	16°	18°	20°	22°	24°	26°	28°	30°	32°	34°	36°	38°	γ
2761	2794	2728	2663	2560	2447	2320	2160	1999	1832	1663	1488	1301	1114	938	764	609	494	379	291	cd
100%	101%	99%	96%	93%	89%	84%	78%	72%	66%	60%	54%	47%	40%	34%	28%	22%	18%	14%	11%	of 0°val

Light Measurement Report

Print date: 7-5-2025

Measurement date and time: 7-5-2025 08:56:14 – Measurement no. VFR-250507-1117-MS

Measurement tracking No. and Link: [VT250507-007924](#)

Operator:



Light Planning – UGR table

Uncorrected, comprehensive UGR table according to 117-1995

Reflectances											
	ρ Ceiling	70	70	50	50	30	70	70	50	50	30
	ρ Walls	50	30	50	30	30	50	30	50	30	30
	ρ Floor	20	20	20	20	20	20	20	20	20	20
Room size		Viewed Crosswise					Viewed Endwise				
H = mounting height above eye level		(Viewing direction orthogonal to lamp length axis)					(Viewing direction parallel to lamp length axis)				
X	Y										
2H	2H	18,1	18,7	18,2	18,9	19,1	19,0	19,6	19,1	19,8	20,0
	3H	17,8	18,5	18,2	18,7	18,9	18,7	19,4	19,1	19,6	19,8
	4H	17,7	18,4	18,1	18,6	18,9	18,6	19,3	19,0	19,5	19,8
	6H	17,7	18,3	18,0	18,6	18,9	18,6	19,2	18,9	19,5	19,8
	8H	17,7	18,2	18,0	18,5	18,9	18,6	19,1	18,9	19,5	19,8
	12H	17,6	18,1	18,0	18,5	18,9	18,5	19,1	18,9	19,4	19,8
4H	2H	17,7	18,4	18,1	18,6	18,9	18,6	19,3	19,0	19,5	19,8
	3H	17,6	18,1	18,0	18,5	18,9	18,5	19,1	18,9	19,4	19,8
	4H	17,5	18,0	17,9	18,4	18,9	18,4	18,9	18,8	19,3	19,8
	6H	17,4	17,9	17,9	18,3	18,6	18,3	18,8	18,8	19,2	19,5
	8H	17,4	17,8	17,9	18,2	18,5	18,3	18,7	18,8	19,1	19,4
	12H	17,3	17,7	17,8	18,1	18,5	18,2	18,6	18,7	19,0	19,4
8H	4H	17,3	17,8	17,9	18,2	18,5	18,3	18,7	18,8	19,1	19,4
	6H	17,3	17,6	17,8	18,1	18,6	18,2	18,5	18,7	19,0	19,5
	8H	17,3	17,5	17,8	18,1	18,7	18,2	18,4	18,7	19,0	19,6
	12H	17,2	17,4	17,8	18,0	18,6	18,1	18,3	18,7	18,9	19,5
12H	4H	17,3	17,7	17,8	18,1	18,5	18,2	18,6	18,7	19,0	19,4
	6H	17,3	17,5	17,8	18,1	18,7	18,2	18,4	18,7	19,0	19,6
	8H	17,2	17,4	17,8	17,9	18,5	18,1	18,3	18,7	18,8	19,4
Variations with the observer position for the luminaire spacings, S:											
S = 1.0H		5,9 / -13,0					5,7 / -14,0				
S = 1.5H		8,6 / -13,3					8,4 / -14,4				
S = 2.0H		10,6 / -13,6					10,4 / -14,8				

Coefficients of Utilization

Ceiling reflectance	80			70			50			30			10			0		
Wall reflectance	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
Floor reflectance	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	0
RCR		(RCR: Room Cavity Ratio)			Room Values are expressed as percentage of Lumen delivered to the task surface													
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	114	111	109	107	112	109	107	105	105	104	102	102	100	99	98	97	96	95
2	109	105	101	98	107	103	100	97	100	97	95	97	95	93	94	92	91	89
3	104	99	94	91	102	97	93	90	95	91	88	92	89	87	90	88	86	84
4	100	93	88	84	98	92	87	84	90	86	83	88	85	82	86	83	81	80
5	95	88	83	79	94	87	82	79	85	81	78	84	80	77	82	79	77	75
6	91	83	78	74	90	83	78	74	81	77	74	80	76	73	79	75	73	71
7	88	79	74	70	86	79	74	70	77	73	70	76	72	69	75	72	69	68
8	84	75	70	66	83	75	70	66	74	69	66	73	69	66	72	68	65	64
9	81	72	67	63	79	71	66	63	71	66	63	70	66	63	69	65	62	61
10	77	69	63	60	76	68	63	60	67	63	60	67	63	60	66	62	59	58


Light Measurement Report

Print date: 7-5-2025
Measurement date and time: 7-5-2025 08:56:14 – Measurement no. VFR-250507-1117-MS
Measurement tracking No. and Link: [VT250507-007924](#)
Operator:



Luminaire budgetary diagram

Uncorrected, comprehensive UGR table according to 117-1995
LAMPS (number of lamps)

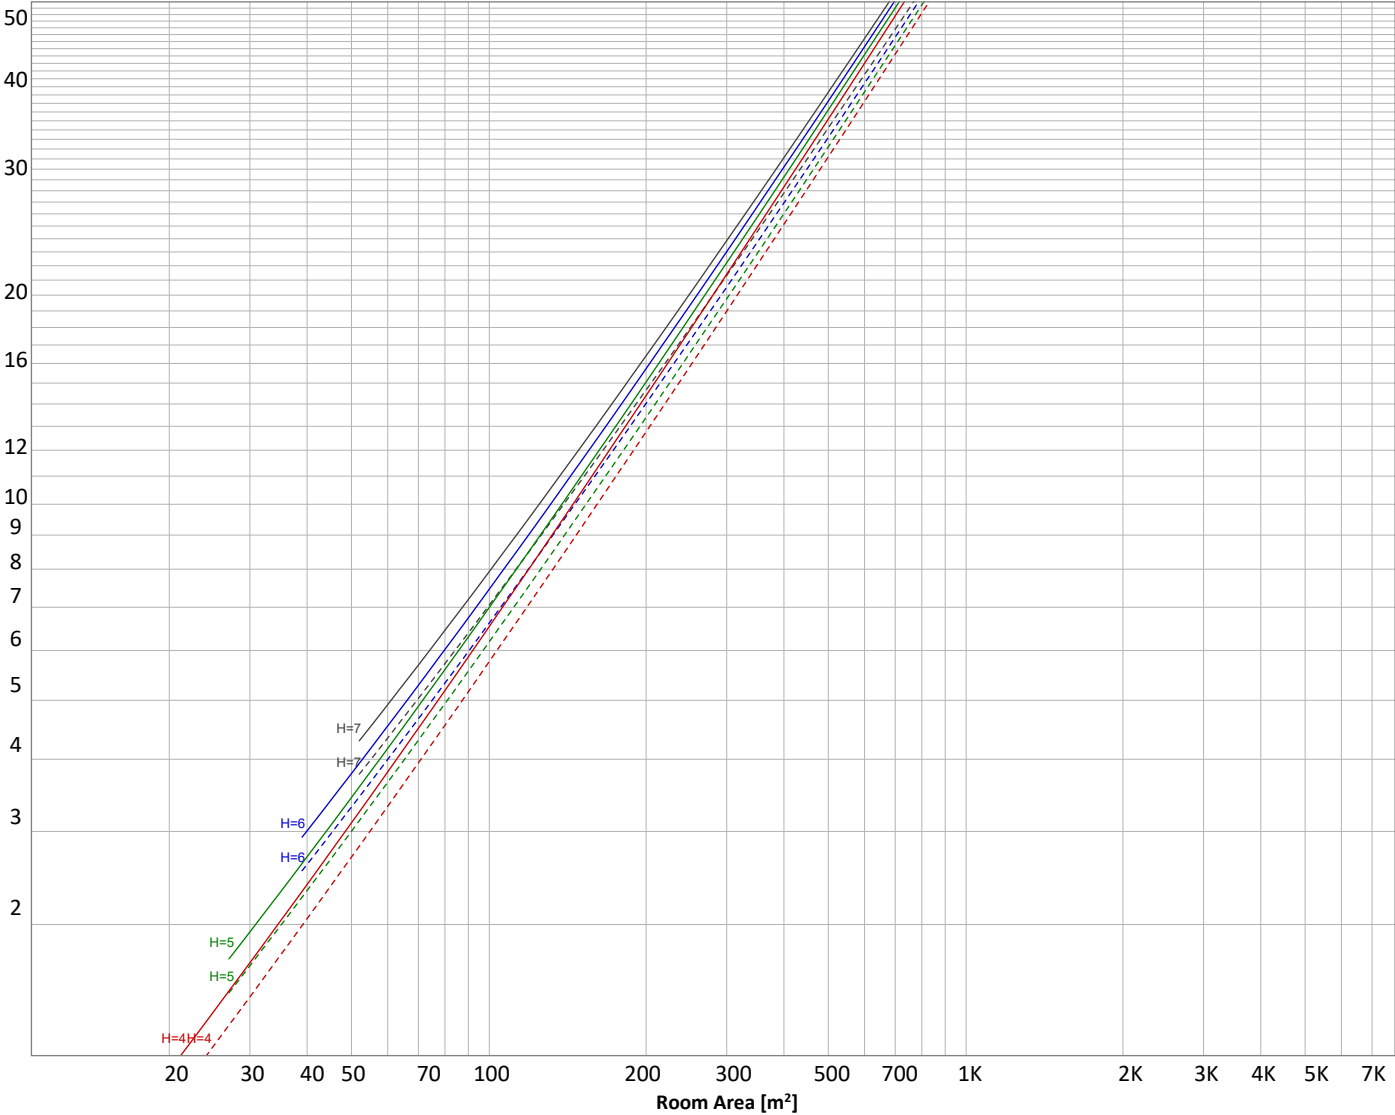

Conditions

H = Room height	Flux = 1600 lm	p(%)		
H _{down} = Lamp distance from ceiling =	0.00 m	Line type	Ceiling reflectance	Wall reflectance
H _{work} = Work area height from floor =	0.00 m		70	50
E _{work} = Average lux on work area =	100 lx		50	30
				Floor reflectance
				20

Zonal Lumen Summary

0°-10°	10°-20°	20°-30°	30°-40°	40°-50°	50°-60°	60°-70°	70°-80°	80°-90°
248 lm	569 lm	515 lm	225 lm	32,4 lm	4,52 lm	2,77 lm	2,07 lm	1,35 lm
90°-100°	100°-110°	110°-120°	120°-130°	130°-140°	140°-150°	150°-160°	160°-170°	170°-180°
0,186 lm	0,004 lm	0,001 lm	0,006 lm	0,035 lm	0,136 lm	0,221 lm	0,179 lm	0,060 lm

Light Measurement Report

Print date: 7-5-2025
Measurement date and time: 7-5-2025 08:56:14 – Measurement no. VFR-250507-1117-MS
Measurement tracking No. and Link: [VT250507-007924](#)
Operator:



Outdoor Light Planning

Lumen per Zone

Zone (γ)	Lumen	% Total
0-10°	{LUM00-10} lm	#VALUE!
10-20°	{LUM10-20} lm	#VALUE!
20-30°	{LUM20-30} lm	#VALUE!
30-40°	{LUM30-40} lm	#VALUE!
40-50°	{LUM40-50} lm	#VALUE!
50-60°	{LUM50-60} lm	#VALUE!
60-70°	{LUM60-70} lm	#VALUE!
70-80°	{LUM70-80} lm	#VALUE!
80-90°	{LUM80-90} lm	#VALUE!
90-100°	{LUM90-100} lm	#VALUE!
100-110°	{LUM100-110} lm	#VALUE!
110-120°	{LUM110-120} lm	#VALUE!
120-130°	{LUM120-130} lm	#VALUE!
130-140°	{LUM130-140} lm	#VALUE!
140-150°	{LUM140-150} lm	#VALUE!
150-160°	{LUM150-160} lm	#VALUE!
160-170°	{LUM160-170} lm	#VALUE!
170-180°	{LUM170-180} lm	#VALUE!
Total	0 lm	#VALUE!

Intensity peaks

Max intensity	{PEAK} cd
Intensity, 90°	{INT90} cd
Intensity, 0°	{INT0} cd

Zonal Lumen summary


Zone (γ)	Lumen	% Total
0-30°	{LUM00-30} lm	#VALUE!
0-40°	{LUM00-40} lm	#VALUE!
0-60°	{LUM00-60} lm	#VALUE!
60-90°	{LUM60-90} lm	#VALUE!
70-100°	{LUM70-100} lm	#VALUE!
90-120°	{LUM90-120} lm	#VALUE!
0-90°	{LUM00-90} lm	#VALUE!
90-180°	{LUM90-180} lm	#VALUE!
0-180°	{LUM00-180} lm	#VALUE!

BUG rating

	Lumen	% Total
Forward light		
Low(0-30°)	{BUG0} lm	#VALUE!
Medium(30-60°)	{BUG1} lm	#VALUE!
High(60-80°)	{BUG2} lm	#VALUE!
Very high(80-90°)	{BUG3} lm	#VALUE!
Back light		
Low(0-30°)	{BUG4} lm	#VALUE!
Medium(30-60°)	{BUG5} lm	#VALUE!
High(60-80°)	{BUG6} lm	#VALUE!
Very high(80-90°)	{BUG7} lm	#VALUE!
Uplight		
Low(90-100°)	{BUG8} lm	#VALUE!
High(100-180°)	{BUG9} lm	#VALUE!

IESNA TM-15-07
Luminaire Classification System
For Outdoor Luminaires

BUG rating B2 U1 G0

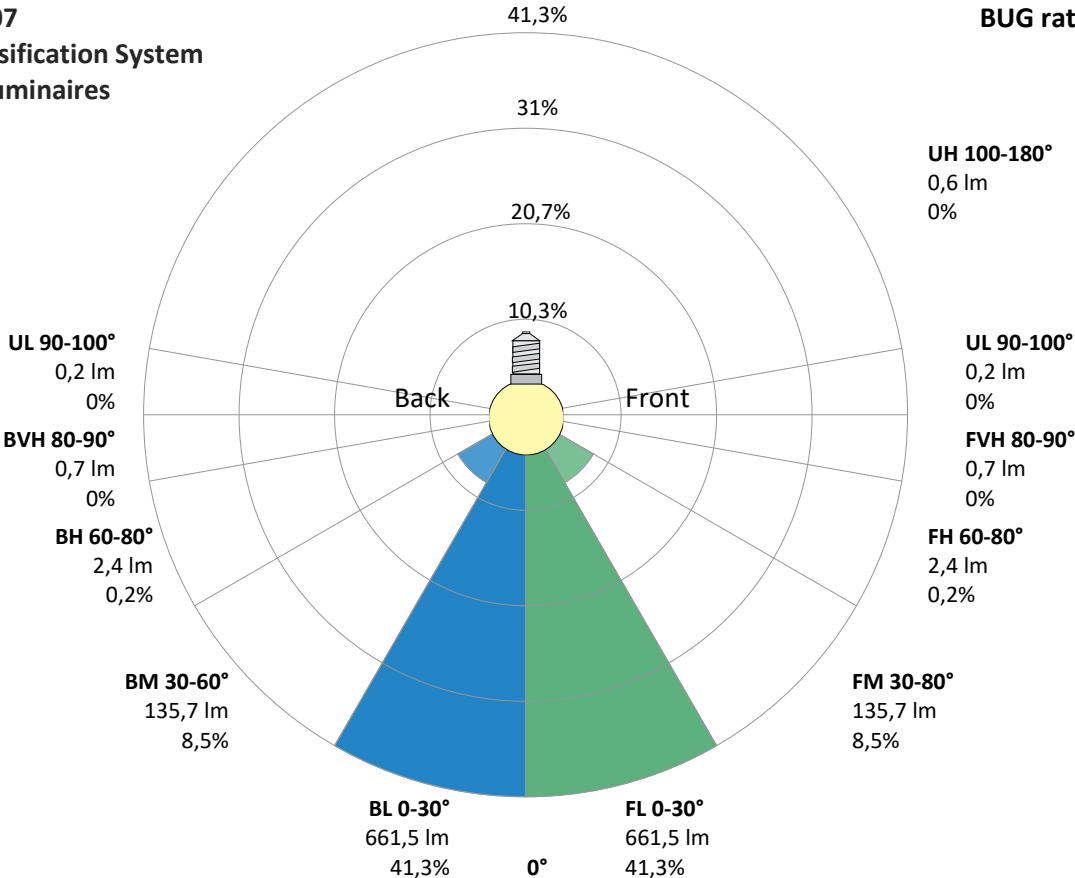

Light Measurement Report

Print date: 7-5-2025
Measurement date and time: 7-5-2025 08:56:14 – Measurement no. VFR-250507-1117-MS
Measurement tracking No. and Link: [VT250507-007924](#)
Operator:




Power Details


Input Power

Power feed to light source	19,5 W
Frequency of input power	50 Hz
RMS Input voltage feed, V_{RMS}	230 V
RMS Input current feed, I_{RMS}	0,092 A
Volt-Ampere or apparent power = $V_{RMS} * I_{RMS}$	21,26 VA
Displacement factor of AC power feed	0,99
Power factor of AC current feed	0,91
Total harmonic distortion of the current	38,5%
Total harmonic distortion of the voltage	0,13%

Input Power Curve

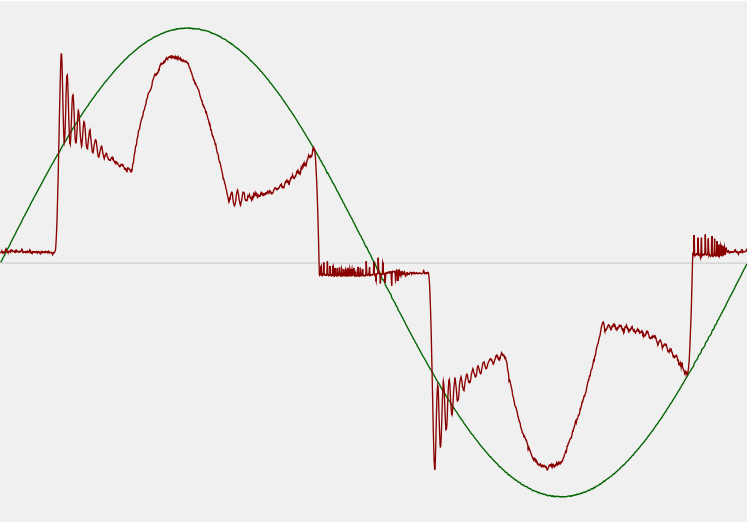

Efficiency

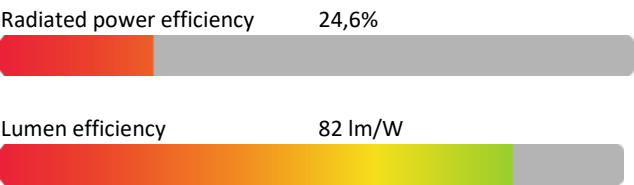

Stabilization Details

Warmup Conditions

Stable period	15 min
Stable change max	2,0%
Minimum time	15 min

Color Temperature Change

CCT start	3961 K
CCT shift	+39 K
CCT end	4000 K


Warmup Result

Total warmup time	Lamp stabilized in 32 min 2 sec
Warmup variation	-6,6%

Output Change

Output start	1712 lm
Output change	-112 lm
Output end	1600 lm

Stabilization Curve

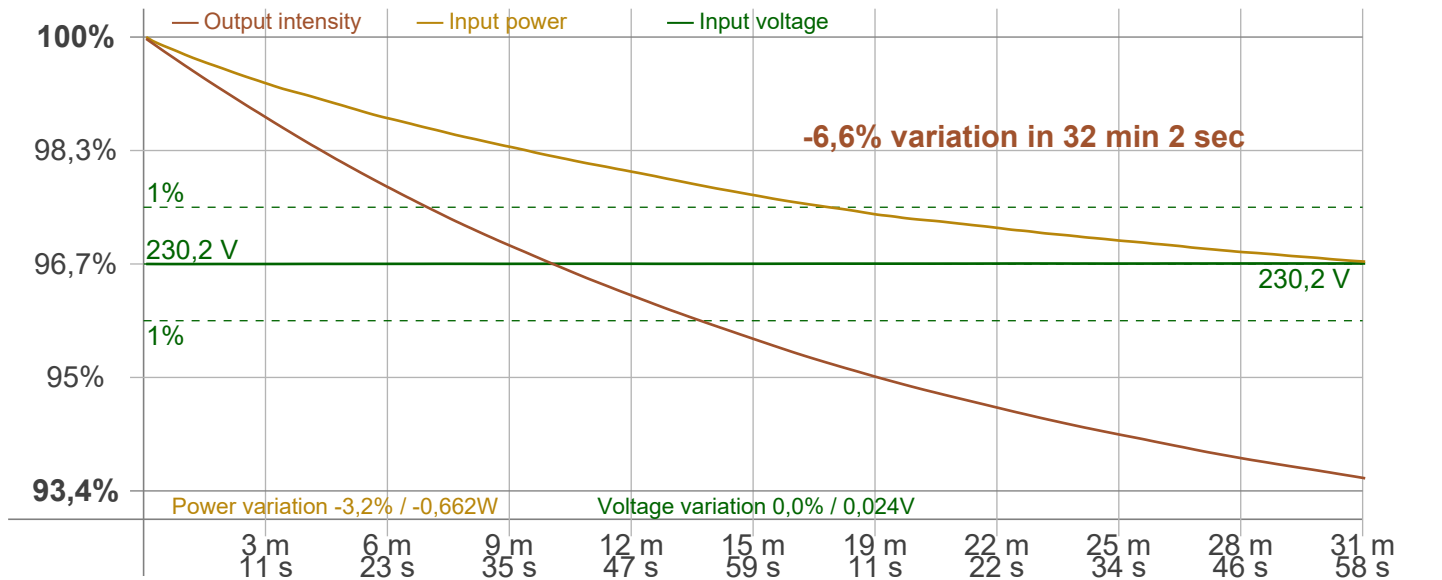

Light Measurement Report


Print date: 7-5-2025
Measurement date and time: 7-5-2025 08:56:14 – Measurement no. VFR-250507-1117-MS
Measurement tracking No. and Link: [VT250507-007924](#)
Operator:




Flicker /TLA details

Flicker Meter Type	Viso Systems LabFlicker	Measurement time	
Frequency of input power	50 Hz	PstLM	180 sec
Flicker/TLA sample rate	20000 samples/s	All other indices	1,2 sec
Flicker indices according to Illuminating Engineering Society (IES)		Flicker indices according to California Energy Commission (CEC) 2016b	
Flicker frequency	100 Hz	JA8/10 40 Hz	0,02 %
Percent Flicker	1,72 %	JA8/10 90 Hz	0,02 %
Flicker index	0,01	JA8/10 200 Hz	1,79 %
		JA8/10 400 Hz	1,73 %
		JA8/10 1000 Hz	1,72 %
TLA indices (re IEC TR 61547-1, IEC 61000-3-3 and IEC 61000-4-15)		Flicker indices according to Lighting Research Center (2015)	
PstLM value (F < 80 Hz)	0,02	Perception metric, Assist Mp	0,01
SVM value (80 < F < 2000 Hz)	0,07		

Flicker frame (frame of one flicker period in time domain)

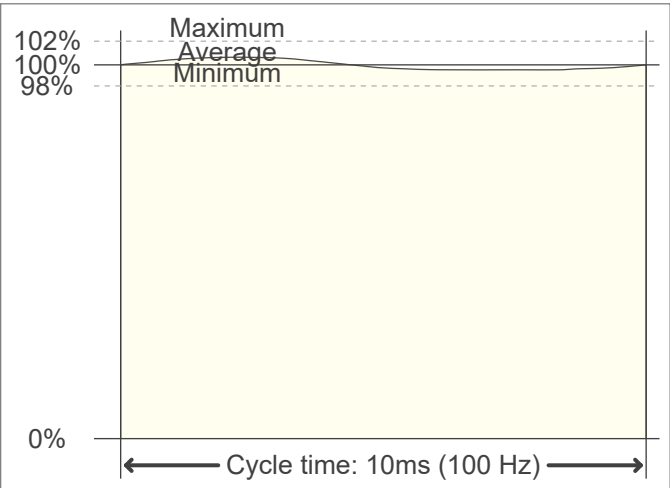

Flicker FFT (flicker curve in frequency domain)

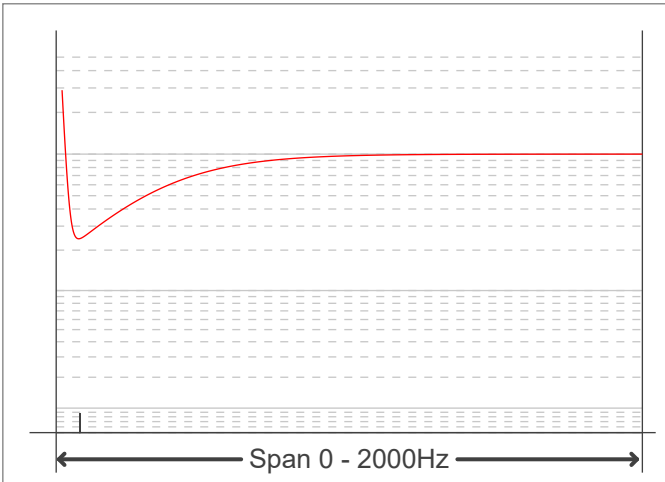

IEEE 1789 Frequency/modulation plot

